



TEST REPORT

Client	GST Datacom Technology LLC Dubai, UAE		
Sample Description	Cabinet 12U 150 Deep – Wall mount series	Report No.	WD-R-240926-0528
Part Number	1. 12U 600X600X150mm 2. 12U 600X600X300mm 3. 12U 600X450X150mm 4. 12U 600X450X120mm	Request No.	WD-Q-240926-0167
Country of Origin	UAE	Sample No.	WD-S-240926-0475
Test Temperature	23°C	Date Received	26/09/2024
Relative Humidity	50%	Date Test Completed	08/10/2024
Tested By	SU	Date Reported	08/10/2024

*Corrosion Resistance

Test Method : ASTM B117-19
Salt Solution used : 5% NaCl+95%Water
PH of Solution : 6.7
Temperature of test zone : 35°C
Test Duration : 240 Hours

Test	Observation	Result
Corrosion Resistance	No Cracking, Blistering, Flaking or loss of adhesion was Observed.	Resistant

Chemical Analysis

Test	Method	Unit	Result
Iron	ASTM E415-21	%	80.11
Silicon		%	0.019
Manganese		%	0.10
Phosphorus		%	0.016
Vanadium		%	0.71
Molybdenum		%	0.28
Niobium		%	0.13
Nickel		%	0.015
Chromium		%	0.010
Titanium		%	10.11





***Dimension**

Test Method: ASTM A1073/A1073M-21 & ASTM A1087/A1087M-16

Test	Unit	Result
Total Length	mm	600
Total Width	mm	600
Door opening Length	mm	590
Door opening Width	mm	590
Glass Length	mm	428
Glass Width	mm	428
Total Depth	mm	150
Distance between mounting holes	mm	494

Surface Finish

Test Method: IHP & Observation

Test	Observation	Result
Surface Finish	Surface of the sample is smooth and no physical damage observed	Satisfactory

Physical Requirements

Test	Test Conditions	Test Method	Result
Stability Test	-	IEC 60950-1 Clause No. 4.1	Not Applicable for wall mount closure
Steady Force Test	Applied Force = 30N	IEC 60950-1 Clause No. 4.2	No Damages observed
	Duration = 5 seconds		
Drop Test	Drop Height = 1 meter	IEC 60950-1 Clause No. 4.2.6	No Damages observed
Stress Relief Test	Conditioned temperature = 70°C	IEC 60950-1 Clause No. 4.2.7	No shrinkage or Distortion observed
	Duration = 7 hours		
Wall mounted Enclosure	-	IEC 60950-1 Clause No. 4.2.10	Complies with construction and available date of manufacture





Report No.: WD-R-240926-0528
Sample No.: WD-S-240926-0475

Test	Test Conditions	Test Method	Result
Side opening enclosure	-	IEC 60950-1 Clause No. 4.6	Construction is considered to comply with requirements
Thermal Requirements			
Temperature limits, materials and components	Handles, Knobs = 35°C External Surfaces = 38 °C	IEC 60950-1 Clause No. 4.6	Complies with standard limits
Design and Construction			
Edges and corners	IEC 60950-1 Clause No. 4.3		Well rounded and not to constitute hazards
Handle or Manual controls			None that would cause hazard
Adjustable controls and direct plug in equipments			No such device with equipment

Remark: None.

* Accredited by IAS.


Signed for and on behalf of Wimpey Laboratories LLC

S. Sarath Kumar
Head of Department

Test results relate only to the samples tested.

This report shall not be reproduced except in full, without the written approval of the laboratory.

End of text-

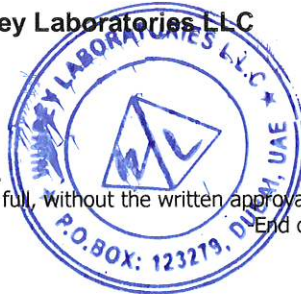

Page 3 of 3





مختبرات ويمبي ش.ذ.م.م.
WIMPEY LABORATORIES L.L.C.

IAS

ACCREDITED
Testing Laboratory

TL-564


Report No.: WD-R-240926-0528

Sample No.: WD-S-240926-0475


ANNEXURE – A

PHOTOS

Salt Spray Test:

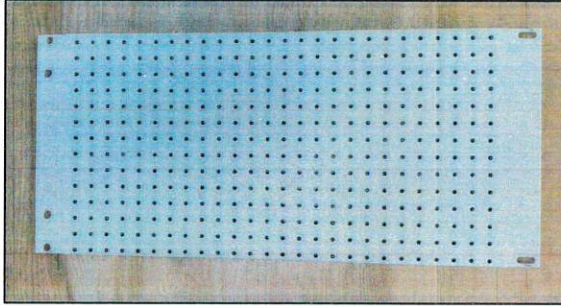

Before Test

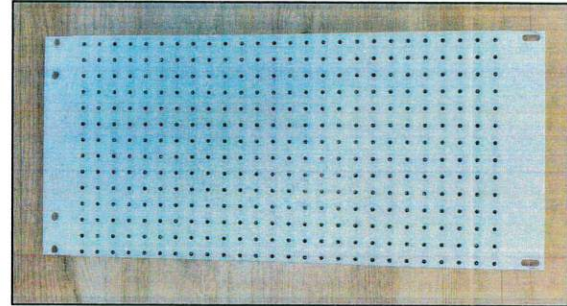

After Test

Sample photo:

