



MARTHA DEAR

STREATERY — DESIGN PERMIT DRAWING SET

3110 MOUNT PLEASANT STREET NW


PROJECT DATA

ADDRESS	3110 MOUNT PLEASANT STREET NW
SQUARE-LOT (SSL)	2596-0639
WARD / ANC	1 / 1D
BLOCK	3100 - 3145 BLOCK OF MOUNT PLEASANT STREET NW
STRUCTURE	22'-0" x 6'-0" parking-lane platform
BARRIER TYPE (§4.2)	TYPE 2
ROOF	PVC CORRUGATED ROOFING
SEATING CAPACITY (§4.8)	6 (96 SF / 15)
GENERATED	2026-06-11

SHEET INDEX

one view per sheet; page order matches the combined PDF

G1.00	COVER SHEET
G1.01	GENERAL NOTES + DDOT REQUIREMENTS
G2.00	LIFE SAFETY + ACCESSIBILITY
A1.00	SITE PLAN
A2.00	ELEVATION — STREET SIDE
A2.01	ELEVATION — SIDEWALK SIDE
A2.02	END ELEVATION — LOW STATION
A2.03	END ELEVATION — HIGH STATION
A3.00	SECTION — TYPICAL
A3.01	SECTION — ENTRY / ACCESSIBILITY
A4.00	DDOT STANDARD DETAILS

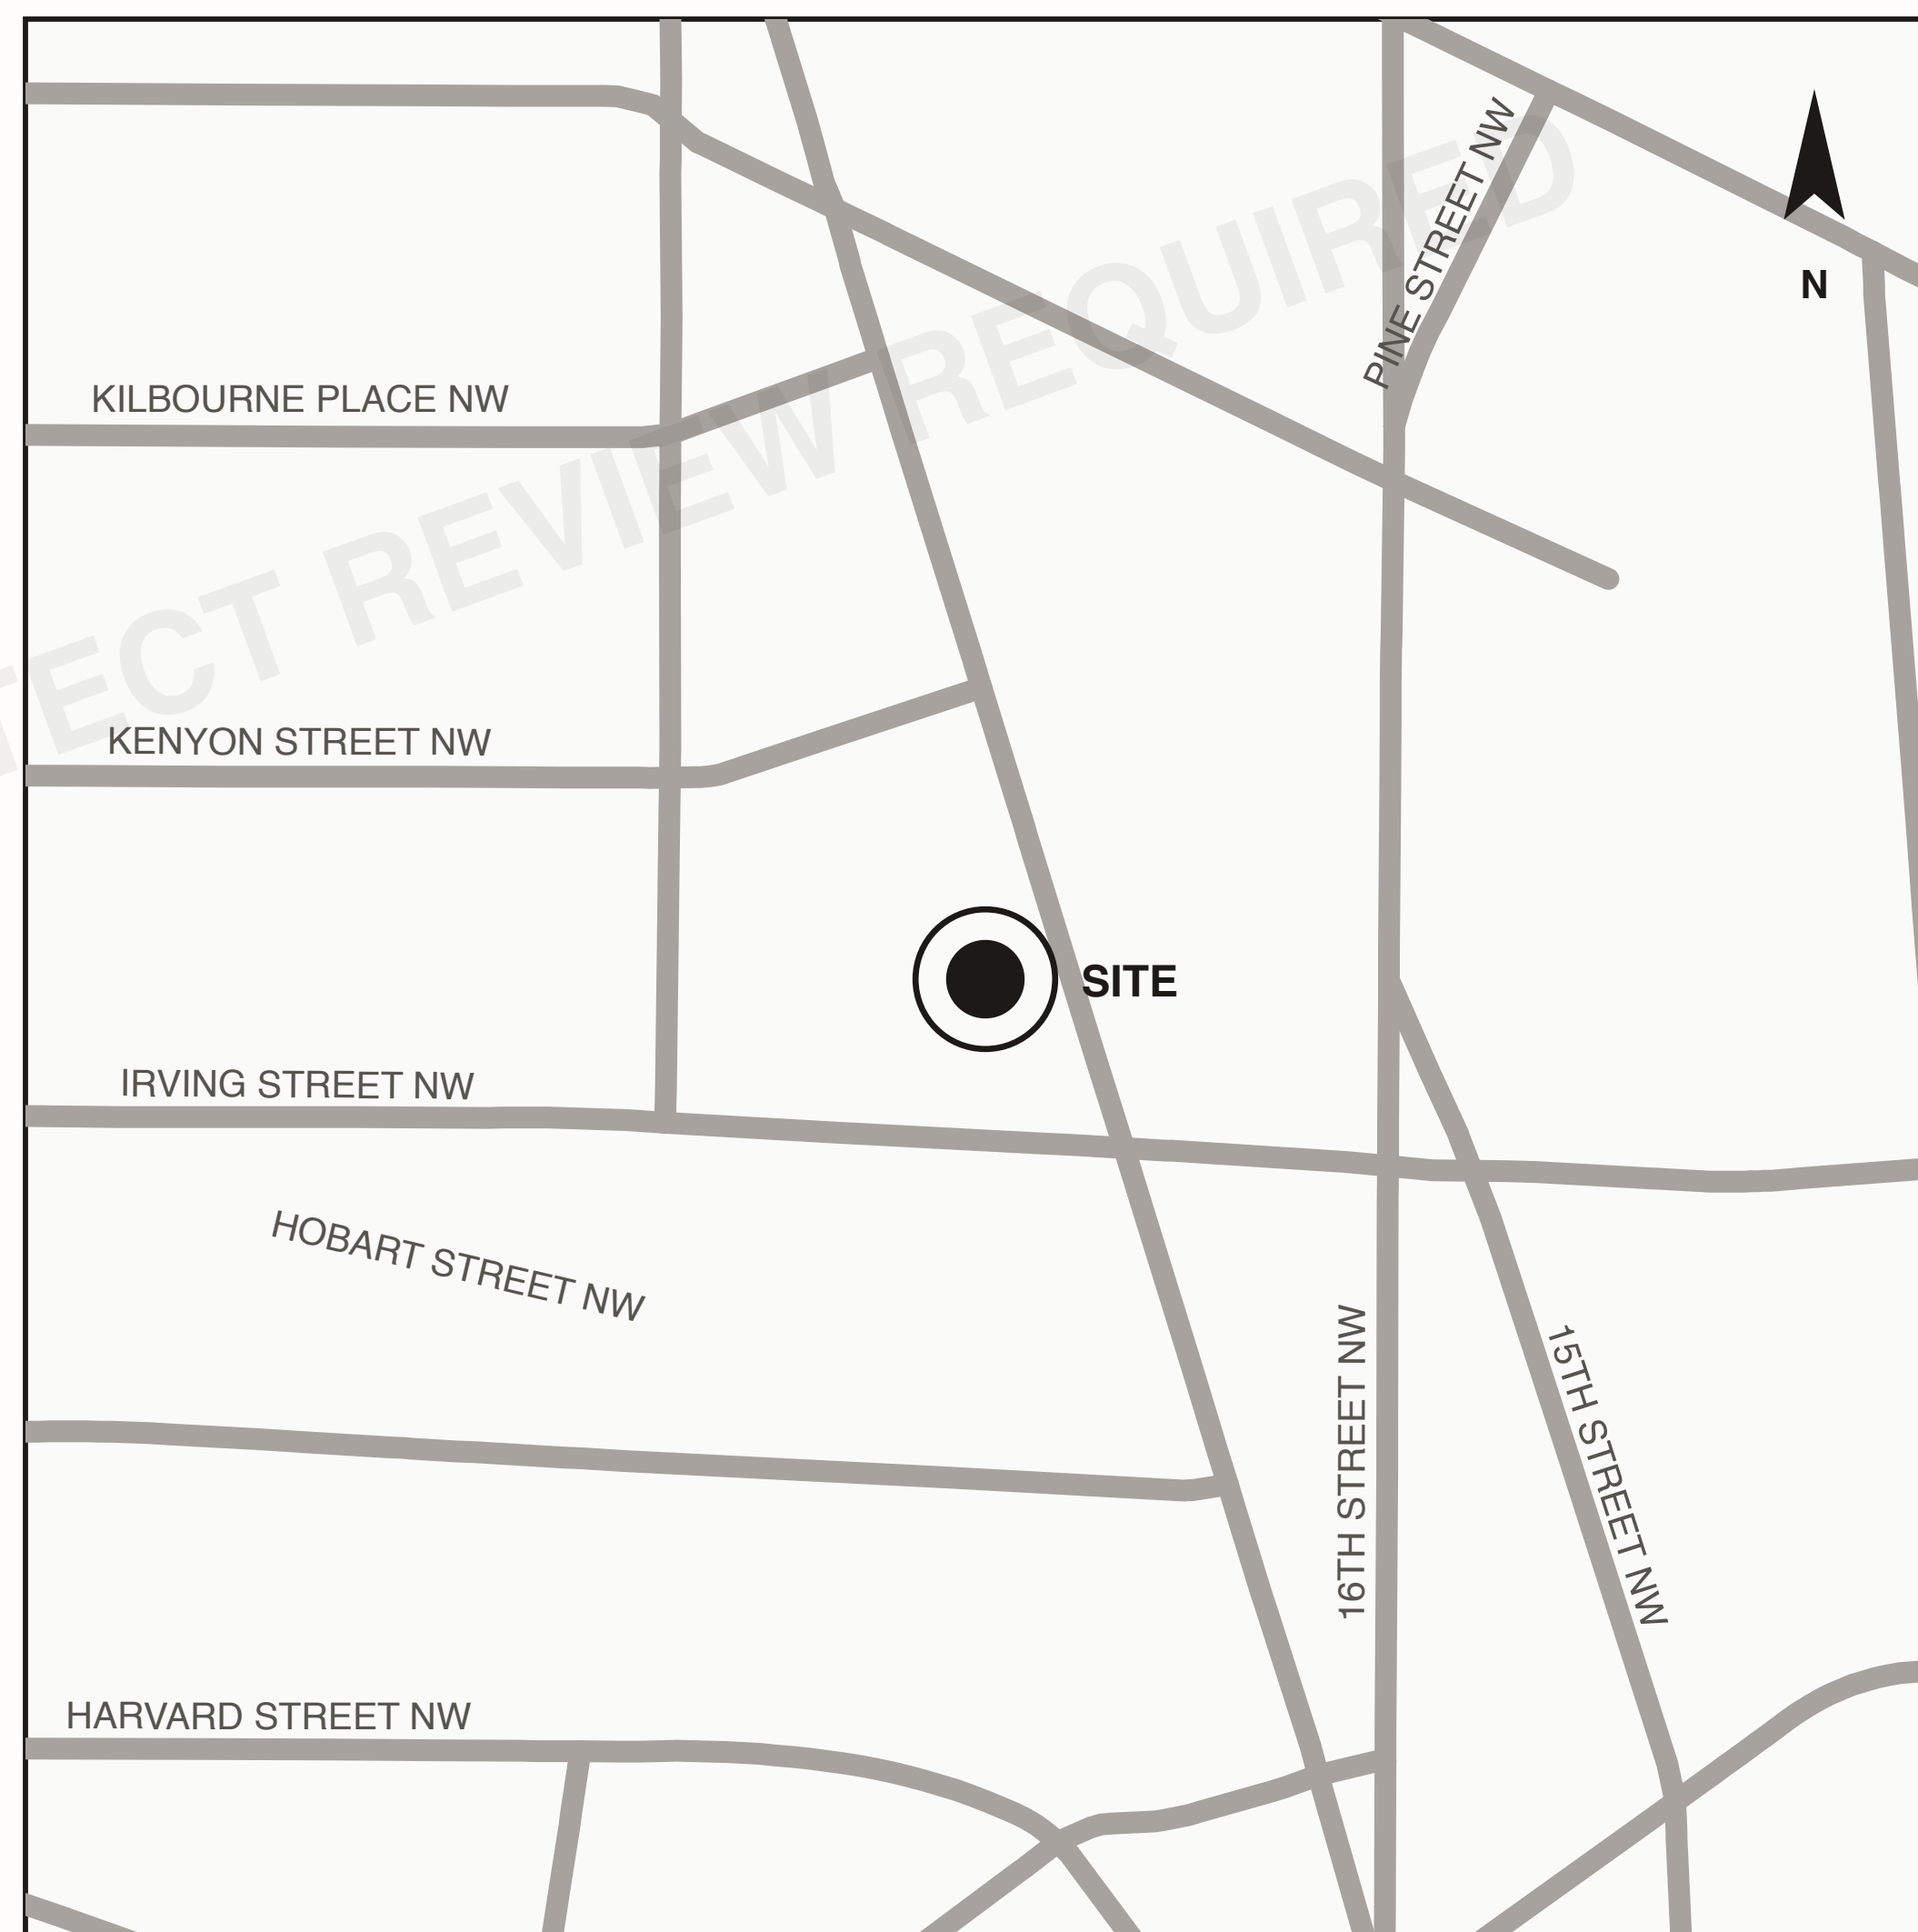

VICINITY MAP

DDOT Roadway Block centerlines, ±900 ft window, north up. Scale: 1 unit = 41 ft.

ARCHITECT: 	MARTHA DEAR 3110 MOUNT PLEASANT STREET NW G1.00 — COVER SHEET SEATING CAPACITY: 6 (96 SF / 15) GENERATED 2026-06-11 — SCALE: 1 UNIT = 1 FT AUTOMATED DRAFT — generated by streatory pre-screener v3. Architect review, refinement, and seal required before submission.
SEAL	



GENERAL NOTES + DDOT REQUIREMENTS

Conditions evaluated for this site — notes whose conditions do not apply are omitted, not crossed out. Site-specific notes appear on each drawing sheet.

DDOT /ADA REQUIREMENTS

1. Platform rides on adjustable pedestals / leveling feet for positive drainage; deck is NOT bolted or anchored into the roadway (§4.4). Composite decking on PT 2x4 sleepers — the assembly both approved sets use. [§4.4]

2. Entry flush with the sidewalk: removable 3/8" steel transition plate at the curb, max 3/8" rise, gap $\leq 1/2$ " (§4.4; Queen's English self-imposed 3/8" max). [§4.4]

3. Maintain 1'-0" clear stormwater channel along the curb under the deck, with open ends (§4.6). Construction Details must show positive drainage flow AND how the channel is accessed/cleared if blocked (§5.2 item 4). [§4.6 + §5.2 item 4]

4. Mark all utilities in/under/adjacent to the streatory per APWA color code before installation; show proposed markings on the platform/barriers in the Utility Access Plan (§5.2 item 5; operator contact table in Appendix 5). [§5.2 item 5, Appendix 5]

5. Two 5.5"x8.5" signs, one near each end of the sidewalk-facing edge: business name, seating hours, seating capacity, emergency contact (§4.7, Appendix 1 format). No other signage, logos, advertising, or branding permitted. [§4.7, Appendix 1]

6. Enclosure tops out 32-42" above the roadway (42" cap rail, both approved sets); gaps between intermediate members $\leq 19"$ (§4.2). [§4.2]

7. Overhead structure 8-12 ft above platform; translucent, minimal-profile roof sloped 2:12 (10%) SLOPE TO CURB; NO enclosure above barrier height at any time; vertical members above 42" max 6" wide (§4.3). [§4.3]

8. Concrete blocks required in the 2 ft travel-side buffer (§4.2). DDOT standard detail to appear on the details sheet (A2.01 equivalent, M5). [§4.2]

9. DDOT-provided Jersey barrier carries reflectors per the Appendix 3 standard detail (signed by DDOT's chief engineer) — embed on the details sheet rather than redrawing. [Appendix 3]

10. ≥ 1 ADA-accessible table: 28-34" surface height, 27" knee clearance, 30"x48" clear floor space, on an accessible route (§4.8). All seating 1 ft back from barriers/enclosure. [§4.8]

SITE-WALK VERIFICATIONS

1. Provide access panels / removable planks over any manhole, vault lid, or utility cover within the footprint (§5.2 item 5). SITE-WALK: locate covers — utility vault coverage in DC Open Data is incomplete. [§5.2 item 5]

OPERATOR ITEMS

1. IF portable propane heaters are planned: "Propane Use: Heating — Portable Outdoor" permit from FEMS (fems.dc.gov, ~5 calendar days). Where a roof is present, confirm heater clearances with FEMS before purchase. [FEMS]

ARCHITECT:

SEAL

MARTHA DEAR

3110 MOUNT PLEASANT STREET NW

G1.01 — GENERAL NOTES + DDOT REQUIREMENTS


SEATING CAPACITY: 6 (96 SF / 15)

GENERATED 2026-06-11 — SCALE: 1 UNIT = 1 FT

AUTOMATED DRAFT — generated by streatory pre-screener v3.
Architect review, refinement, and seal required before submission.



LIFE SAFETY + ACCESSIBILITY — SEATING PLAN

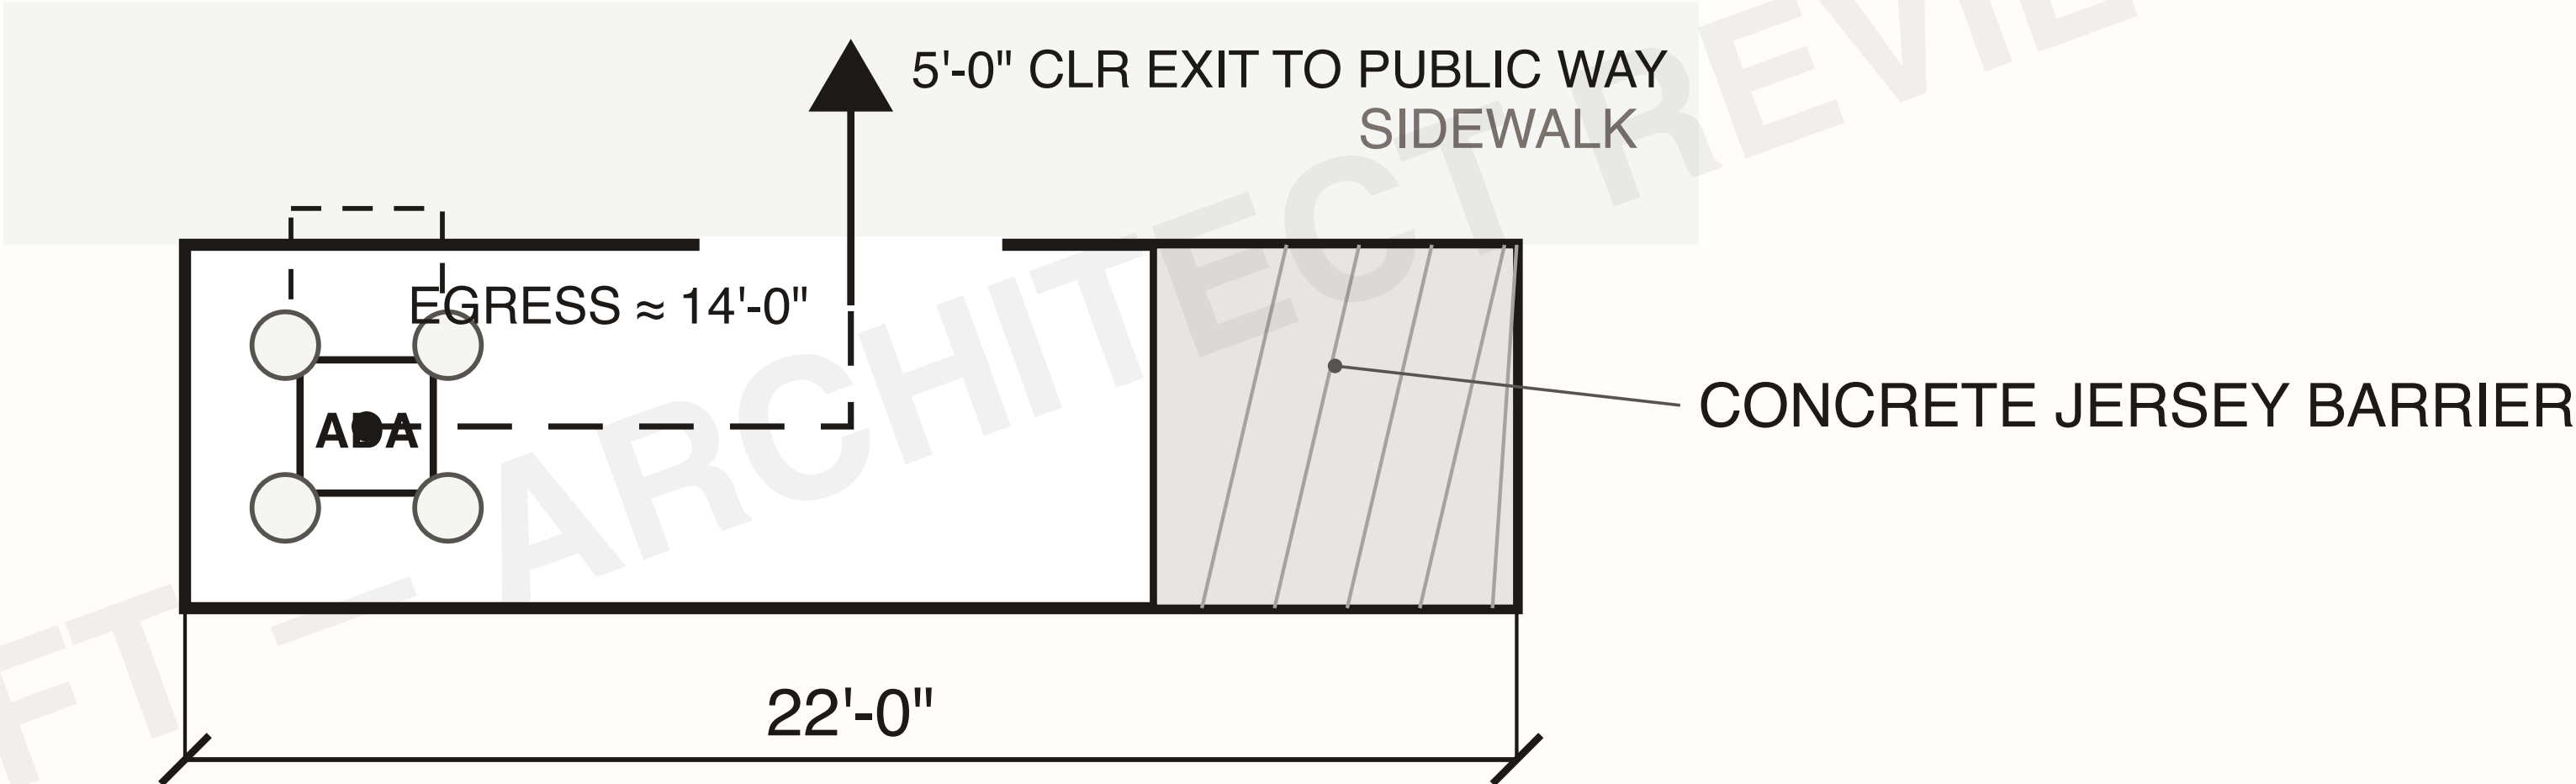

OCCUPANT LOAD

PLATFORM AREA	132 SF (22'-0" × 6'-0")
USABLE AREA (structures deducted)	96 SF
OCCUPANCY FACTOR (§4.8)	1 SEAT / 15 SF
MAXIMUM SEATING CAPACITY	6
SEATS SHOWN THIS PLAN	4
ADA TABLES (§4.8)	1

ACCESSIBILITY

ADA TABLE: 28"-34" surface height, 27" knee clearance, 30"×48" clear floor space (dashed), on an accessible route (§4.8).
All seating 1 ft clear of barriers and enclosure (§4.8). Seating layout is a draft capacity proof — final furniture by operator.
Entry ≥ 36" clear, no vertical protrusions; platform flush with sidewalk, max 1/2" gap (§4.4).

ARCHITECT:

SEAL

MARTHA DEAR


3110 MOUNT PLEASANT STREET NW


G2.00 — LIFE SAFETY + ACCESSIBILITY

SEATING CAPACITY: 6 (96 SF / 15)

GENERATED 2026-06-11 — SCALE: 1 UNIT = 1 FT

AUTOMATED DRAFT — generated by streatory pre-screener v3.
Architect review, refinement, and seal required before submission.

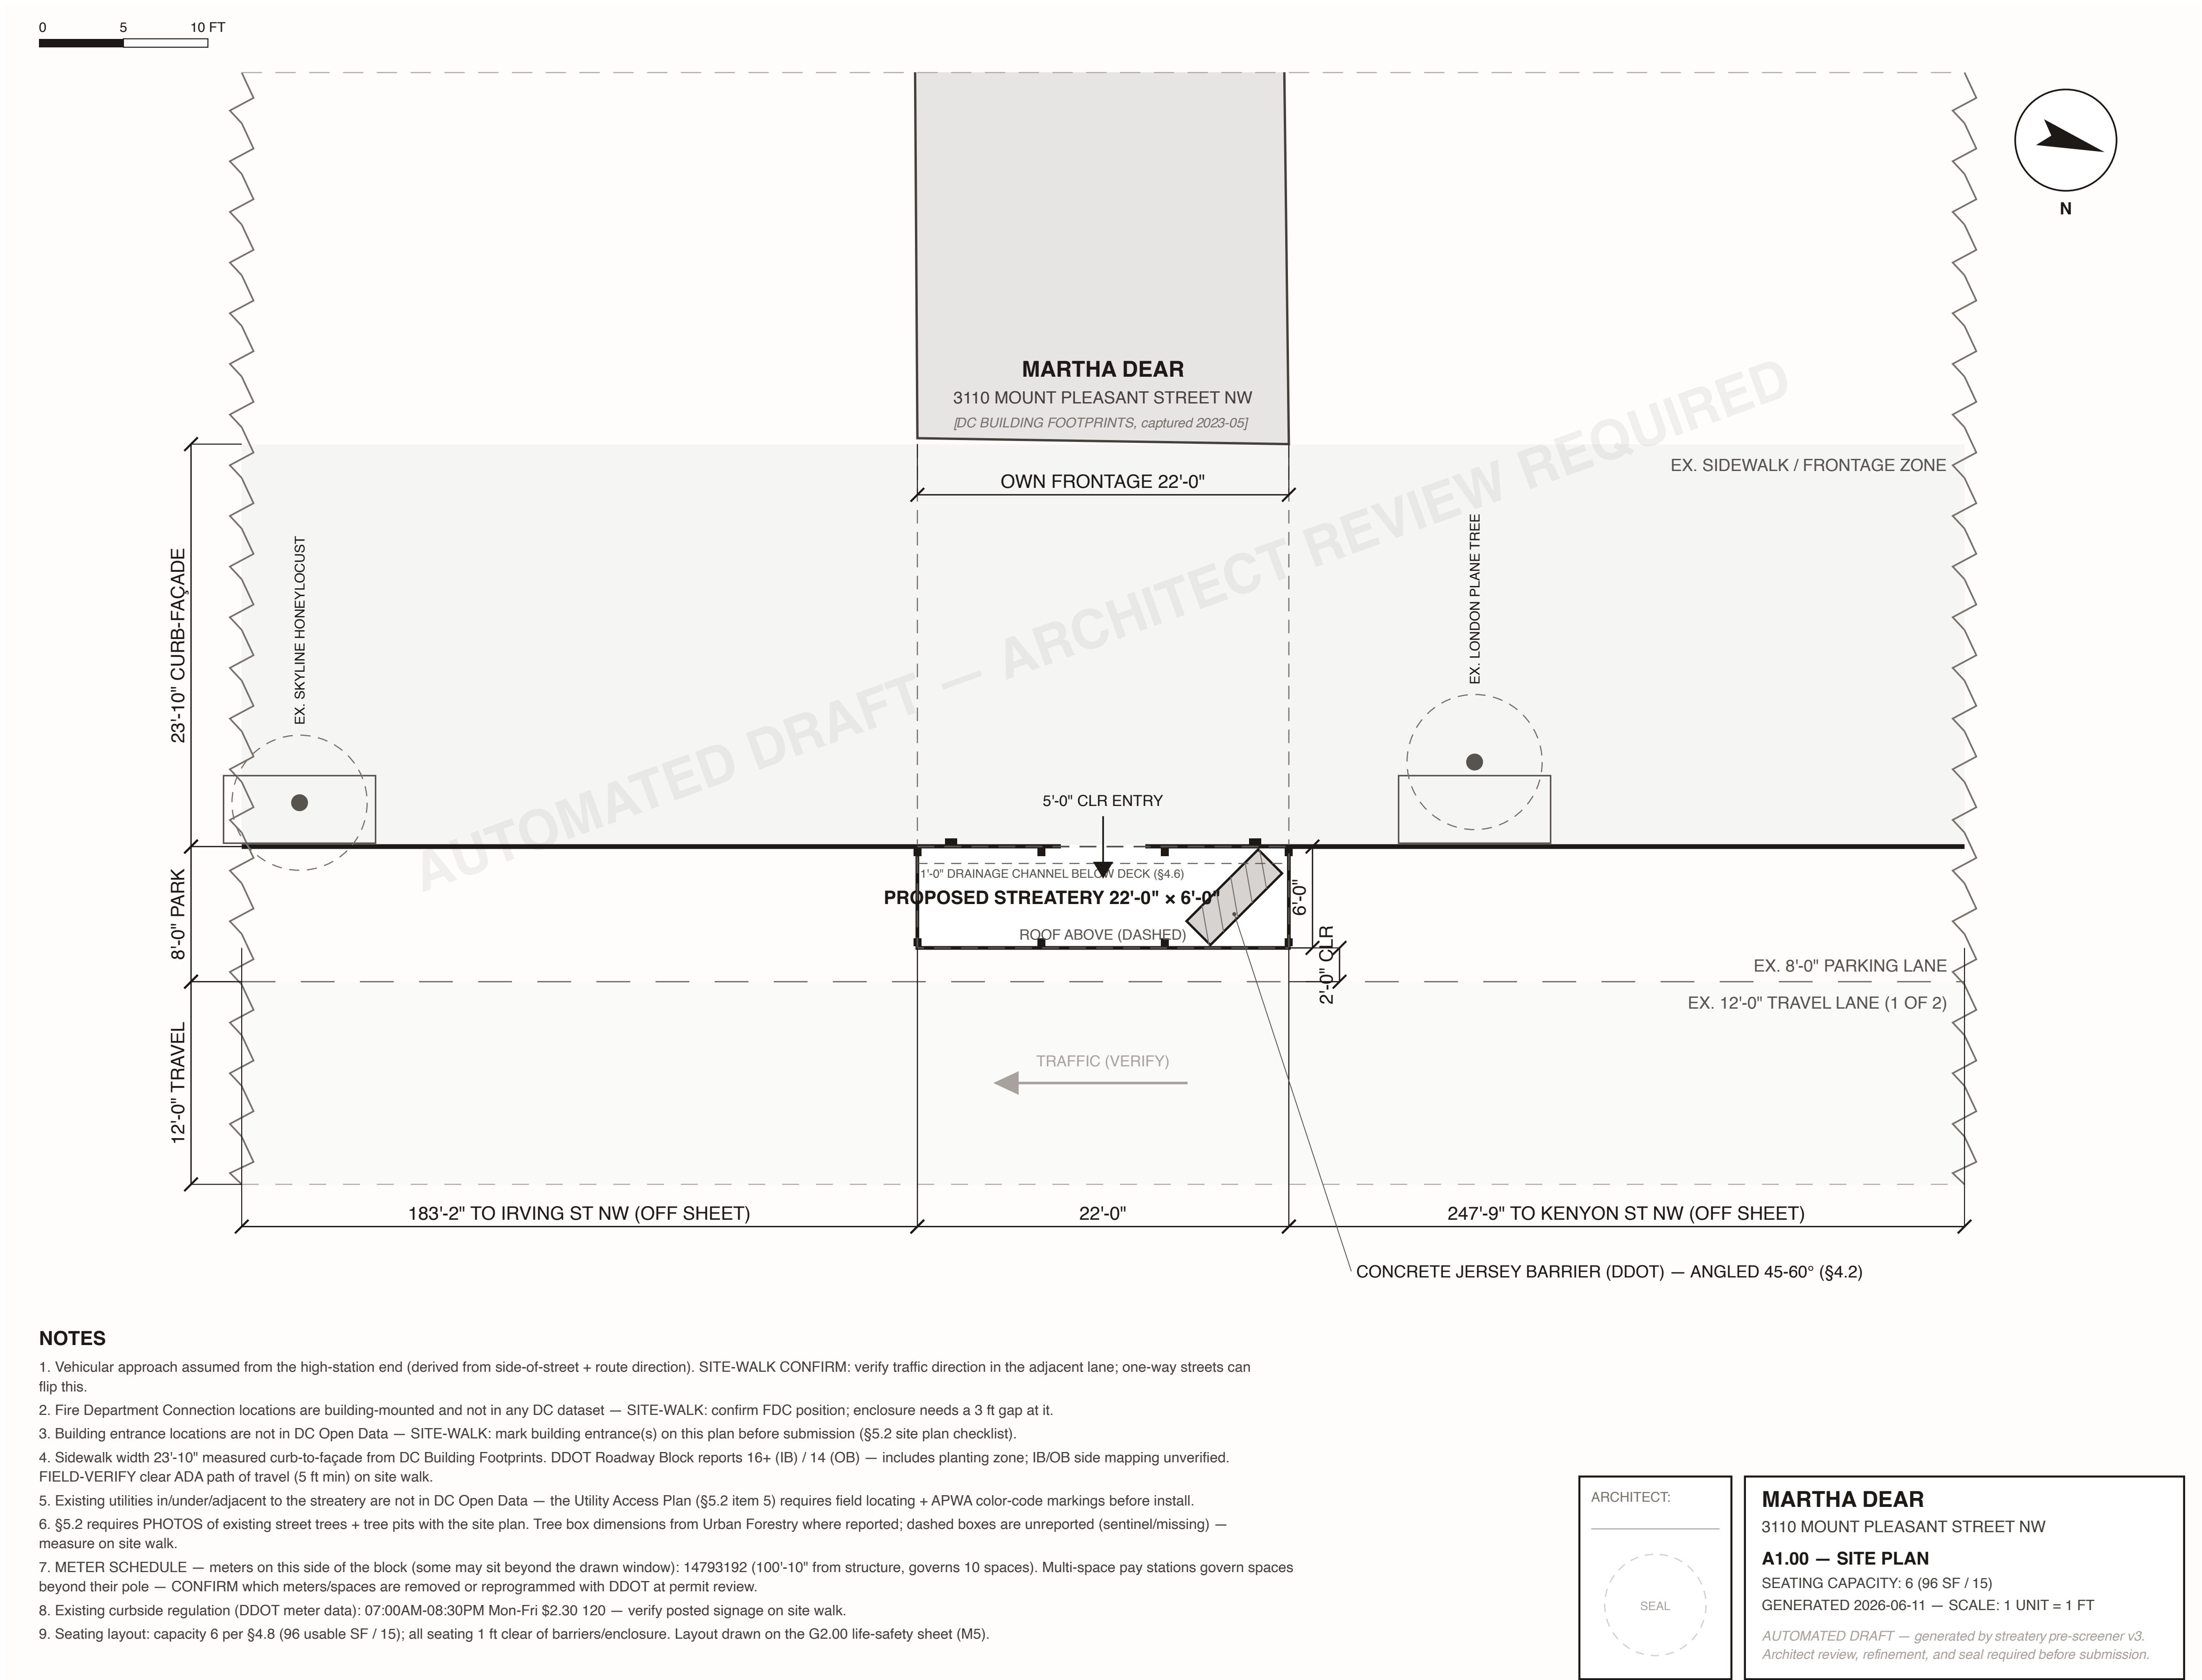

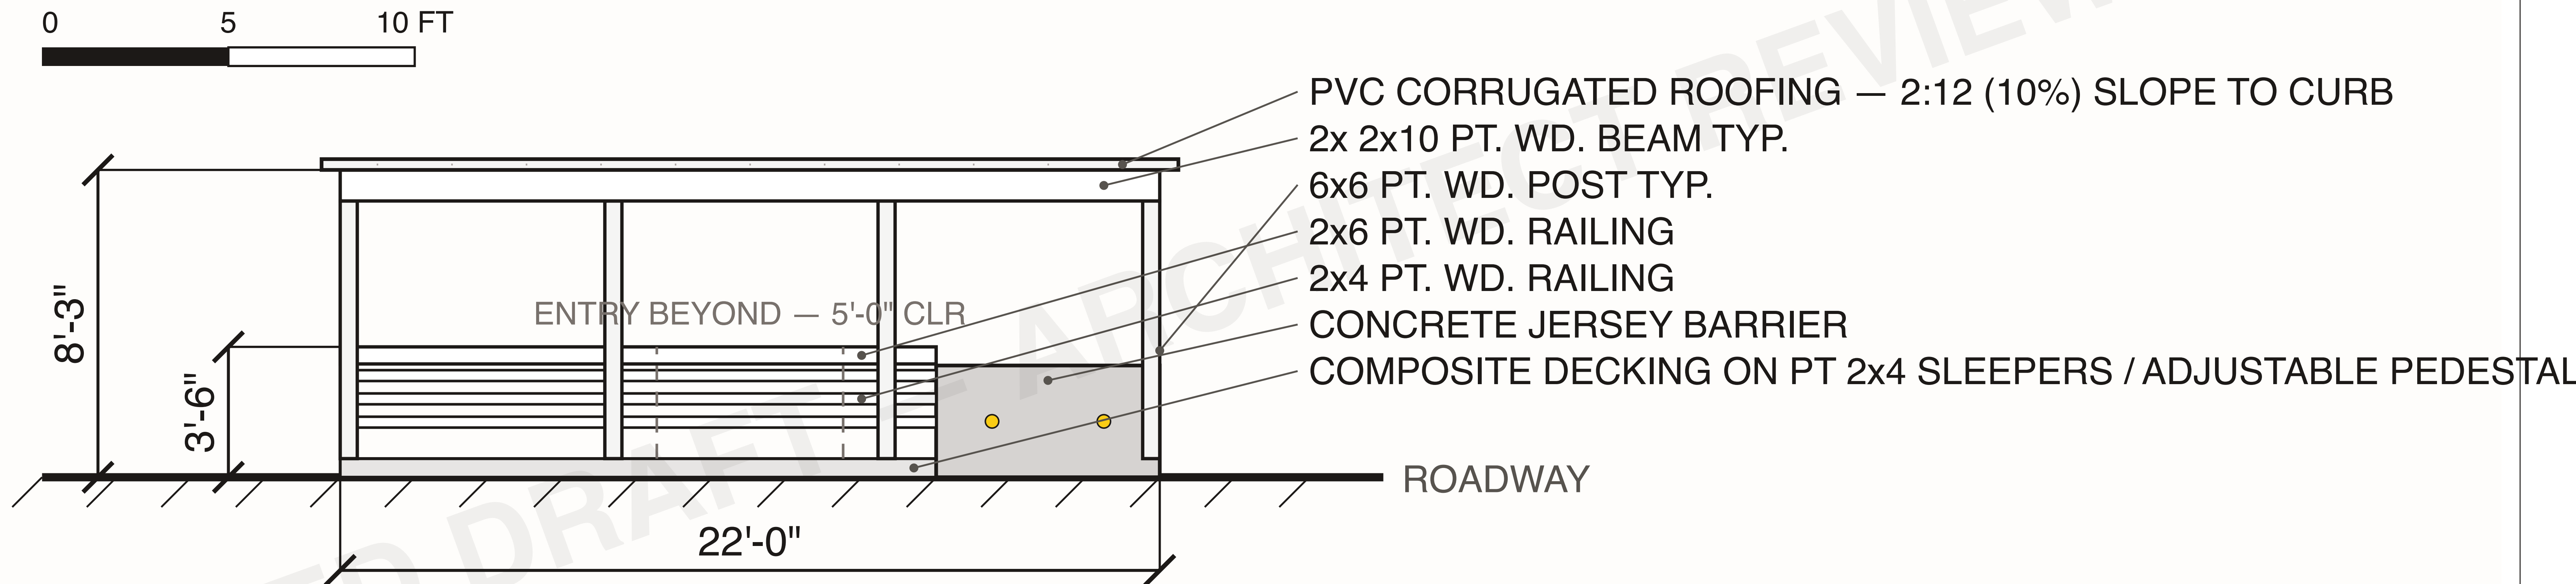

NOTES

1. Vehicular approach assumed from the high-station end (derived from side-of-street + route direction). SITE-WALK CONFIRM: verify traffic direction in the adjacent lane; one-way streets can flip this.
2. Fire Department Connection locations are building-mounted and not in any DC dataset — SITE-WALK: confirm FDC position; enclosure needs a 3 ft gap at it.

ARCHITECT:



MARTHA DEAR


3110 MOUNT PLEASANT STREET NW

A2.00 — ELEVATION — STREET SIDE

SEATING CAPACITY: 6 (96 SF / 15)

GENERATED 2026-06-11 — SCALE: 1 UNIT = 1 FT

*AUTOMATED DRAFT — generated by streatory pre-screener v3.
Architect review, refinement, and seal required before submission.*

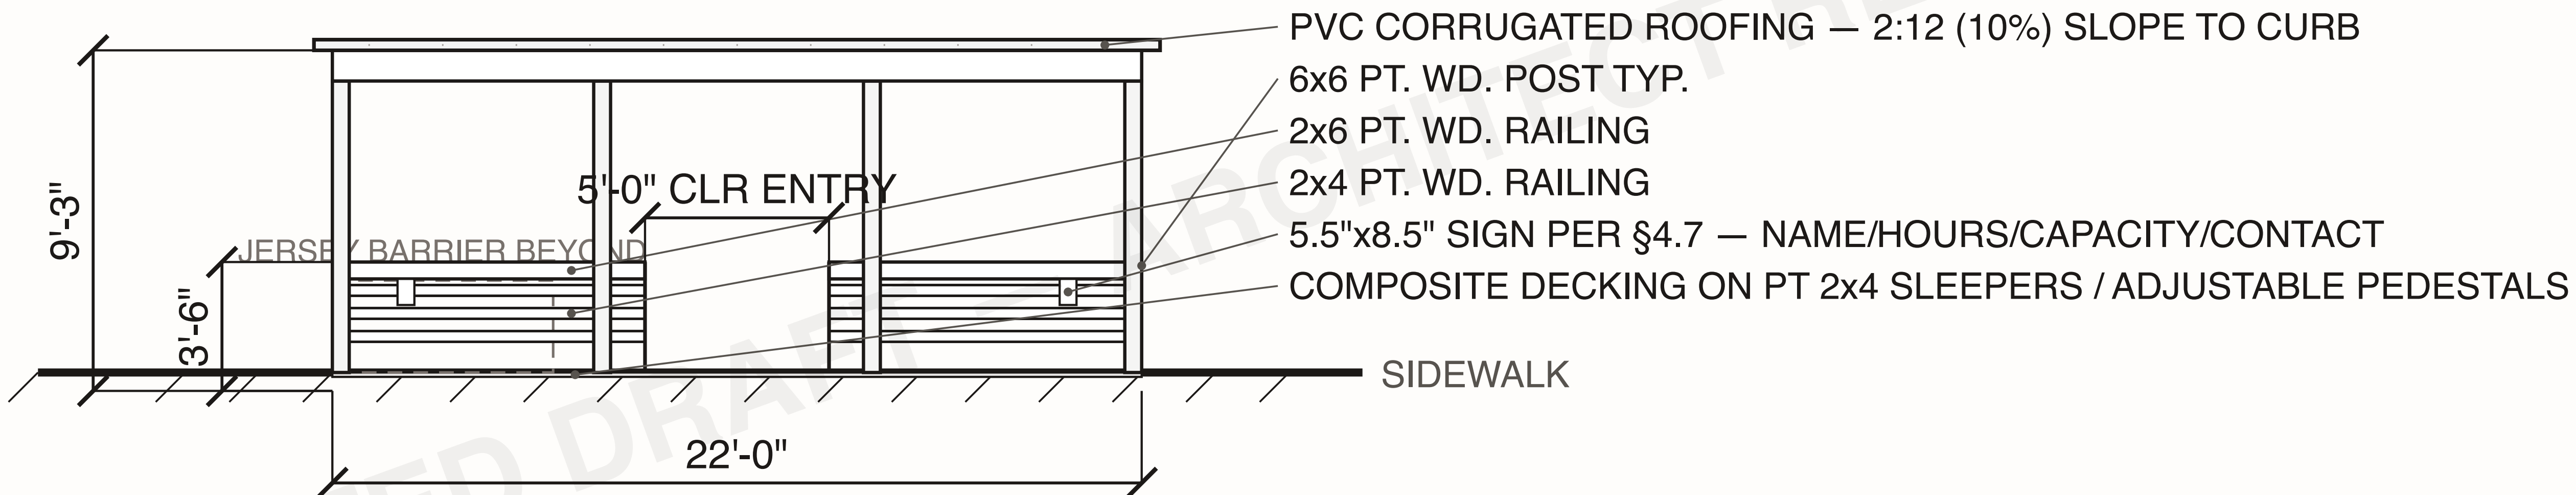

NOTES

1. Vehicular approach assumed from the high-station end (derived from side-of-street + route direction). SITE-WALK CONFIRM: verify traffic direction in the adjacent lane; one-way streets can flip this.
2. Fire Department Connection locations are building-mounted and not in any DC dataset — SITE-WALK: confirm FDC position; enclosure needs a 3 ft gap at it.

ARCHITECT:



MARTHA DEAR


3110 MOUNT PLEASANT STREET NW

A2.01 — ELEVATION — SIDEWALK SIDE

SEATING CAPACITY: 6 (96 SF / 15)

GENERATED 2026-06-11 — SCALE: 1 UNIT = 1 FT

*AUTOMATED DRAFT — generated by streatory pre-screener v3.
Architect review, refinement, and seal required before submission.*

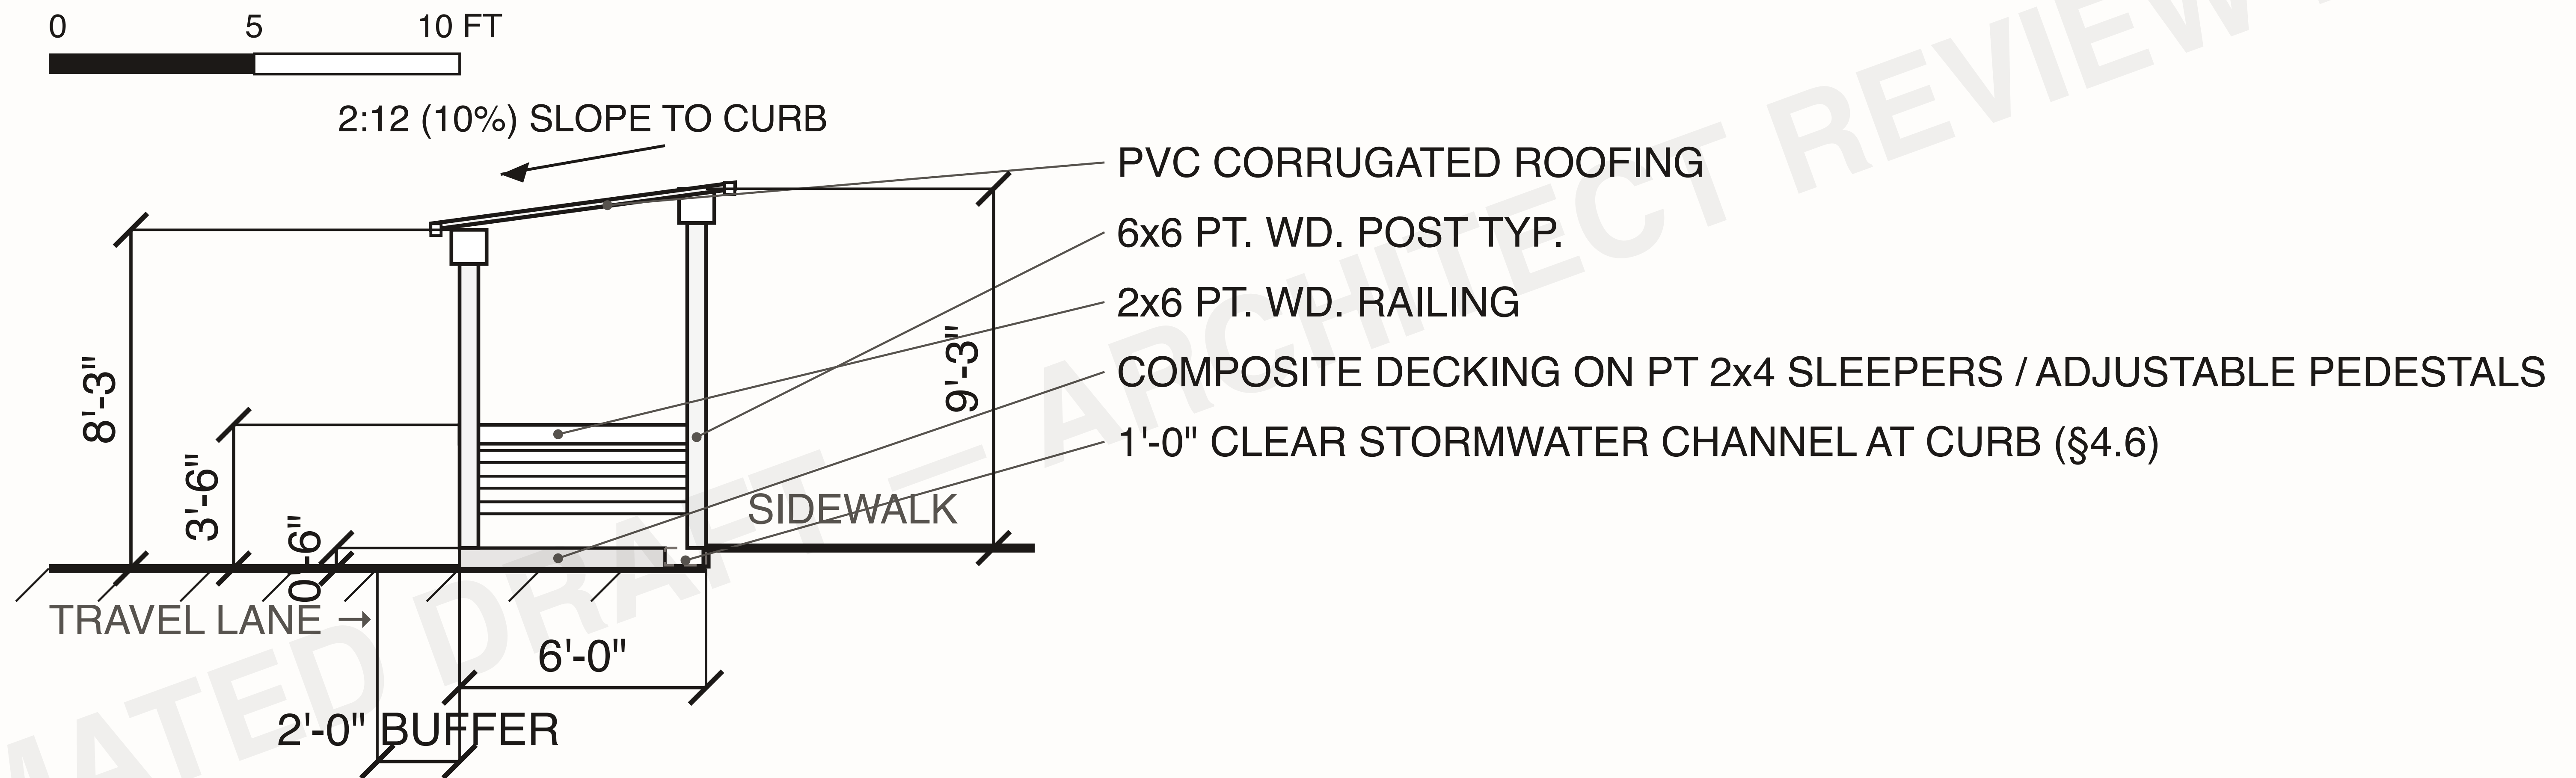

NOTES

1. Vehicular approach assumed from the high-station end (derived from side-of-street + route direction). SITE-WALK CONFIRM: verify traffic direction in the adjacent lane; one-way streets can flip this.
2. Fire Department Connection locations are building-mounted and not in any DC dataset — SITE-WALK: confirm FDC position; enclosure needs a 3 ft gap at it.

ARCHITECT:



MARTHA DEAR


3110 MOUNT PLEASANT STREET NW

A2.02 — END ELEVATION — LOW STATION

SEATING CAPACITY: 6 (96 SF / 15)

GENERATED 2026-06-11 — SCALE: 1 UNIT = 1 FT

*AUTOMATED DRAFT — generated by streatory pre-screener v3.
Architect review, refinement, and seal required before submission.*

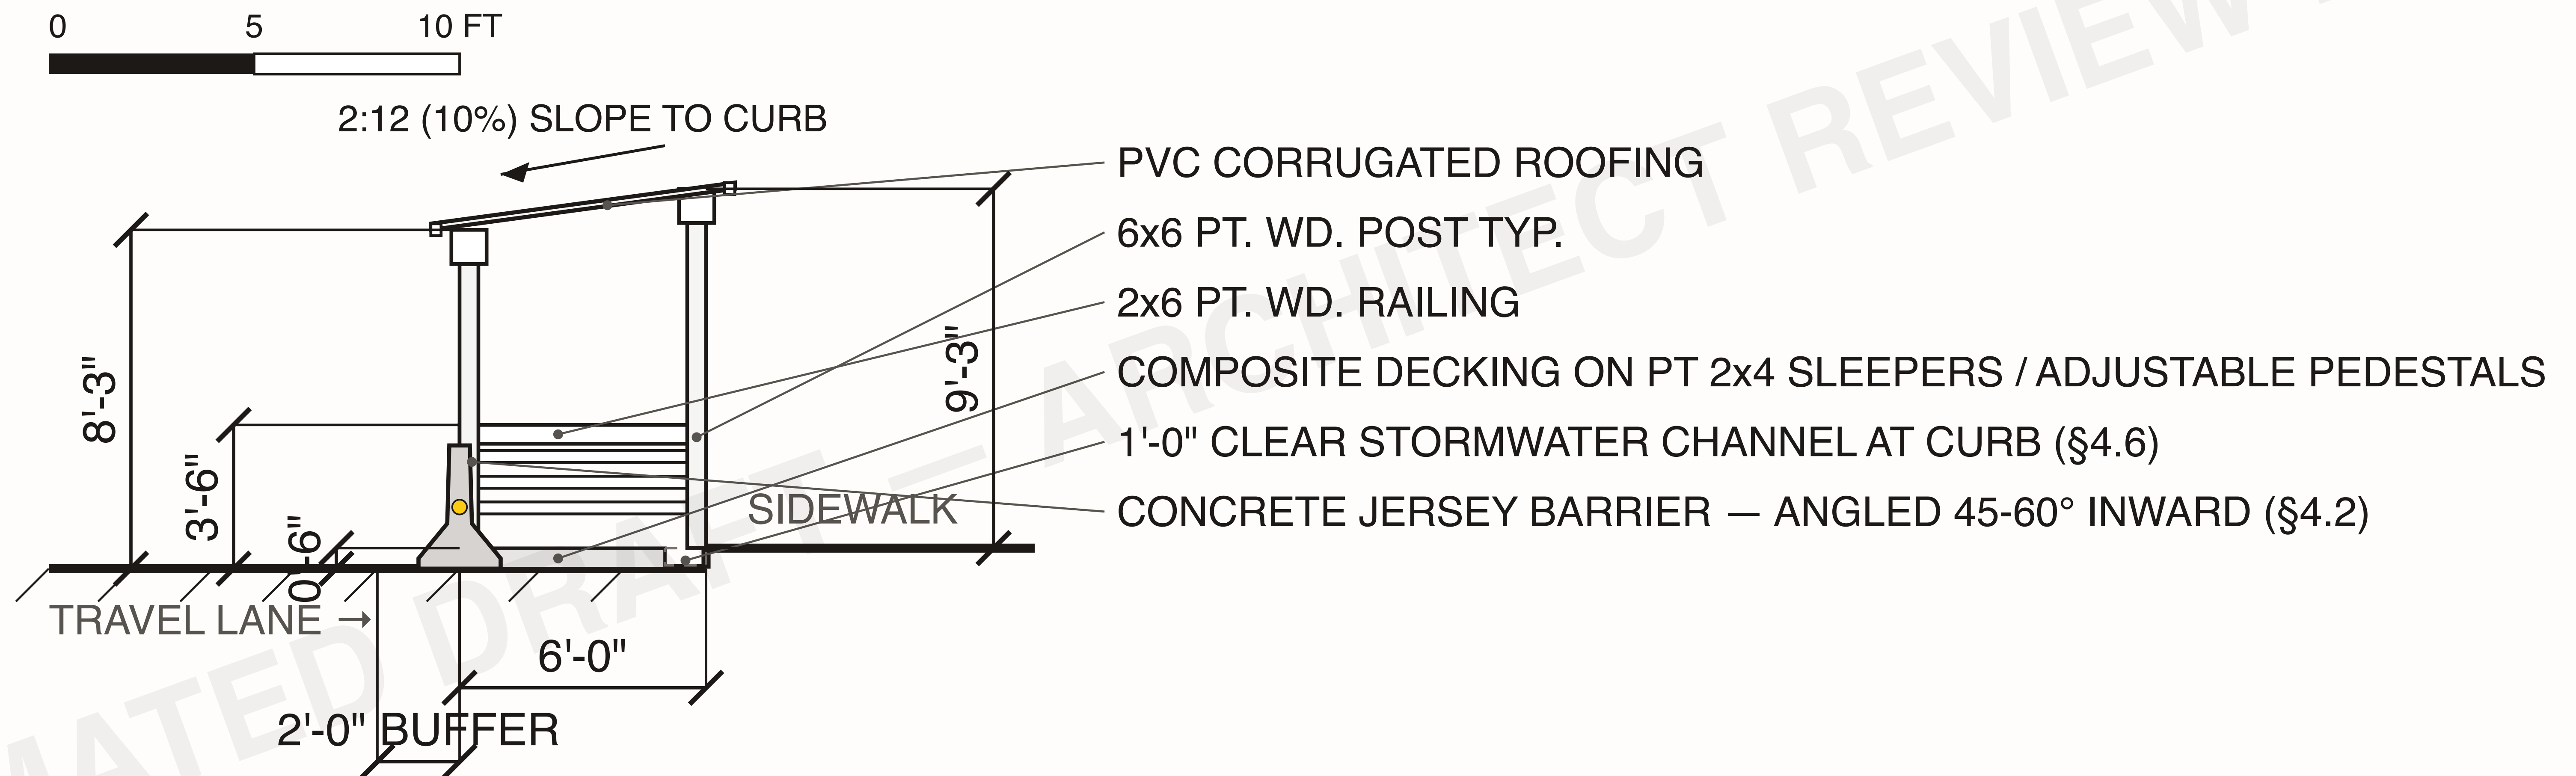

NOTES

1. Vehicular approach assumed from the high-station end (derived from side-of-street + route direction). SITE-WALK CONFIRM: verify traffic direction in the adjacent lane; one-way streets can flip this.
2. Fire Department Connection locations are building-mounted and not in any DC dataset — SITE-WALK: confirm FDC position; enclosure needs a 3 ft gap at it.

ARCHITECT:



MARTHA DEAR


3110 MOUNT PLEASANT STREET NW

A2.03 — END ELEVATION — HIGH STATION (APPROACH)

SEATING CAPACITY: 6 (96 SF / 15)

GENERATED 2026-06-11 — SCALE: 1 UNIT = 1 FT

*AUTOMATED DRAFT — generated by streatory pre-screener v3.
Architect review, refinement, and seal required before submission.*

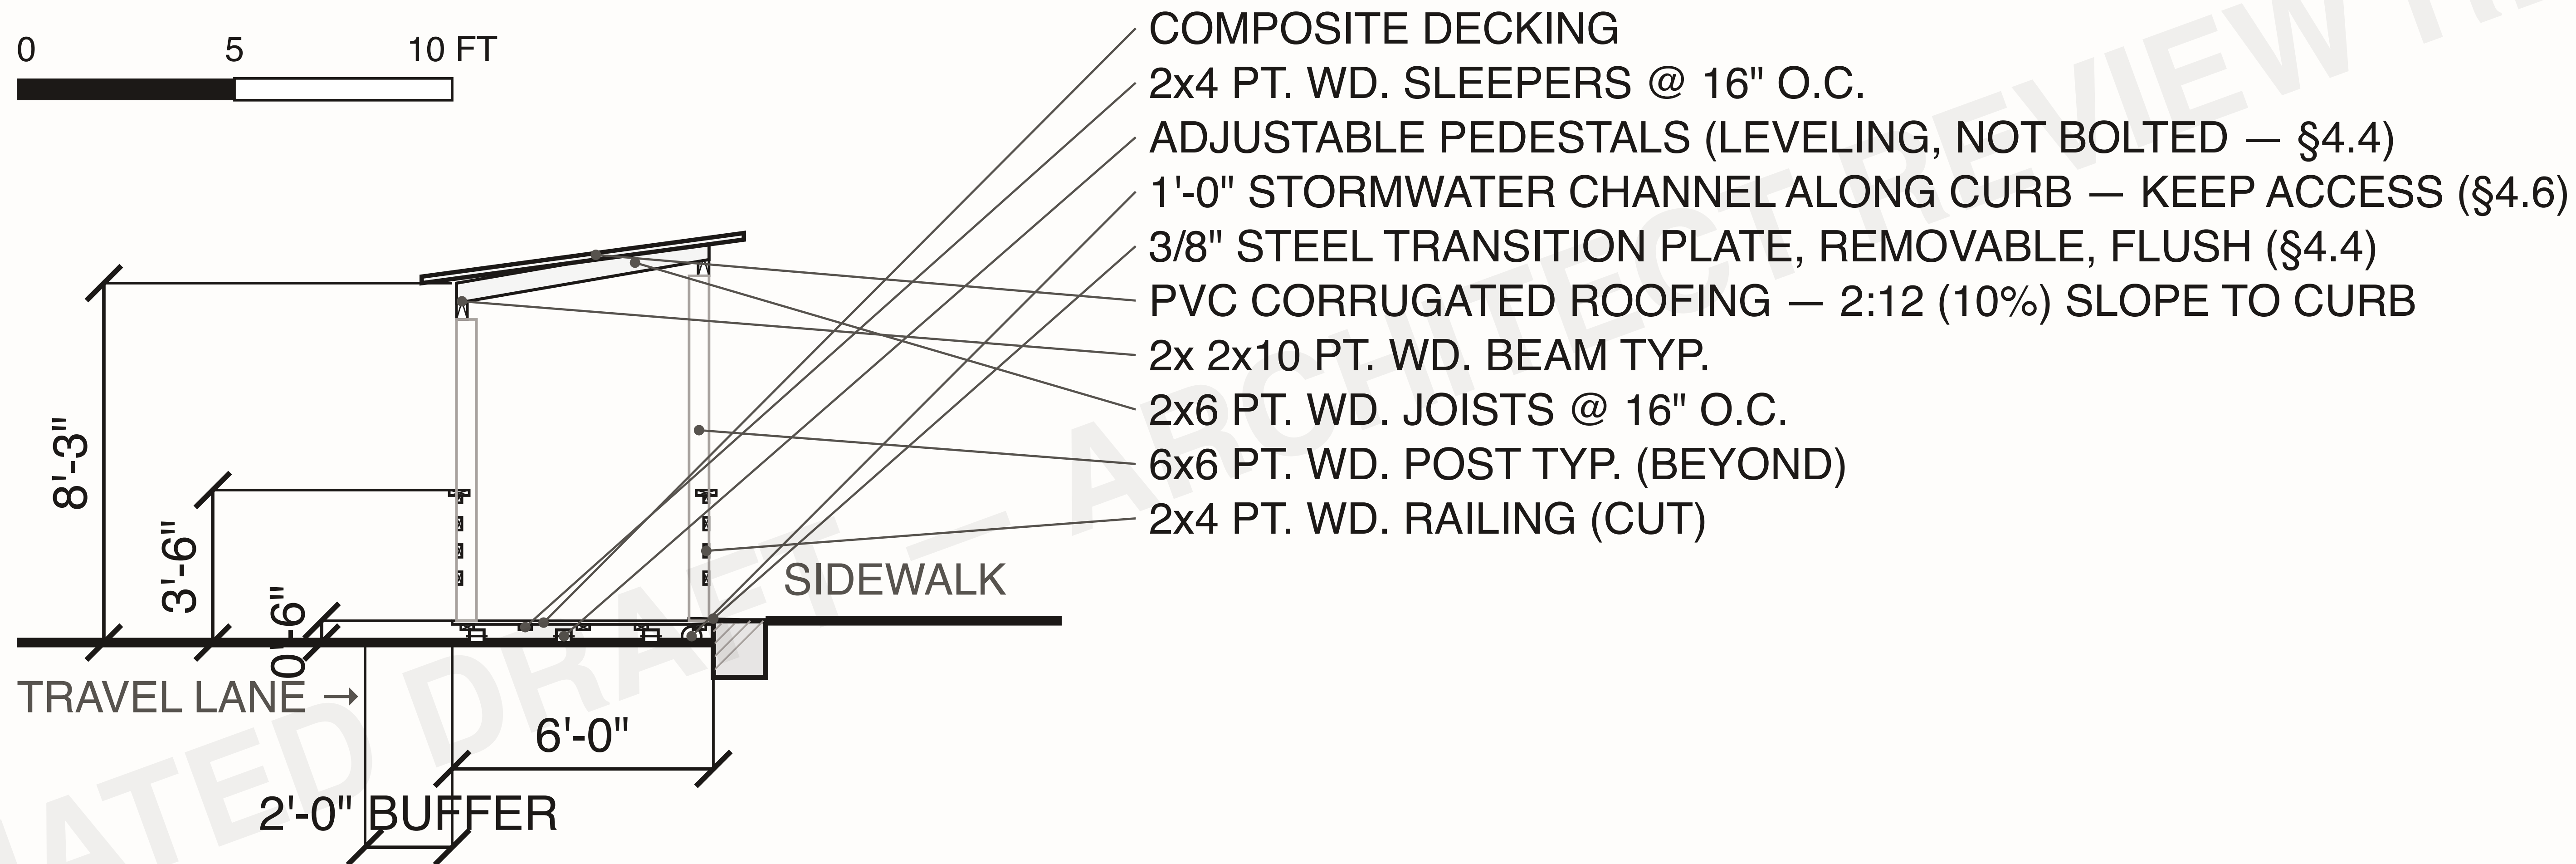

NOTES

1. Vehicular approach assumed from the high-station end (derived from side-of-street + route direction). SITE-WALK CONFIRM: verify traffic direction in the adjacent lane; one-way streets can flip this.
2. Fire Department Connection locations are building-mounted and not in any DC dataset — SITE-WALK: confirm FDC position; enclosure needs a 3 ft gap at it.

ARCHITECT:



MARTHA DEAR


3110 MOUNT PLEASANT STREET NW

A3.00 — SECTION — TYPICAL

SEATING CAPACITY: 6 (96 SF / 15)

GENERATED 2026-06-11 — SCALE: 1 UNIT = 1 FT

*AUTOMATED DRAFT — generated by streatory pre-screener v3.
Architect review, refinement, and seal required before submission.*

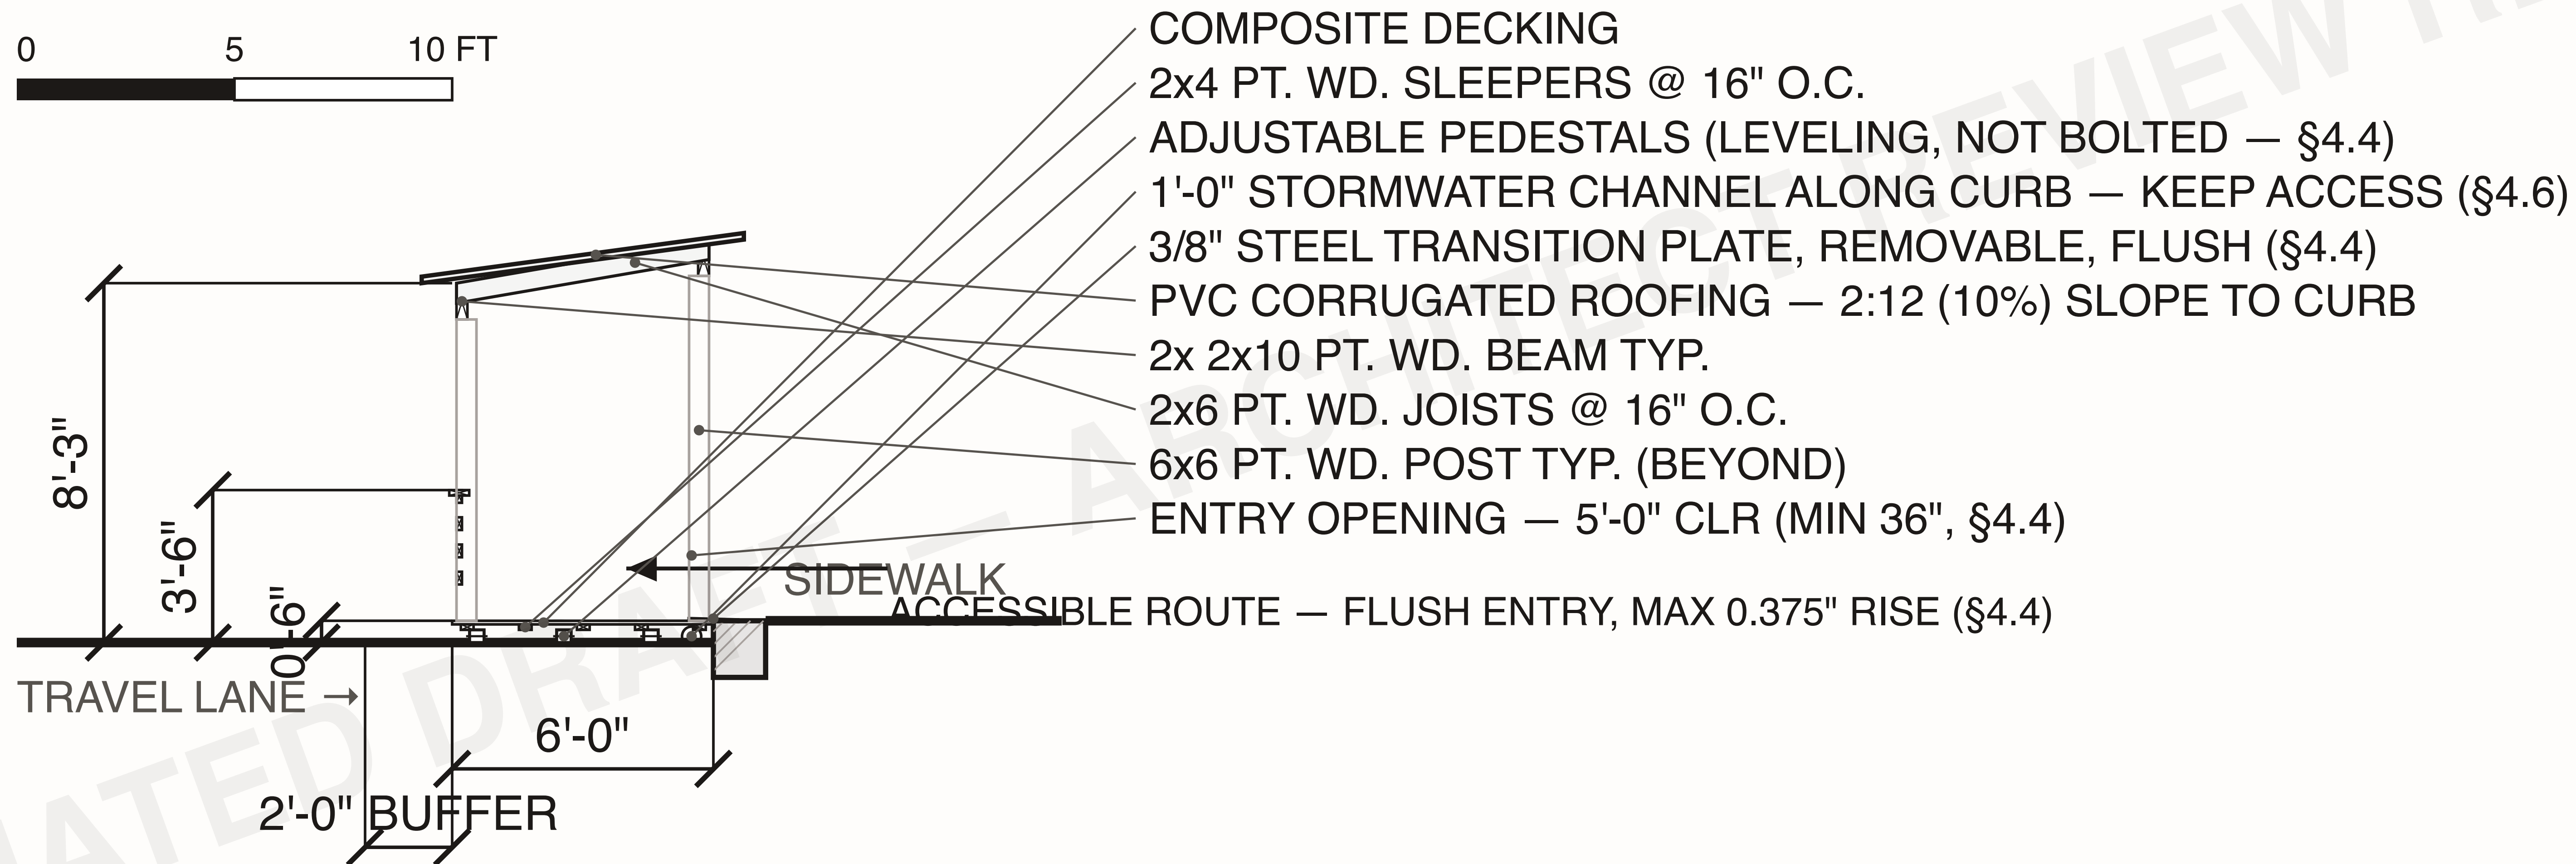

NOTES

1. Vehicular approach assumed from the high-station end (derived from side-of-street + route direction). SITE-WALK CONFIRM: verify traffic direction in the adjacent lane; one-way streets can flip this.
2. Fire Department Connection locations are building-mounted and not in any DC dataset — SITE-WALK: confirm FDC position; enclosure needs a 3 ft gap at it.

ARCHITECT:



MARTHA DEAR

3110 MOUNT PLEASANT STREET NW

A3.01 — SECTION — ENTRY / ACCESSIBILITY

SEATING CAPACITY: 6 (96 SF / 15)

GENERATED 2026-06-11 — SCALE: 1 UNIT = 1 FT

*AUTOMATED DRAFT — generated by streatory pre-screener v3.
Architect review, refinement, and seal required before submission.*

