


1 MECHANICAL FLOOR PLAN

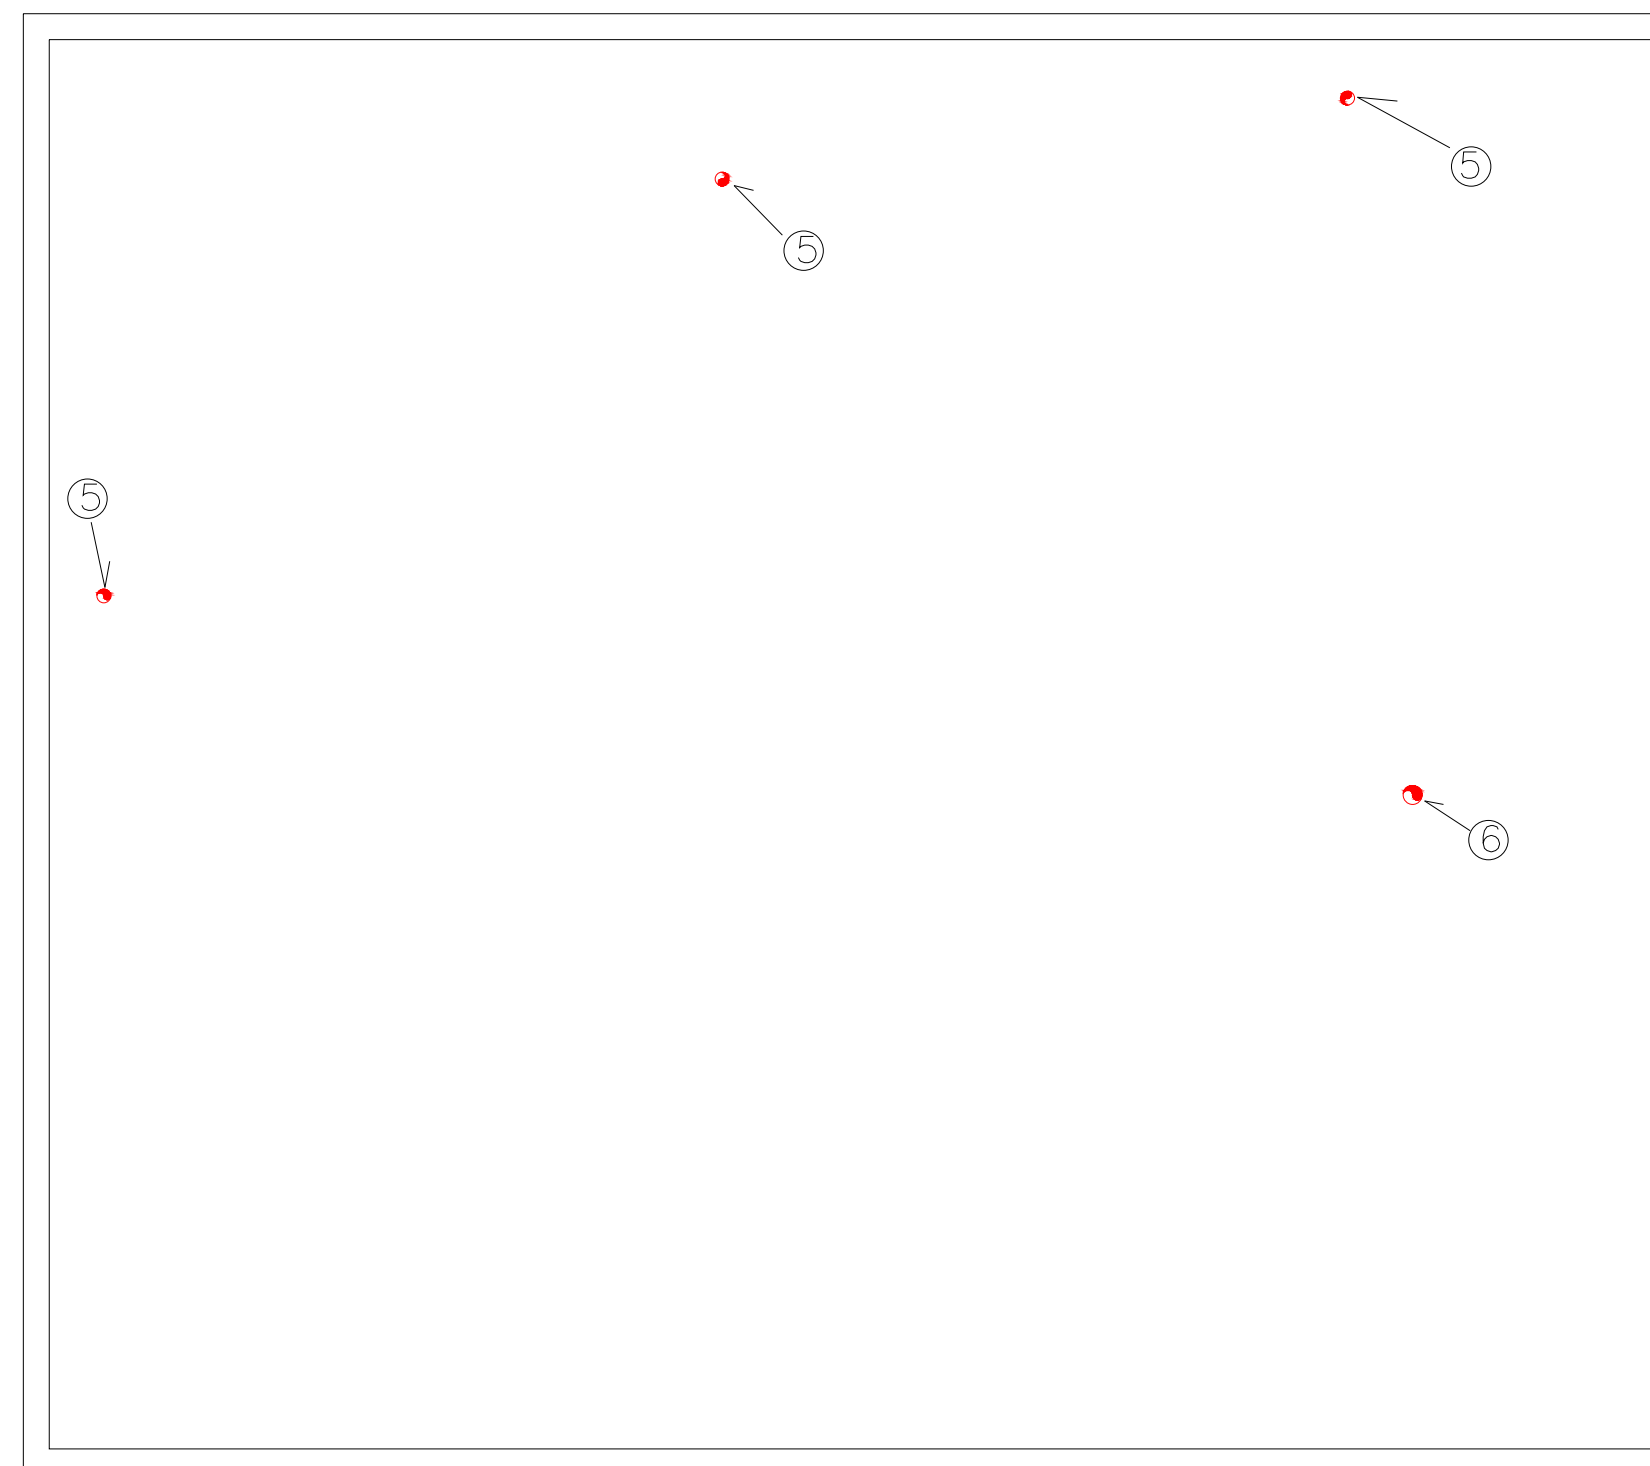

2 MECHANICAL ROOF PLAN

EQUIPMENT LEGENDS	
	SUPPLY DIFFUSER
	RETURN GRILLE
	SUPPLY AIR DUCT
	RETURN AIR DUCT
	FRESH AIR DUCT
	EXHAUST AIR DUCT
	TOILET EXHAUST FAN
	KITCHEN EXHAUST FAN
	SIDEWALL EXHAUST
	FRESH AIR GRILLE
	VOLUME CONTROL DAMPER

KEYNOTES:	
1.	3/4" PVC CONDENSATE LINE TO EXPOSED OFF TO THE EXTERIOR WALL.
2.	4" TOILET EXHAUST DUCT UP THROUGH ROOF.
3.	6" KITCHEN EXHAUST DUCT UP THROUGH ROOF
4.	4" EXHAUST DUCT FROM TOILET EXHAUST FAN. TERMINATE WITH WEATHER CAP 24" ABOVE ROOF SURFACE.
4.	6" EXHAUST DUCT FROM KITCHEN EXHAUST FAN. TERMINATE WITH WEATHER CAP 24" ABOVE ROOF SURFACE.