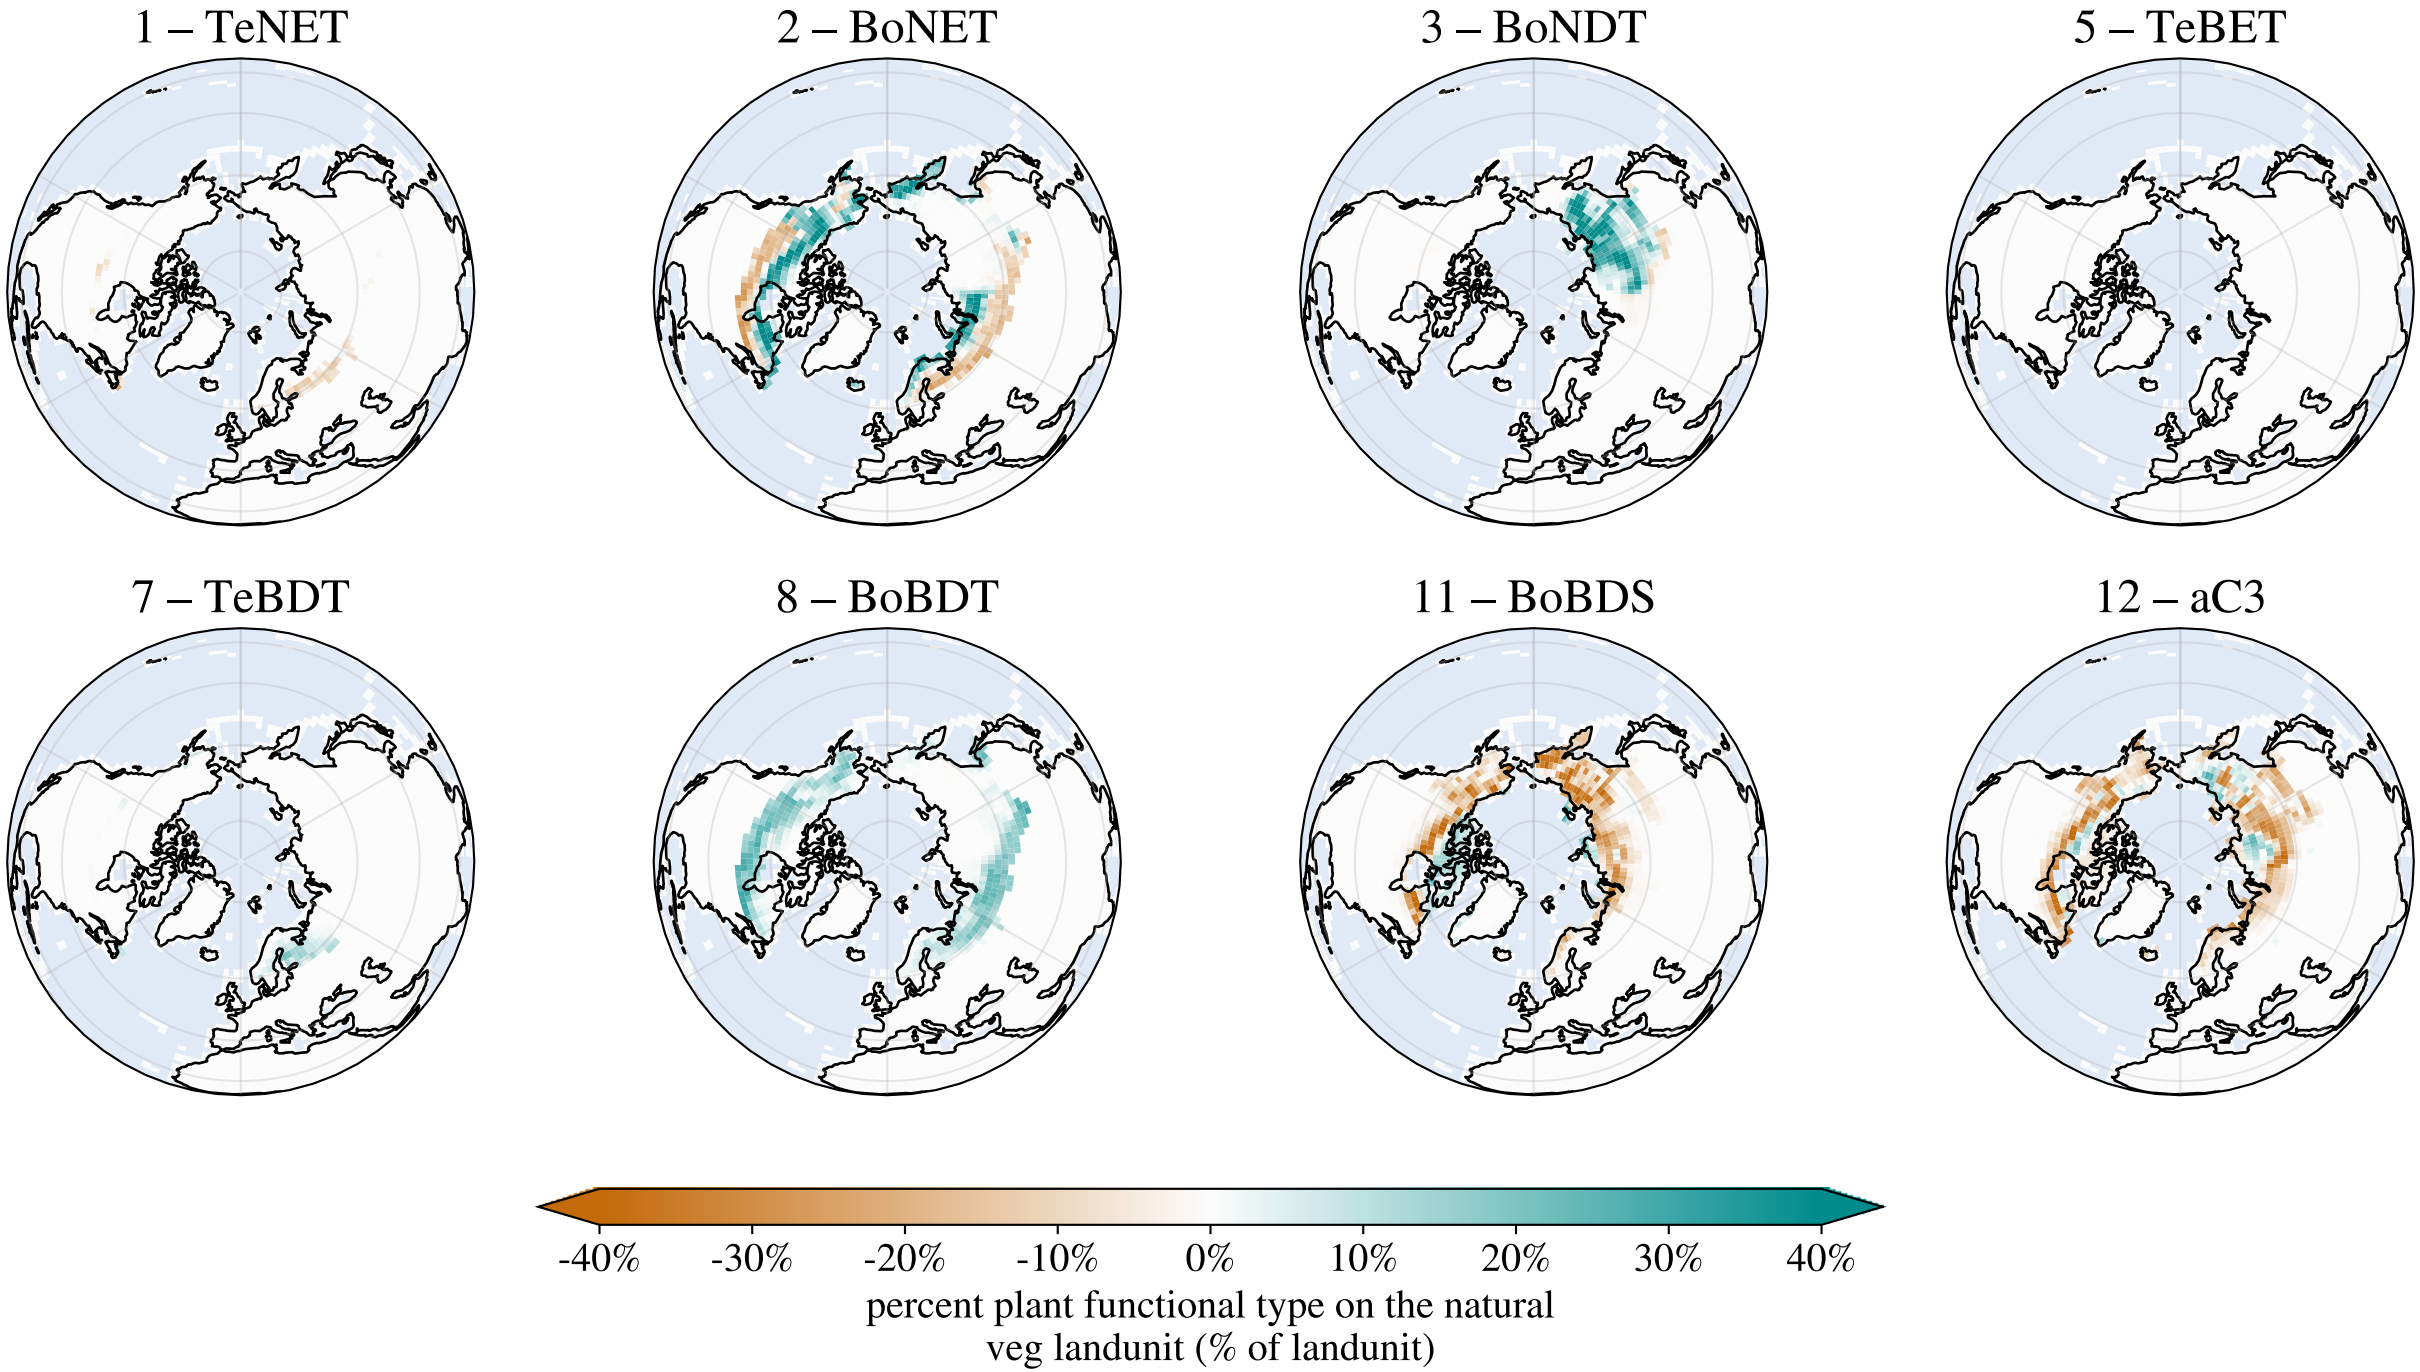Change in PFT distribution