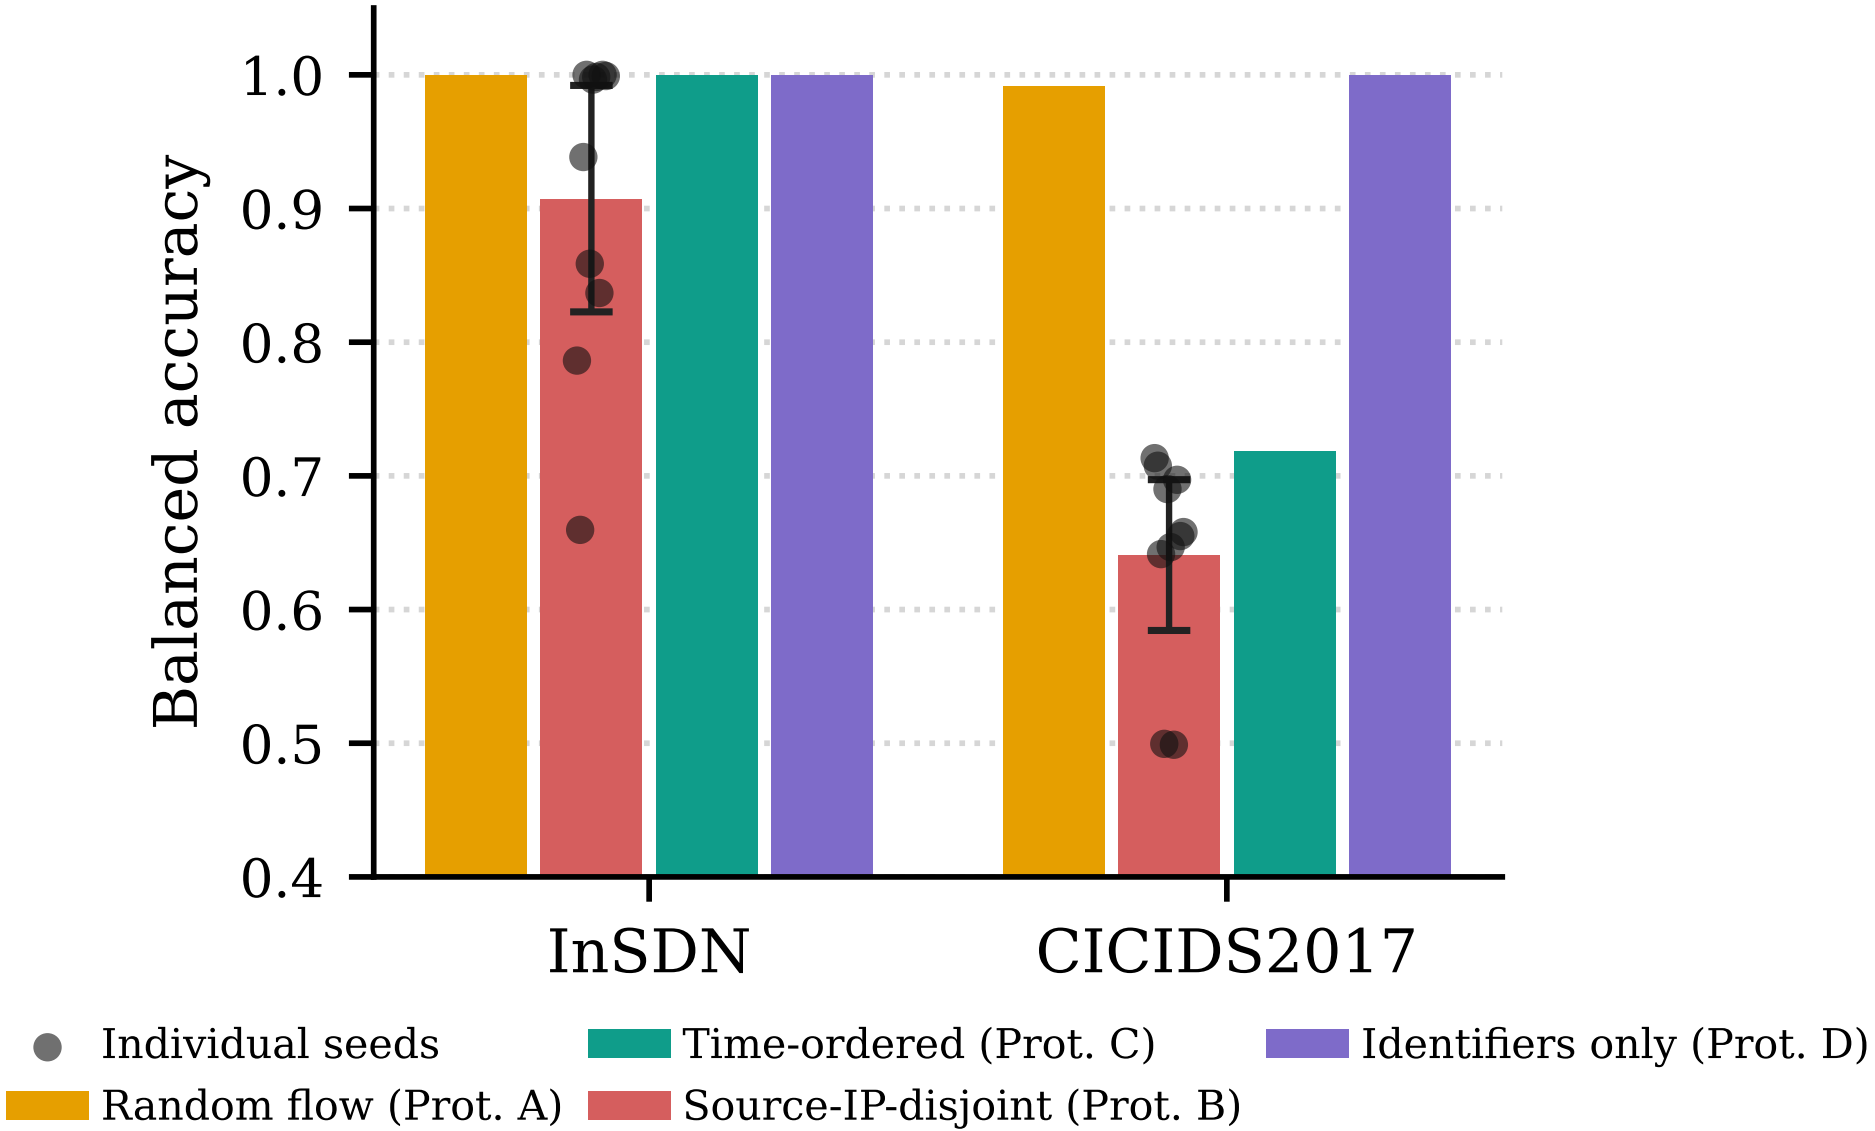
Balanced accuracy
1.0
0.9
0.8
0.7
0.6
0.5
0.4
InSDN
CICIDS2017
Individual seeds
Random flow (Prot. A)
Time-ordered (Prot. C)
Source-IP-disjoint (Prot. B)
Identifiers only (Prot. D)