

Filters

is_machine_archived

Exclude: true


company_name

Sanofi Pasteur

Supporting Equipment

Number of SE Machines

66

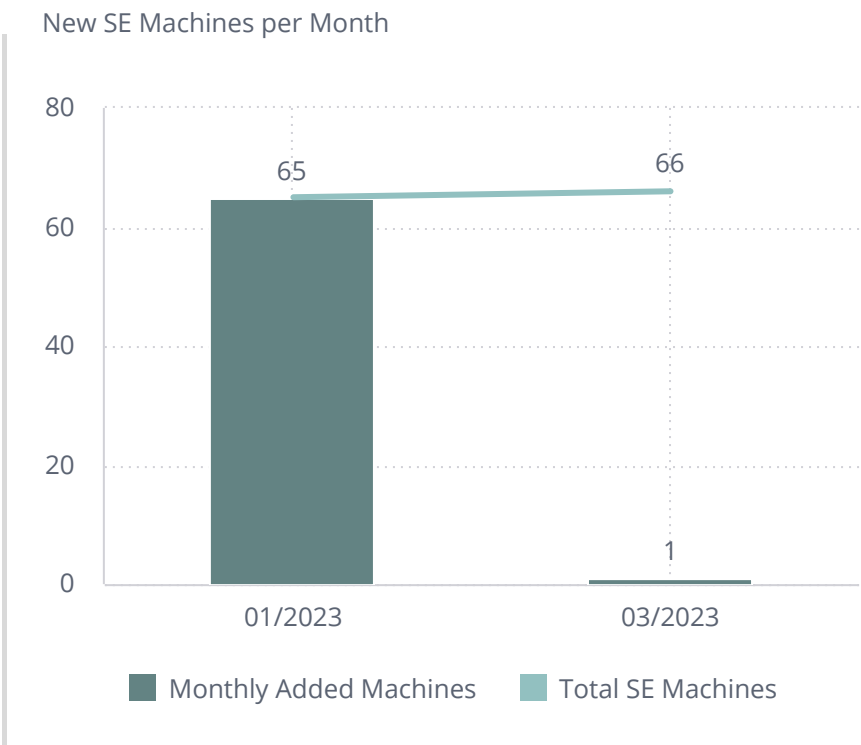

Filters


is_machine_archived

Exclude: true

company_name

Sanofi Pasteur


Machine Labeling Funnel

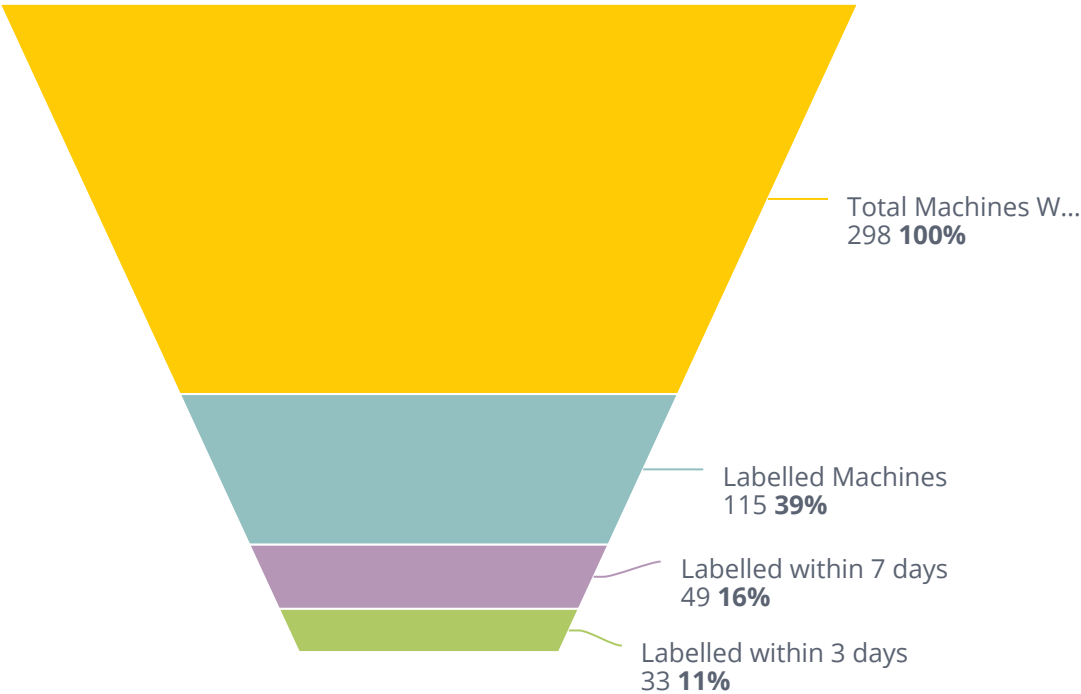


Average Detections Per Machi...

0.077

AVG Detections Per Machine p...

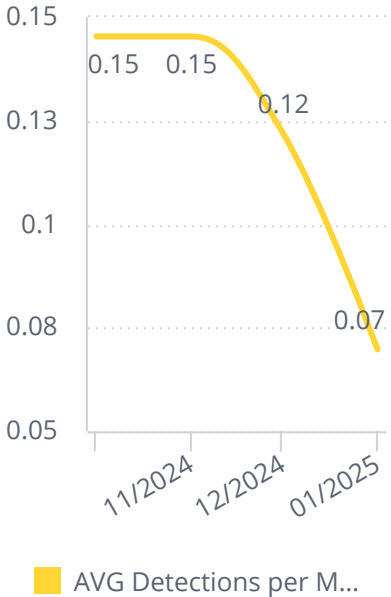

AVG Alerts Per Machine per M...

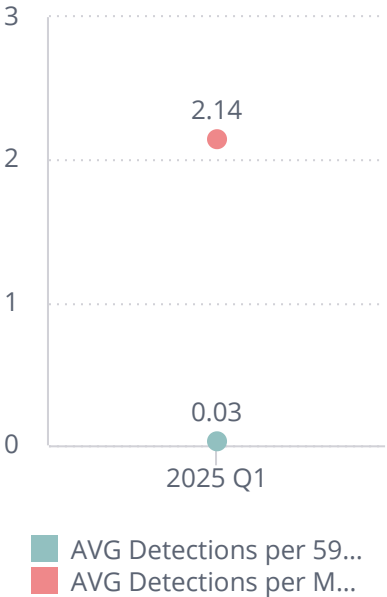



Filters

is_machine_archived

Exclude: true


company_name

Sanofi Pasteur

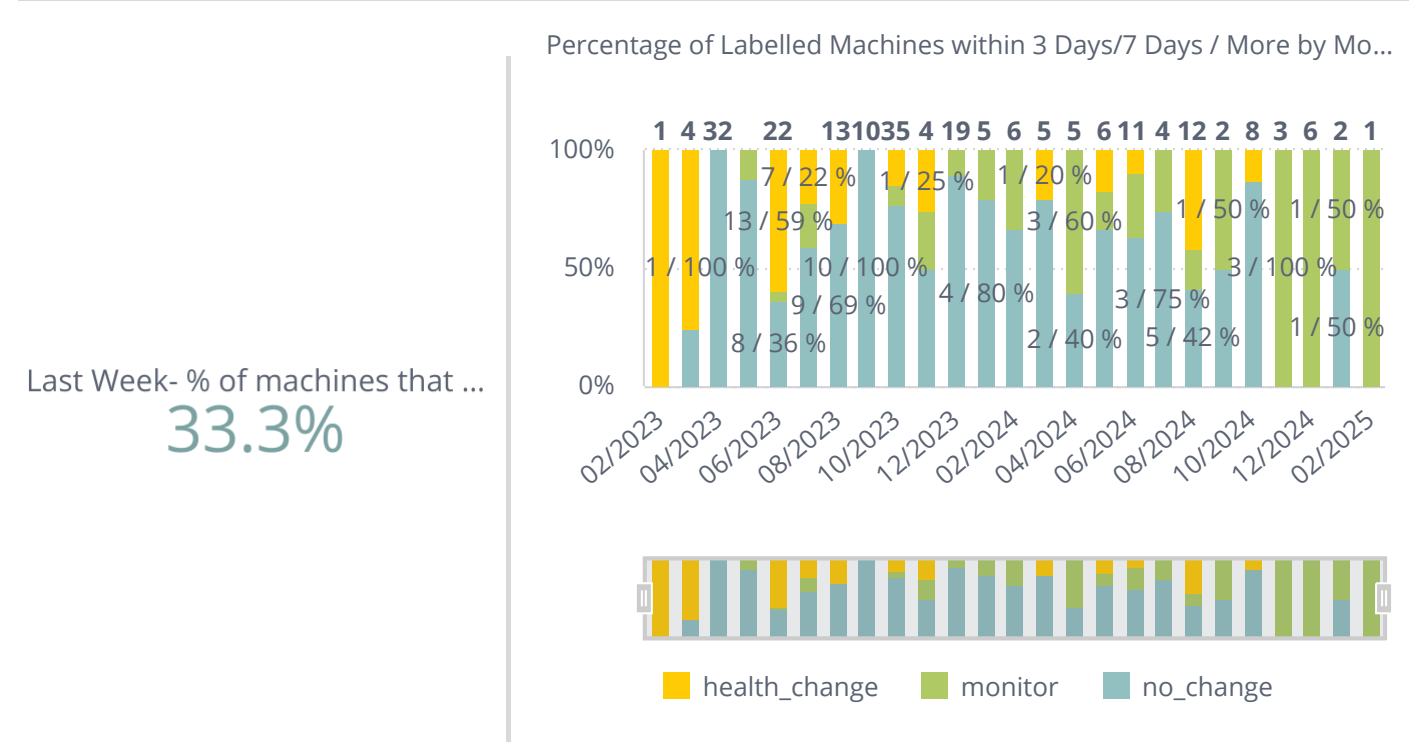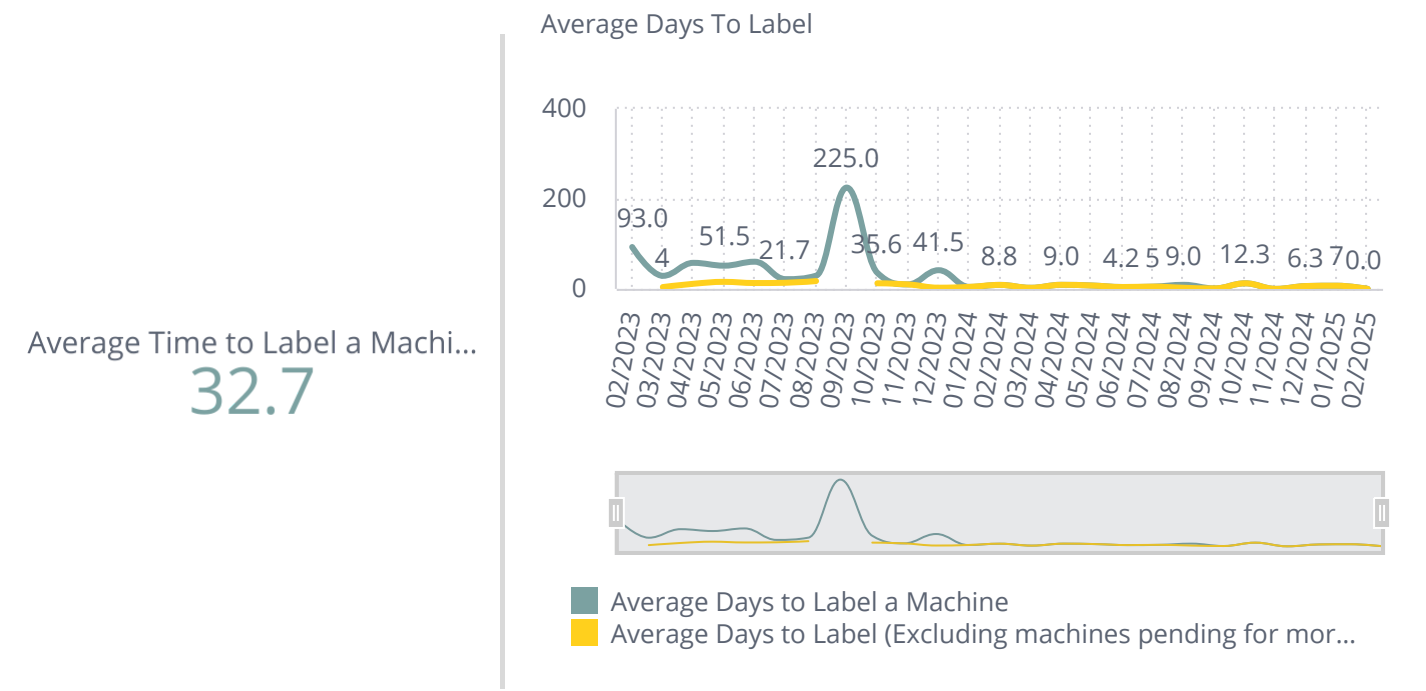


Filters is_machine_archived Exclude: true | company_name Sanofi Pasteur

Labeling Results

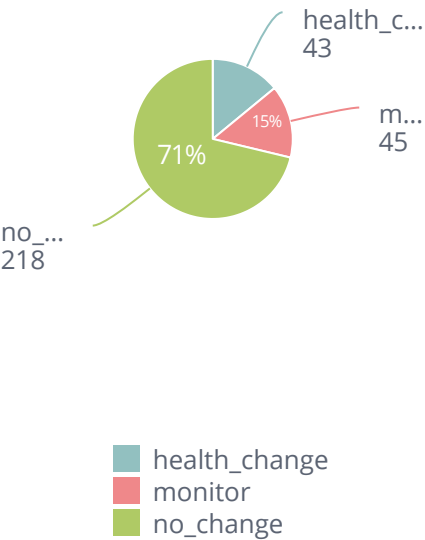


Labeling Results

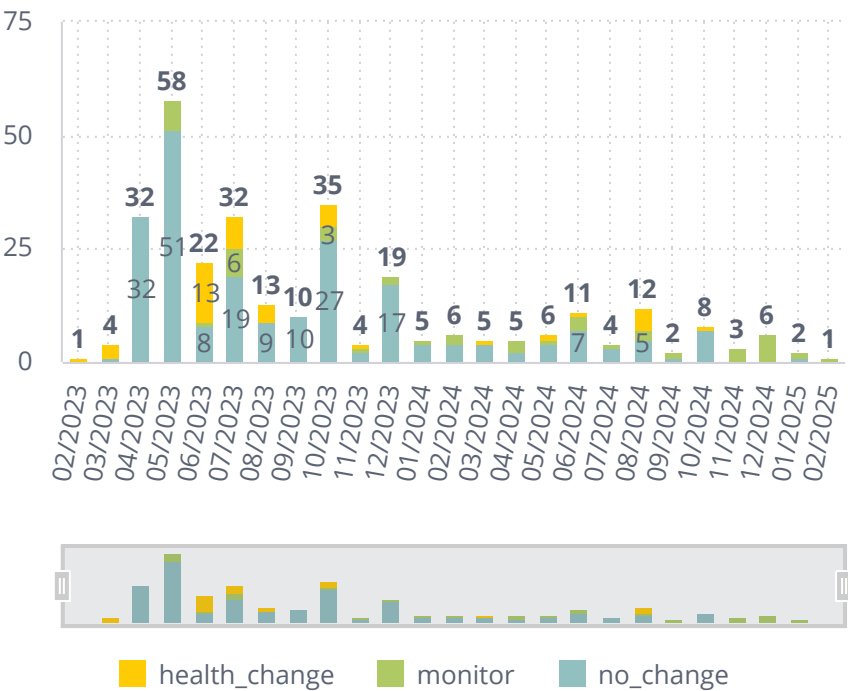

Average Detections Per Labling
3.33

AVG Detection Per Labling

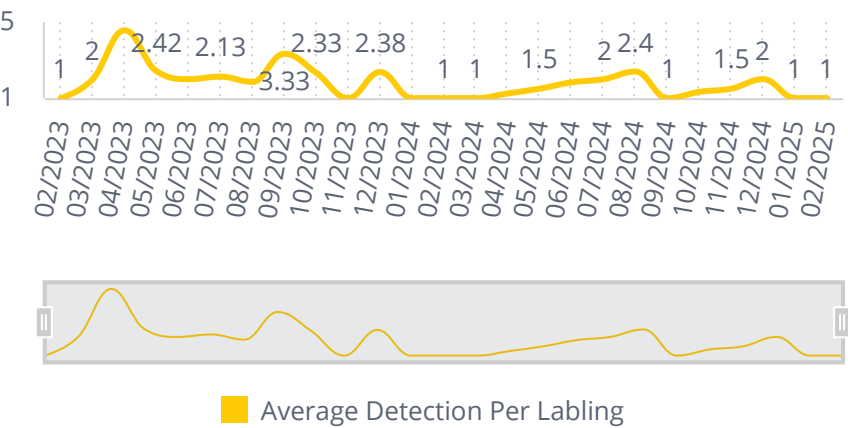

Filters

is_machine_archived

Exclude: true

company_name

Sanofi Pasteur

Month	Avg. Time to Review (In Days)
02/2023	93.96
03/2023	29.53
04/2023	58.4
05/2023	51.4
06/2023	65.73
07/2023	20.84
08/2023	29.67
09/2023	175.15
10/2023	36.01
11/2023	8.42
12/2023	42.05
01/2024	5.14
02/2024	9.52
03/2024	5.69
04/2024	9.37
05/2024	7.99
06/2024	14.31
07/2024	5.64
08/2024	9.35
09/2024	2.32
10/2024	12.86
11/2024	0.30
12/2024	6.74
01/2025	7.73
02/2025	0.15

Year	Active Users
2023	3
2024	1

Filters

is_machine_archived

Exclude: true

company_name

Sanofi Pasteur

Review Rate by Month

