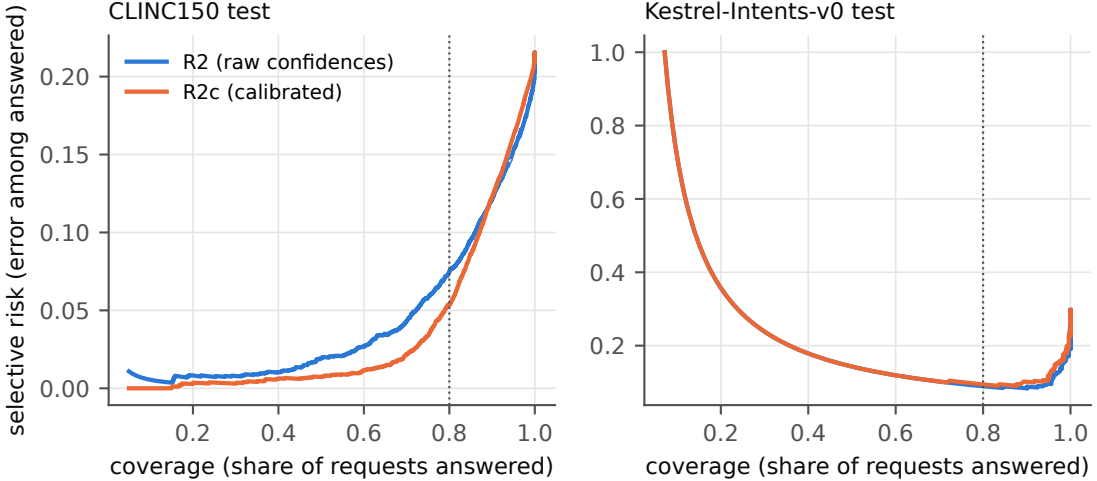
CLINC150 test
R2 (raw confidences)
R2c (calibrated)
selective risk (error among answered)
0.20
0.15
0.10
0.05
0.00
0.2
0.4
0.6
0.8
1.0
coverage (share of requests answered)
Kestrel-Intents-v0 test
1.0
0.8
0.6
0.4
0.2
0.2
0.4
0.6
0.8
1.0
coverage (share of requests answered)