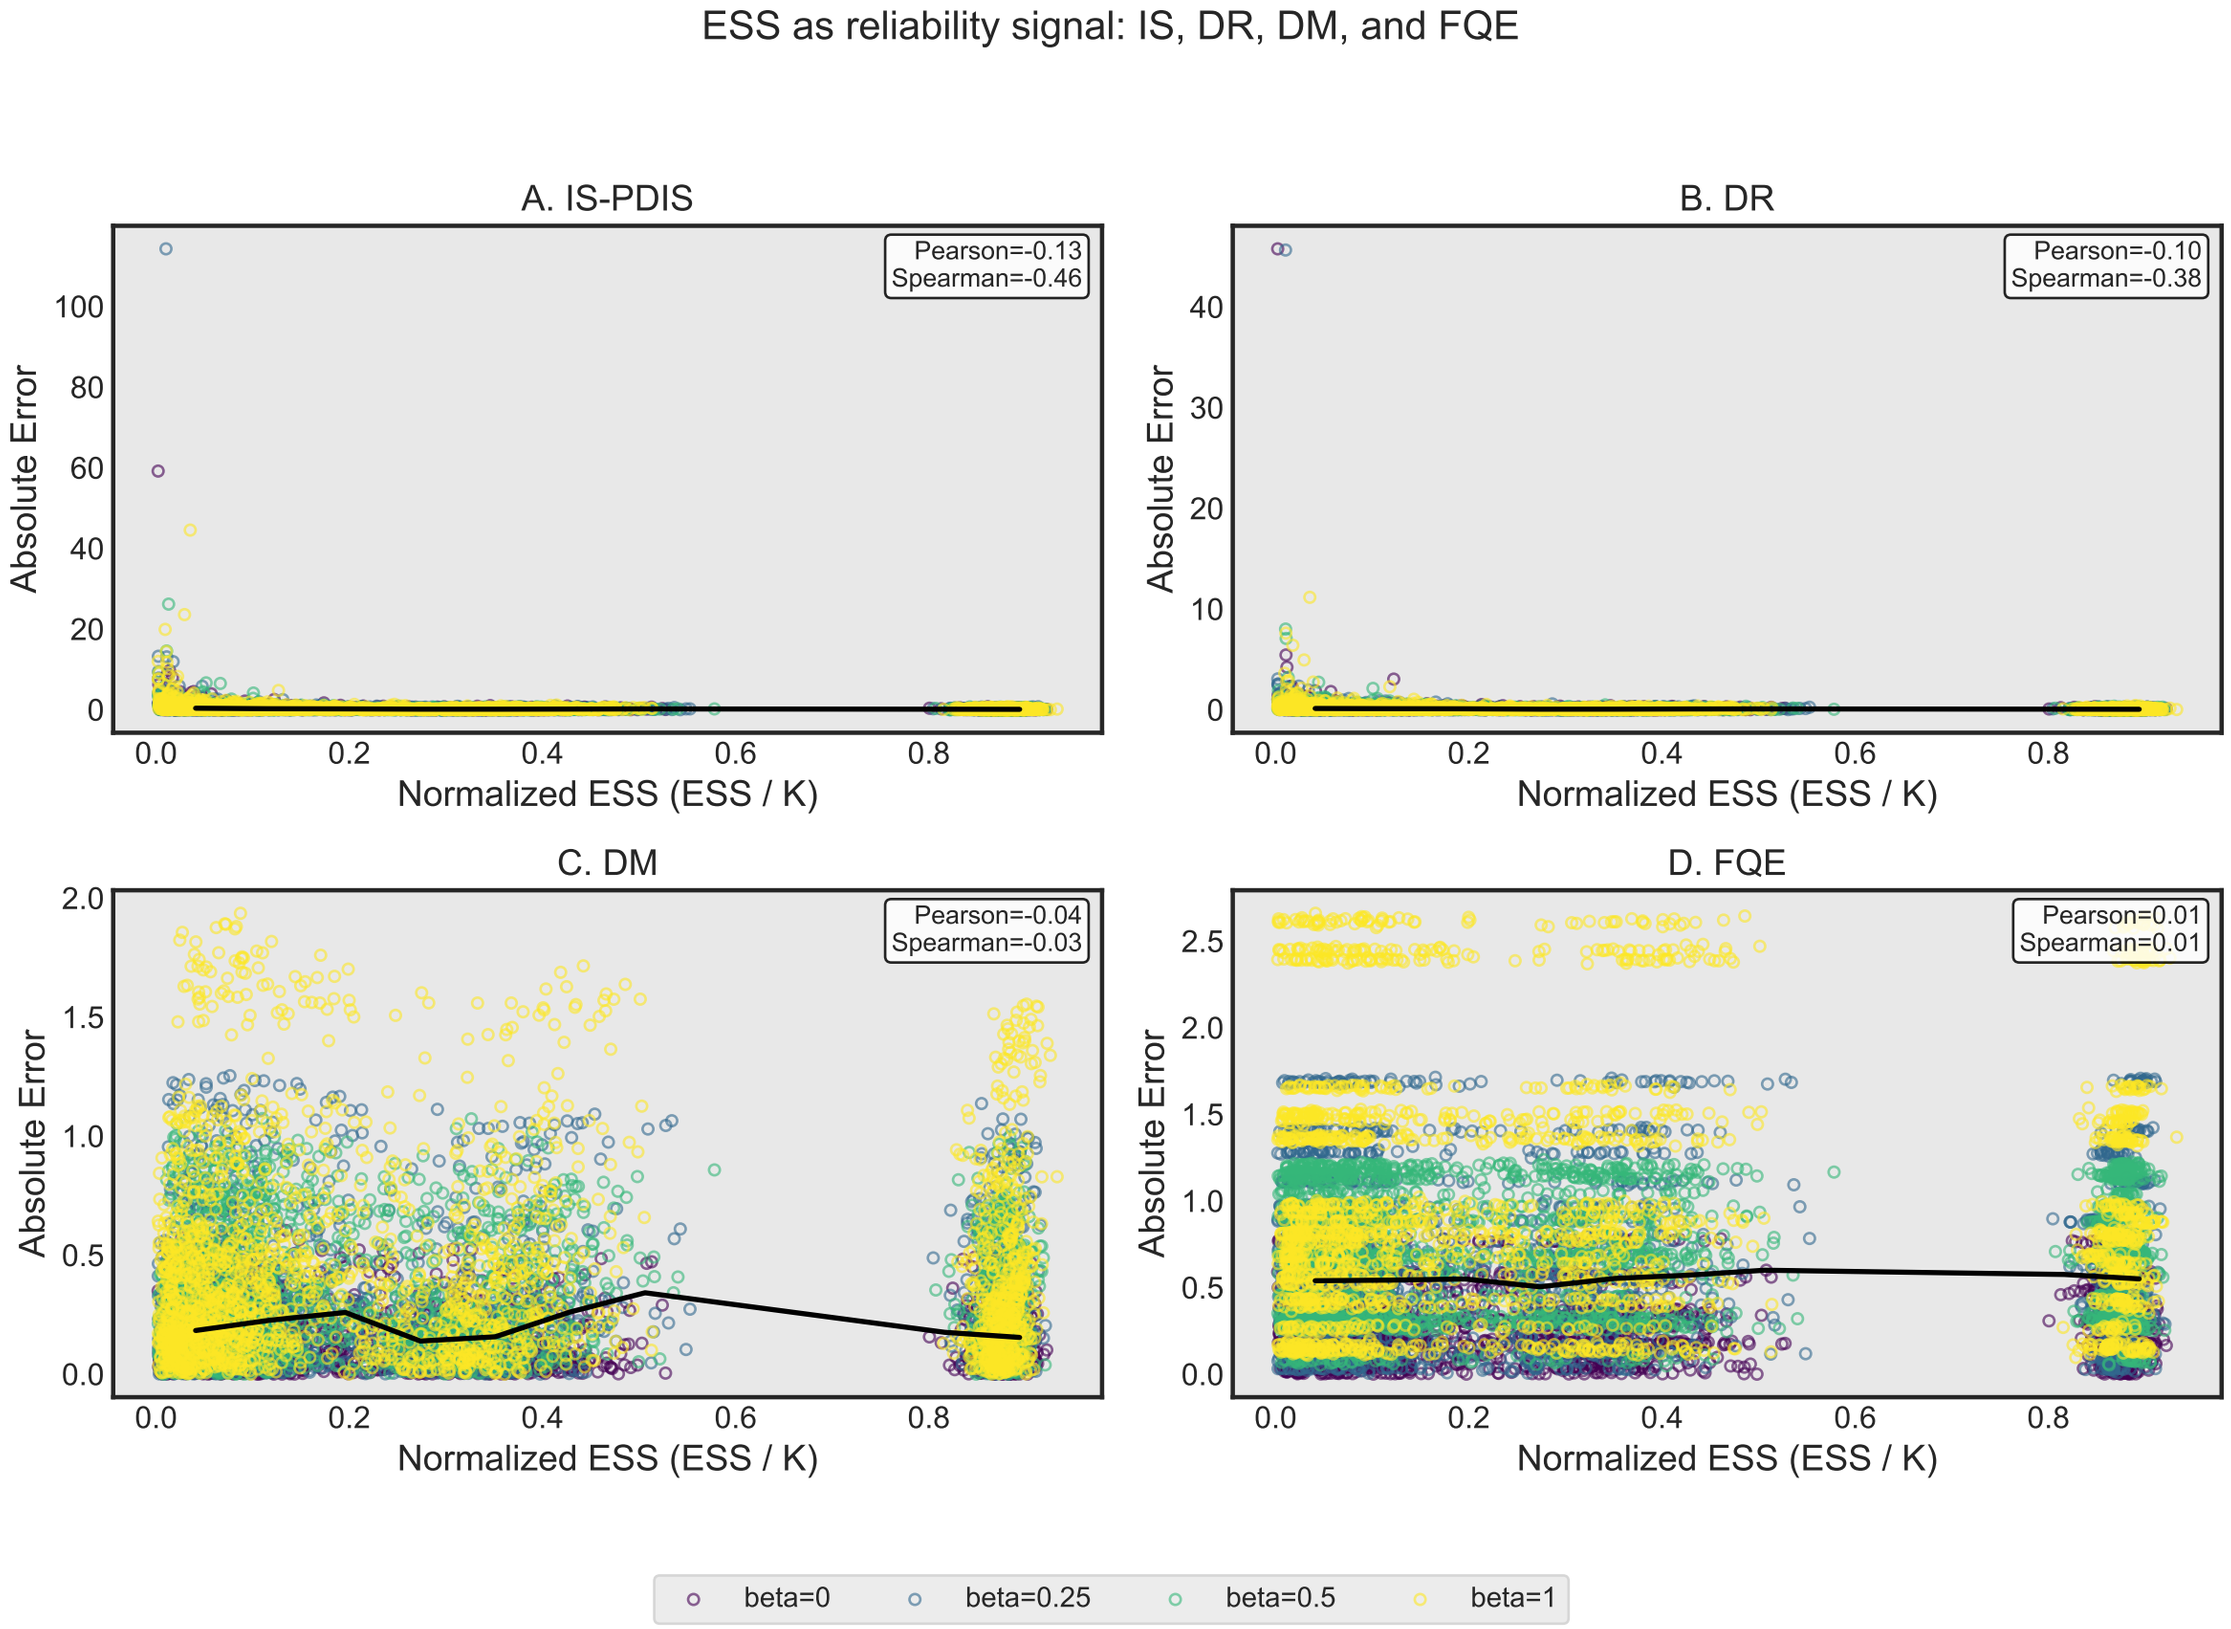
ESS as reliability signal: IS, DR, DM, and FQE
A. IS-PDIS
Pearson=-0.13
Spearman=-0.46
B. DR
Pearson=-0.10
Spearman=-0.38
C. DM
Pearson=-0.04
Spearman=-0.03
D. FQE
Pearson=0.01
Spearman=0.01
Absolute Error
Normalized ESS (ESS / K)
beta=0
beta=0.25
beta=0.5
beta=1