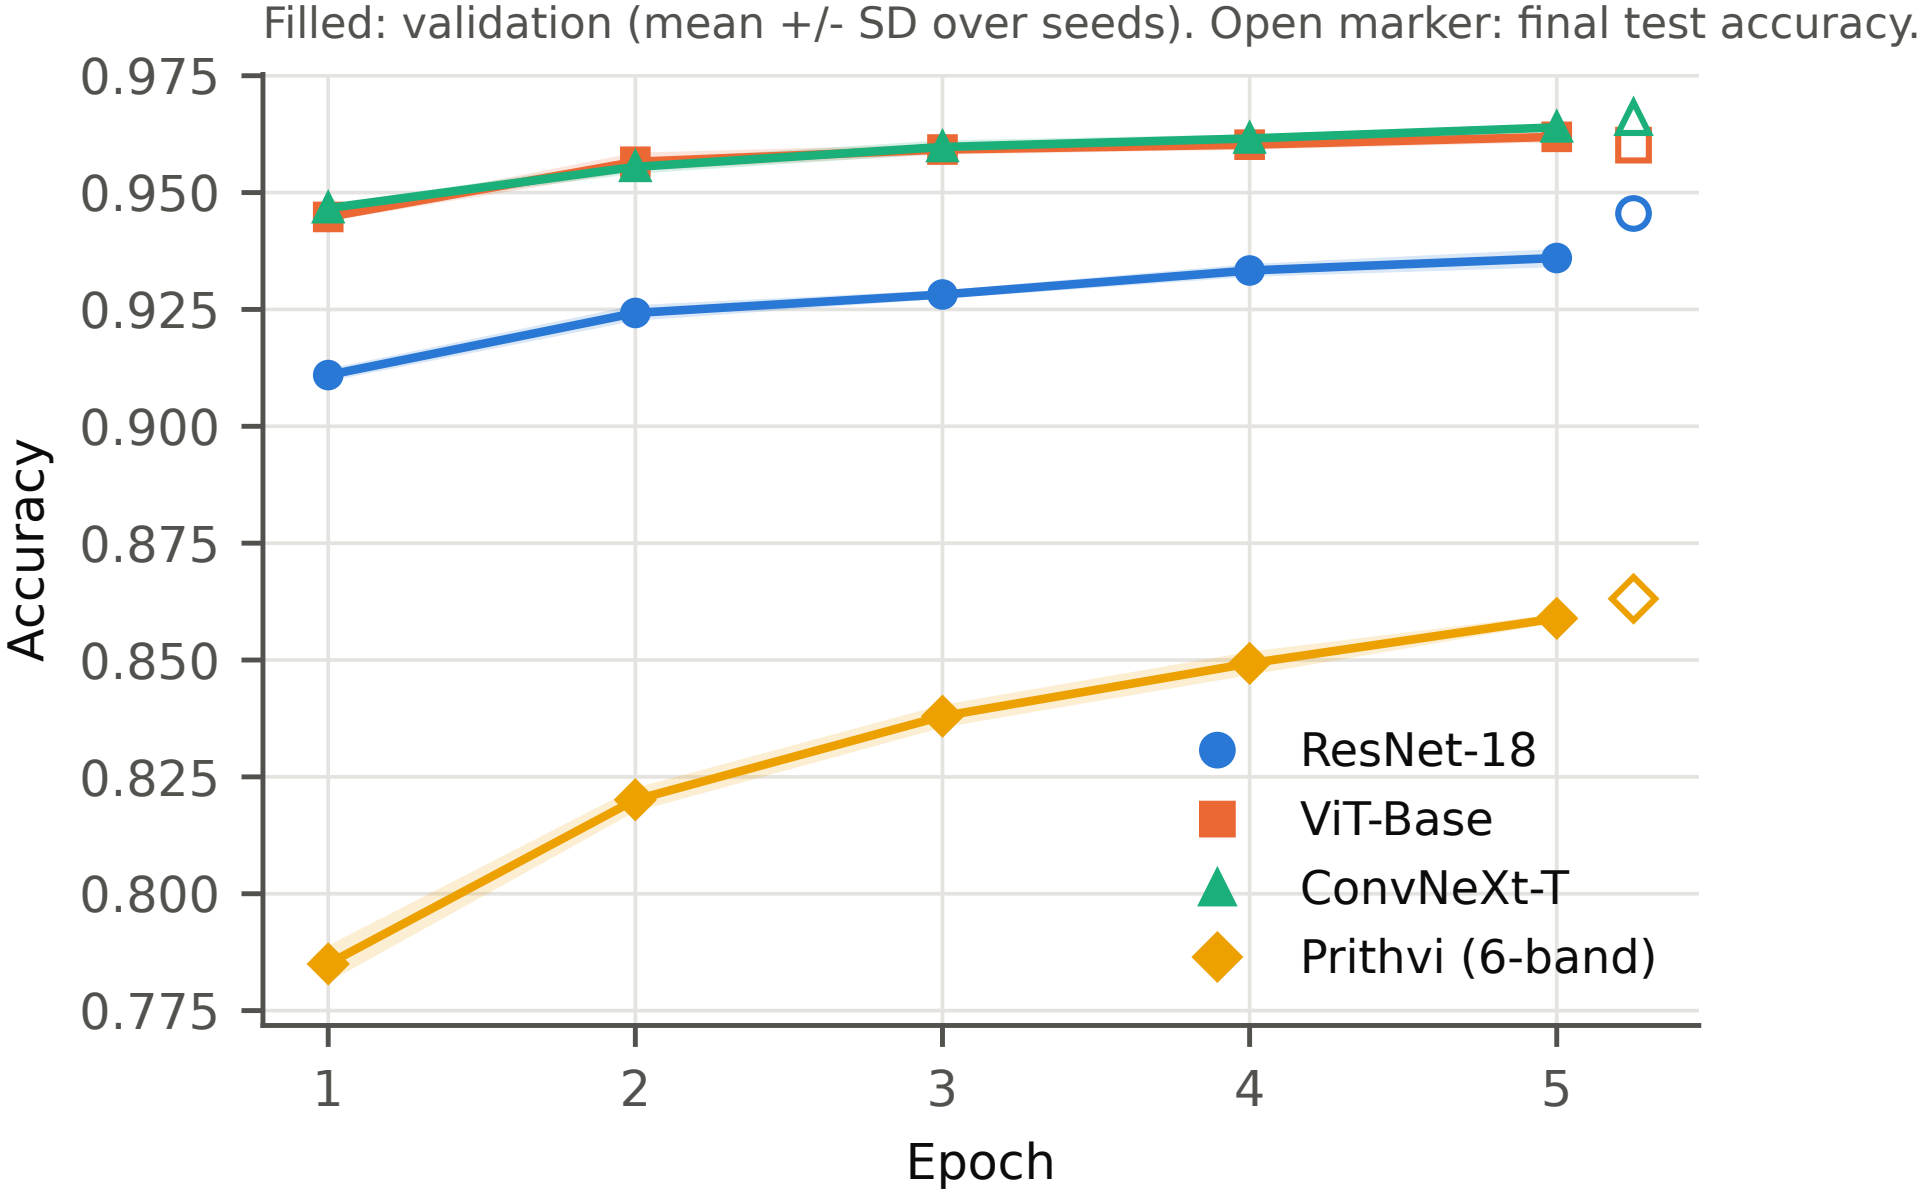

Filled: validation (mean +/- SD over seeds). Open marker: final test accuracy.
Accuracy
0.975
0.950
0.925
0.900
0.875
0.850
0.825
0.800
0.775
1
2
3
4
5
Epoch
ResNet-18
ViT-Base
ConvNeXt-T
Prithvi (6-band)