MATRIX

ULTRA SERIES

G7-S51

3 ENGLISH
11 DEUTSCH
19 NEDERLANDS
27 DANSK
35 FRANÇAIS
43 ESPAÑOL
51 ITALIANO
59 ΕΛΛΗΝΙΚΆ
57 POLSKI
75 PORTUGUÊS
83 РУССКИЙ

PROPER USAGE

1. Do not exceed weight limits of the exercise device.
2. If applicable, set safety stops to appropriate height.
3. If applicable, adjust seat pads, leg pads, foot pads, range of motion adjustment, or any other type of adjustment mechanisms to a comfortable start position. Make certain that the adjusting mechanism is fully engaged to prevent unintentional movement and to avoid injury.
4. Sit on bench (if applicable) and get into appropriate position for exercise.
5. Exercise using no more weight than you can safely lift and control.
6. In a controlled manner, perform exercise.
7. Return weight to its fully-supported start position.

MAINTENANCE CHECKLIST

ACTION	FREQUENCY
Clean Upholstery [1]	Daily
Inspect Cables [2]	Daily
Clean Guide Rods	Monthly
Inspect Hardware	Monthly
Inspect Frame	Bi-Annually
Clean Machine	As Needed
Clean Grips [1]	As Needed
Lubricate Guide Rods [3]	As Needed

[1] Upholstery & Grips should be cleaned with a mild soap and water or a non-ammonia based cleaner.

[2] Cables should be inspected for cracks or frays and immediately replaced if present. If excessive slack exists cable should be tightened without lifting the head plate.

[3] Guide rods should be lubricated with Teflon based lubricant. Apply the lubricant to a cotton cloth and then apply up and down the guide rods.

WARRANTY

For North America, please visit **matrixfitness.com** for warranty information along with warranty exclusions and limitations.

PRODUCT SPECIFICATIONS

Max User Weight	136 kg / 300 lbs
Max Training Weight G7-S51 G7-S51B G7-S51BH	 111.4 kg / 247.5 lbs 72 kg / 160 lbs 108 kg / 240 lbs
Product Weight G7-S51 G7-S51B G7-S51BH	 290 kg / 640 lbs 247 kg / 544.5 lbs 283 kg / 624.5 lbs
Overall Dimensions (L x W x H)*	139 x 121 x 147 cm / 54.6 x 47.5 x 57.9"

* Ensure a minimum clearance width of 0.6 meters (24") for access to and passage around MATRIX strength equipment. Please note, 0.91 meters (36") is the ADA recommended clearance width for individuals in wheelchairs.

TORQUE VALUES

M10 Bolt (Nyloc Nut & Flowdrill)	77 Nm / 57 ft -lbs
M8 Bolts	25 Nm / 18 ft-lbs
M8 Plastic	15 Nm / 11 ft-lbs
M6 Bolts	15 Nm / 11 ft-lbs
Pad Bolts	10 Nm / 7 ft-lbs

IMPORTANT SAFETY INFORMATION

It is the sole responsibility of the purchaser of MATRIX products to instruct all individuals, whether they are the end user or supervising personnel on proper usage of the equipment.

It is recommended that all users of MATRIX exercise equipment be informed of the following information prior to its use.

Do not use any equipment in any way other than designed or intended by the manufacturer.
It is imperative that MATRIX equipment be used properly to avoid injury.

INSTALLATION

1. STABLE AND LEVEL SURFACE: MATRIX exercise equipment must be installed on a stable base and properly leveled.
2. **SECURING EQUIPMENT: Manufacturer recommends that all stationary MATRIX strength equipment be secured to the floor to stabilize equipment and eliminate rocking or tipping over. This must be performed by a licensed contractor.**
3. Under no circumstances should you slide equipment across the floor due to risk of tipping. Use proper materials handling techniques and equipment recommended by OSHA.

   All anchor points must be able to withstand 750 lbs. (3.3 kN) pull-out force.

MAINTENANCE

1. DO NOT use any equipment that is damaged and or has worn or broken parts. Use only replacement parts supplied by your country's local MATRIX dealer.
2. MAINTAIN LABELS AND NAMEPLATES: Do not remove labels for any reason. They contain important information. If unreadable or missing, contact your MATRIX dealer for a replacement.
3. MAINTAIN ALL EQUIPMENT: Preventative maintenance is the key to smooth operating equipment as well as keeping your liability to a minimum. Equipment needs to be inspected at regular intervals.
4. Ensure that any person(s) making adjustments or performing maintenance or repair of any kind is qualified to do so. MATRIX dealers will provide service and maintenance training at our corporate facility upon request.

ADDITIONAL NOTES

This equipment should only be used in supervised areas where access and control is specifically regulated by the owner. It is up to the owner to determine who is allowed access to this training equipment. The owner should consider a user's: degree of reliability, age, experience, etc.

This training equipment meets industry standards for stability when used for its intended purpose in accordance with the instructions provided by the manufacturer.

This equipment is for indoor use only. This training equipment is a Class S product (designed for use in a commercial environment such as a fitness facility). This training equipment is in compliance with EN ISO 20957-1 and EN 957-2.

⚠ WARNING

DEATH OR SERIOUS INJURY CAN OCCUR ON THIS EQUIPMENT. FOLLOW THESE PRECAUTIONS TO AVOID INJURY!

1. Keep children under the age of 14 away from this strength training equipment. Teenagers must be supervised at all times while using this equipment.
2. This equipment is not intended for use by persons with reduced physical, sensory or mental capabilities, or lack of experience and knowledge, unless they have been given supervision or instruction concerning use of the equipment by a person responsible for their safety.
3. All warnings and instructions should be read and proper instruction obtained prior to use. Use this equipment for its intended purpose ONLY.
4. Inspect the machine before use. DO NOT use machine if it appears damaged or inoperable.
5. Do not exceed weight capacity of this equipment.
6. Check to see that the selector pin is completely inserted into the weight stack.
7. NEVER use the machine with the weight stack pinned in an elevated position.
8. NEVER use dumbbells or other means to incrementally increase the weight resistance. Only use the means provided directly from the manufacturer.
9. Injuries to health may result from incorrect or excessive training. Cease exercise if you feel faint or dizzy. Obtain a medical exam before beginning an exercise program.
10. Keep body, clothing, hair, and fitness accessories free and clear of all moving parts.
11. Adjustable stops, where provided, must be used at all times.
12. When adjusting any adjustable mechanism (stop position, seat position, pad location, range of motion limiter, pulley carriage, or any other type), make certain that the adjustable mechanism is fully engaged prior to use to prevent unintended motion.
13. Manufacturer recommends that this equipment be secured to the floor to stabilize and eliminate rocking or tipping over. Use a licensed contractor.
14. If equipment is NOT secured to floor: NEVER allow resistance straps, ropes or other means to be attached to this equipment, as this may result in serious injury. NEVER use this equipment for support during stretching, as this may result in serious injury.
15. DO NOT REMOVE THIS LABEL. REPLACE IF DAMAGED OR ILLEGIBLE.

ABDOMINAL CRUNCH
MATRIX

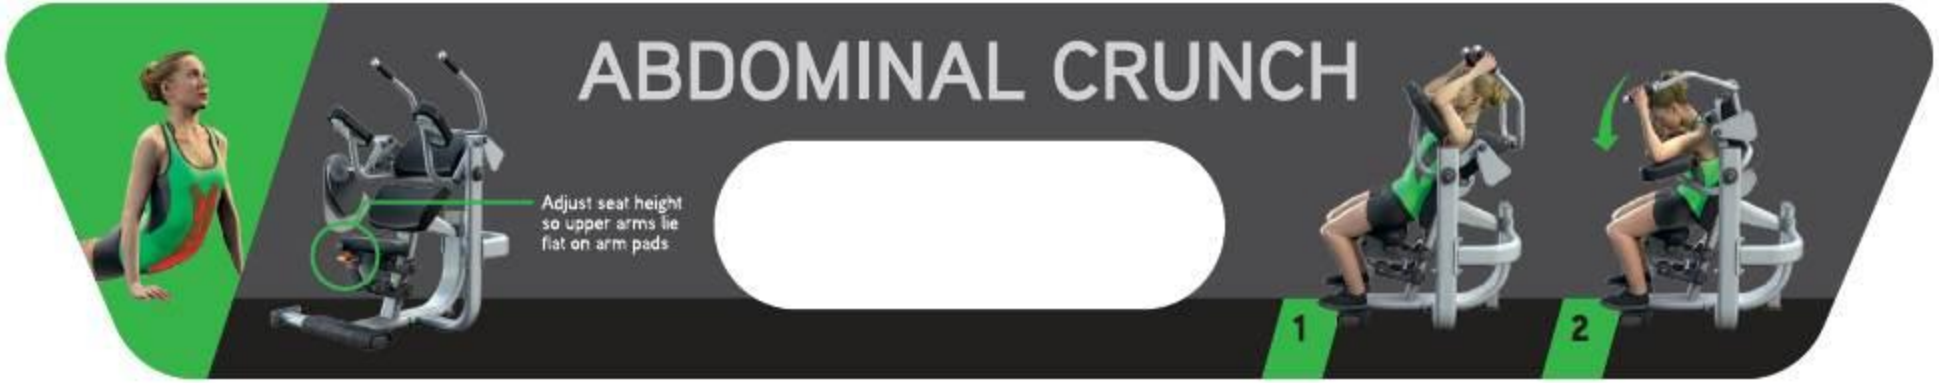
ABDOMINAL CRUNCH
Adjust seat height so upper arms lie flat on arm pads
1
2

3

Крепежные элементы для этапа 3		
	Описание	**Кол-во**
A	Болт (M10x80)	2
B	Шайба (Ф10,2)	4
C	Контргайка с нейлоновым кольцом (M10)	10
D	Пружинная шайба (Ф10,2)	2
G	Дуговая шайба (M10)	16
H	Болт (M10x130)	4
I	Болт (M10x180)	4

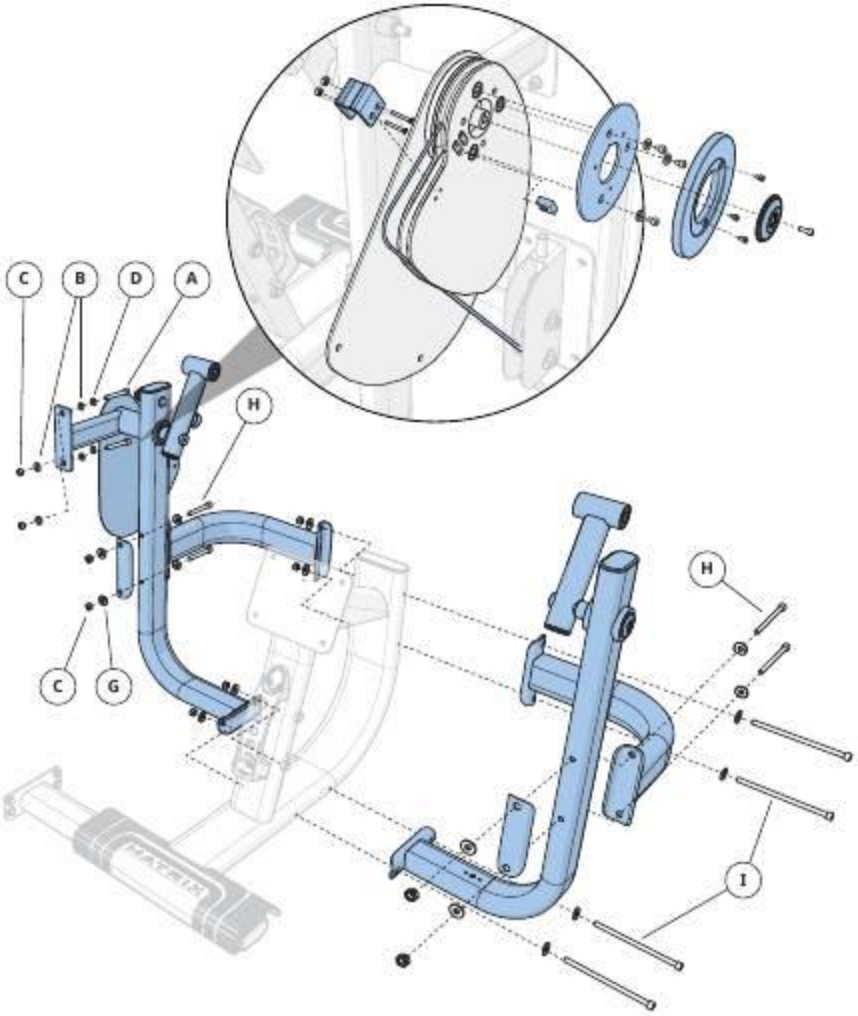

4

Крепежные элементы для этапа 4		
	Описание	**Кол-во**
F	Болт (M10x20)	4
J	Стопорная пластина	4
K	Ось	2
L	Винт (M6x12)	2
M	Шайба (Ф6,4)	2
N	Шатун	1

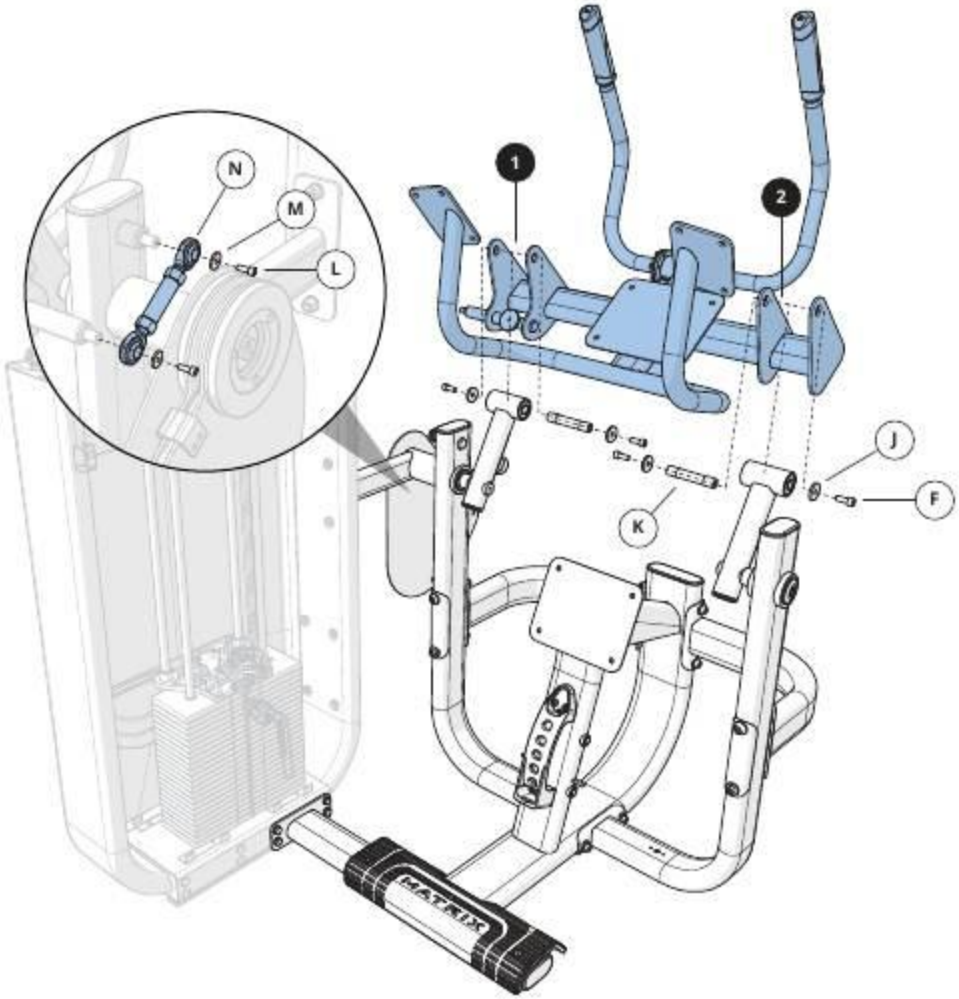

5

Крепежные элементы для этапа 5

	Описание	Кол-во
E	Болт с шестигранной головкой (M10x25)	4
O	Болт (M8x25)	8
P	Крышка	8
Q	Вихревая пружина	2
R	Ось	4

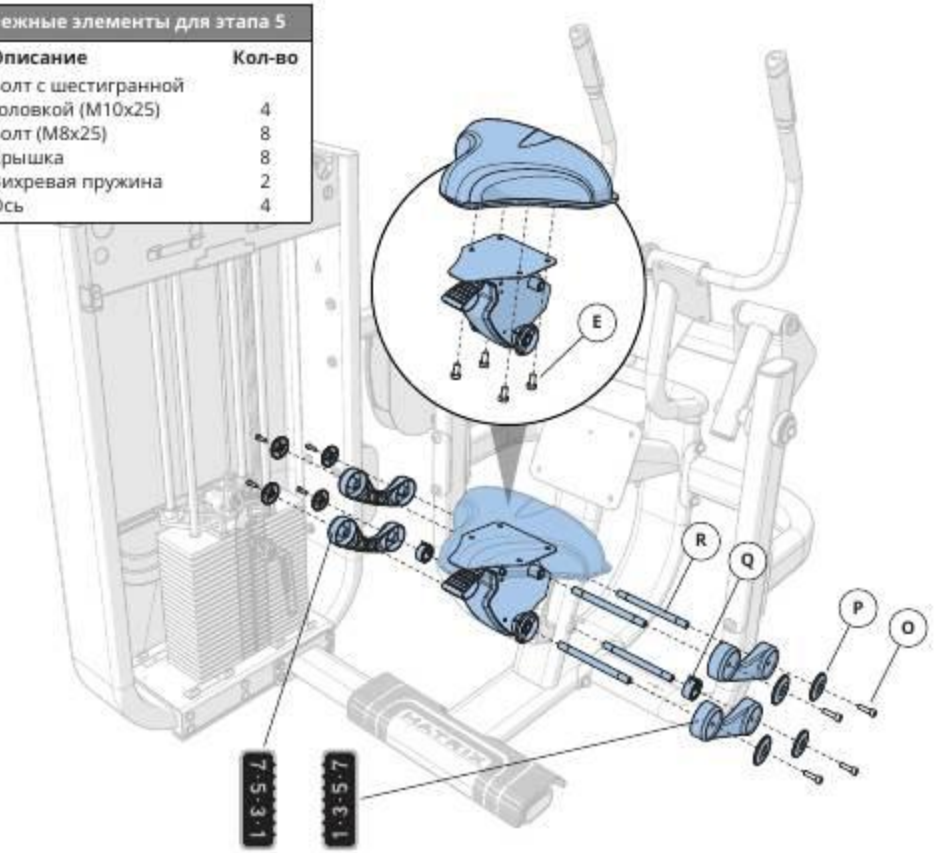

G7-S51B / BH

	Описание	Кол-во
X	Болт (M10x25L)	8
Y	Контргайка с нейлоновым кольцом (M8)	2

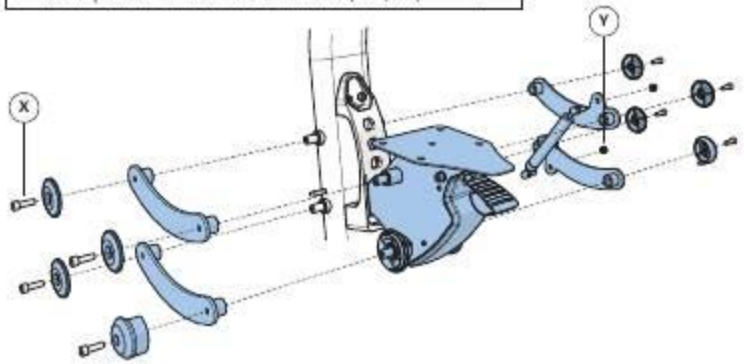

6

Крепежные элементы для этапа 6

	Описание	Кол-во
S	Болт (M8x75)	3
T	Шайба (Ф8,4)	6
U	Соединитель	3
V	Гайка (M8)	3

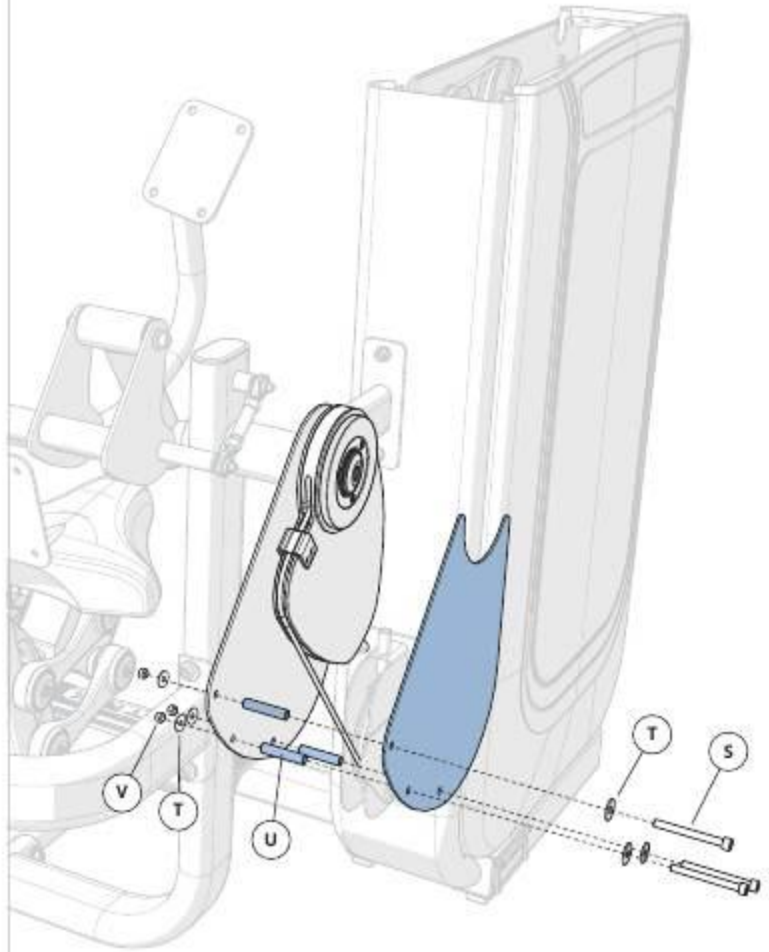

7

Крепежные элементы для этапа 7		
	Описание	**Кол-во**
W	Винт (M10x20)	16

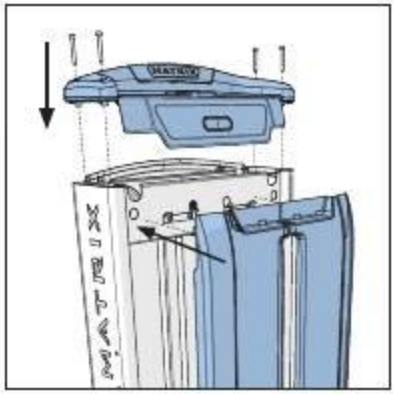

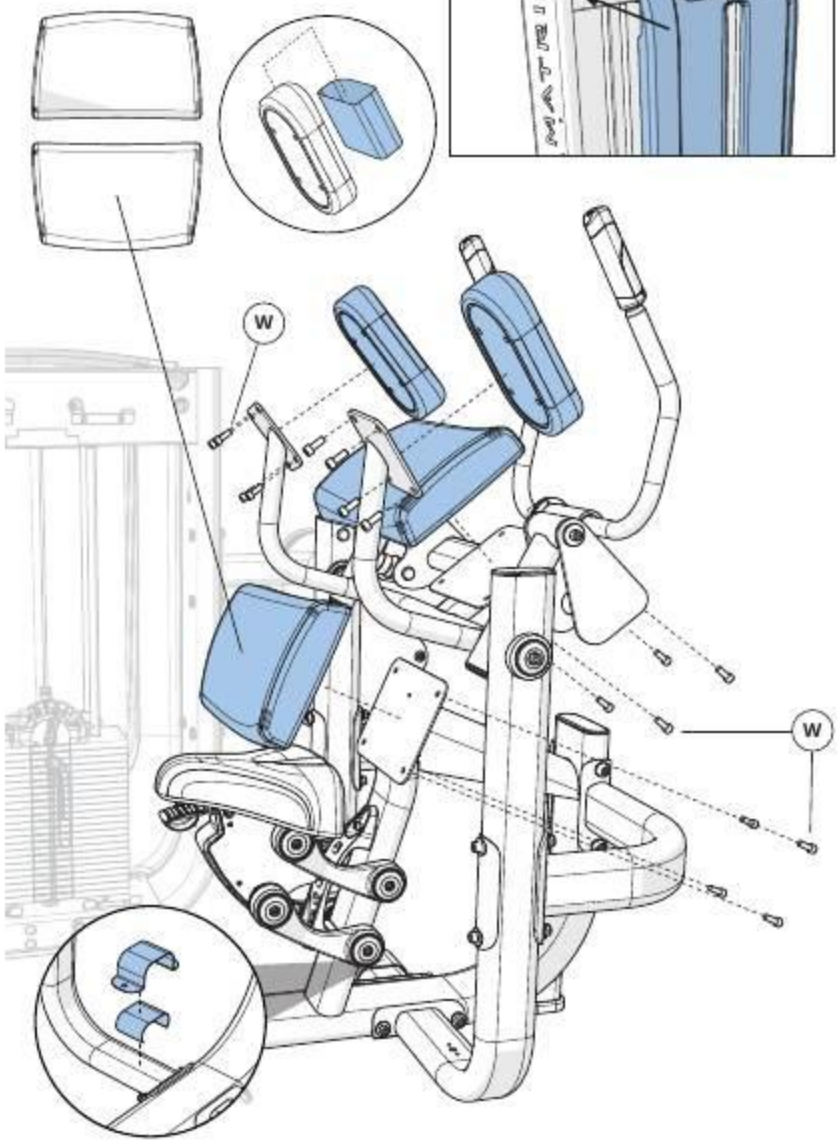

СБОРКА ЗАВЕРШЕНА!

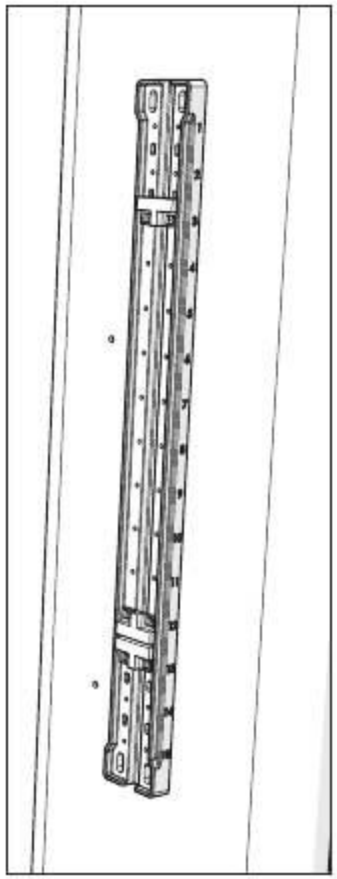

Оборудование		Расположение датчиков *		
G7-S13	Жим от груди	A9 ↓	B10 ↓	C13 ↓
G7-S23	Жим от плеч	A10 ↓	B11 ↓	C14 ↓
G7-S71	Разгибание ног	A8 ↑	B9 ↑	C13 ↓
G7-S72	Сгибание ног сидя	A7 ↓	B11 ↓	C15 ↓
G7-S70	Жим ногами	A10 ↑	B11 ↑	C14 ↓
G7-S33	Тяга верхнего блока к груди	A6 ↑	B7 ↑	C12 ↓
G7-S42	Жим на блоке вниз	A5 ↑	B9 ↑	C12 ↓
G7-S34	Тяга на низком блоке	A7 ↑	B8 ↑	C13 ↓
G7-S40	Подъем на бицепс	A12 ↑	B13 ↑	C15 ↓
G7-S74	Приведение бедра	A8 ↑	B9 ↑	C11 ↓
G7-S75	Отведение бедра	A6 ↑	B7 ↑	C11 ↓
G7-S22	Сведение рук сидя/ задние дельты	A8 ↑	B9 ↑	C14 ↓
G7-S51	Пресс-машина	A10 ↑	B11 ↑	C13 ↓
G7-S52	Растягивание мышц спины	A7 ↑	B8 ↑	C13 ↓
G7-S78	Ягодичные мышцы	A9 ↓	B12 ↓	C15 ↓
G7-S55	Вращение торса	A11 ↑	B12 ↓	C15 ↓
G7-S21	Разведение рук в стороны	A8 ↑	B9 ↑	C15 ↓
G7-S73	Сгибание ног лежа	A10 ↑	B11 ↑	C15 ↓
G7-S77	Подъем на голень	A9 ↓	B11 ↓	C15 ↓

* A = Top Sensor
B = Middle Sensor
C = Bottom Sensor

Ориентация датчика

MATRIX

© 2020 Johnson Health Tech