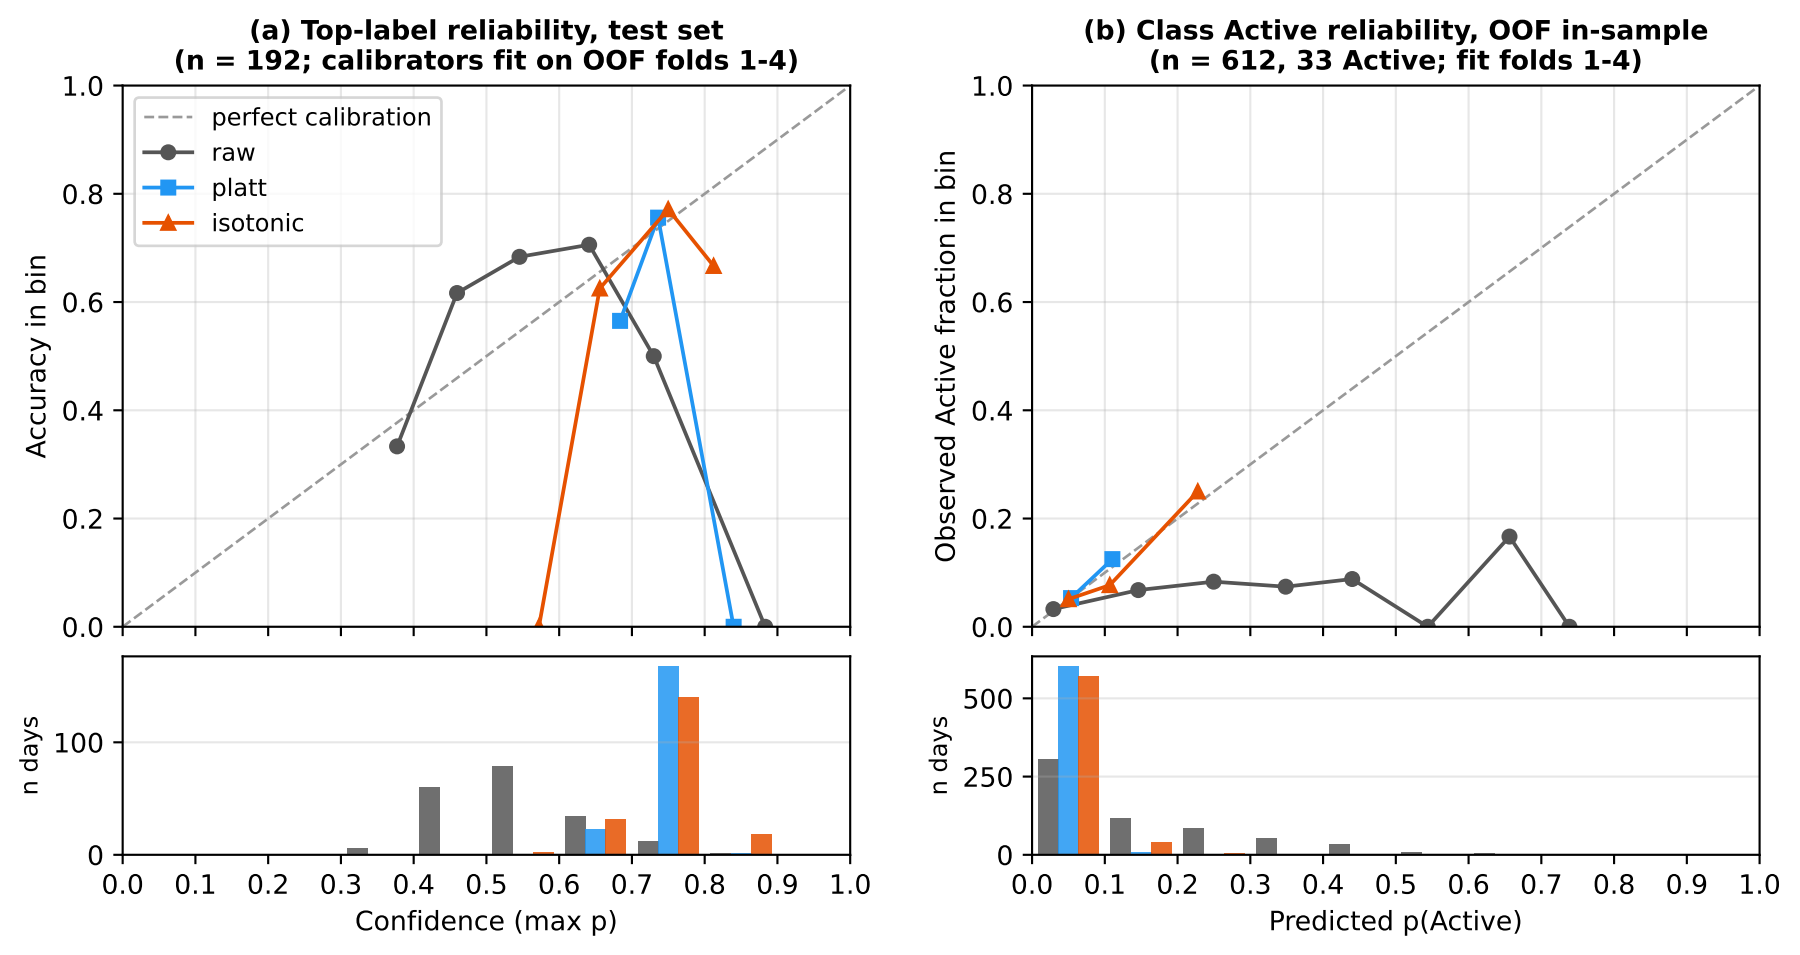
(a) Top-label reliability, test set
(n = 192; calibrators fit on OOF folds 1-4)
perfect calibration
raw
platt
isotonic
Accuracy in bin
n days
Confidence (max p)
(b) Class Active reliability, OOF in-sample
(n = 612, 33 Active; fit folds 1-4)
Observed Active fraction in bin
n days
Predicted p(Active)