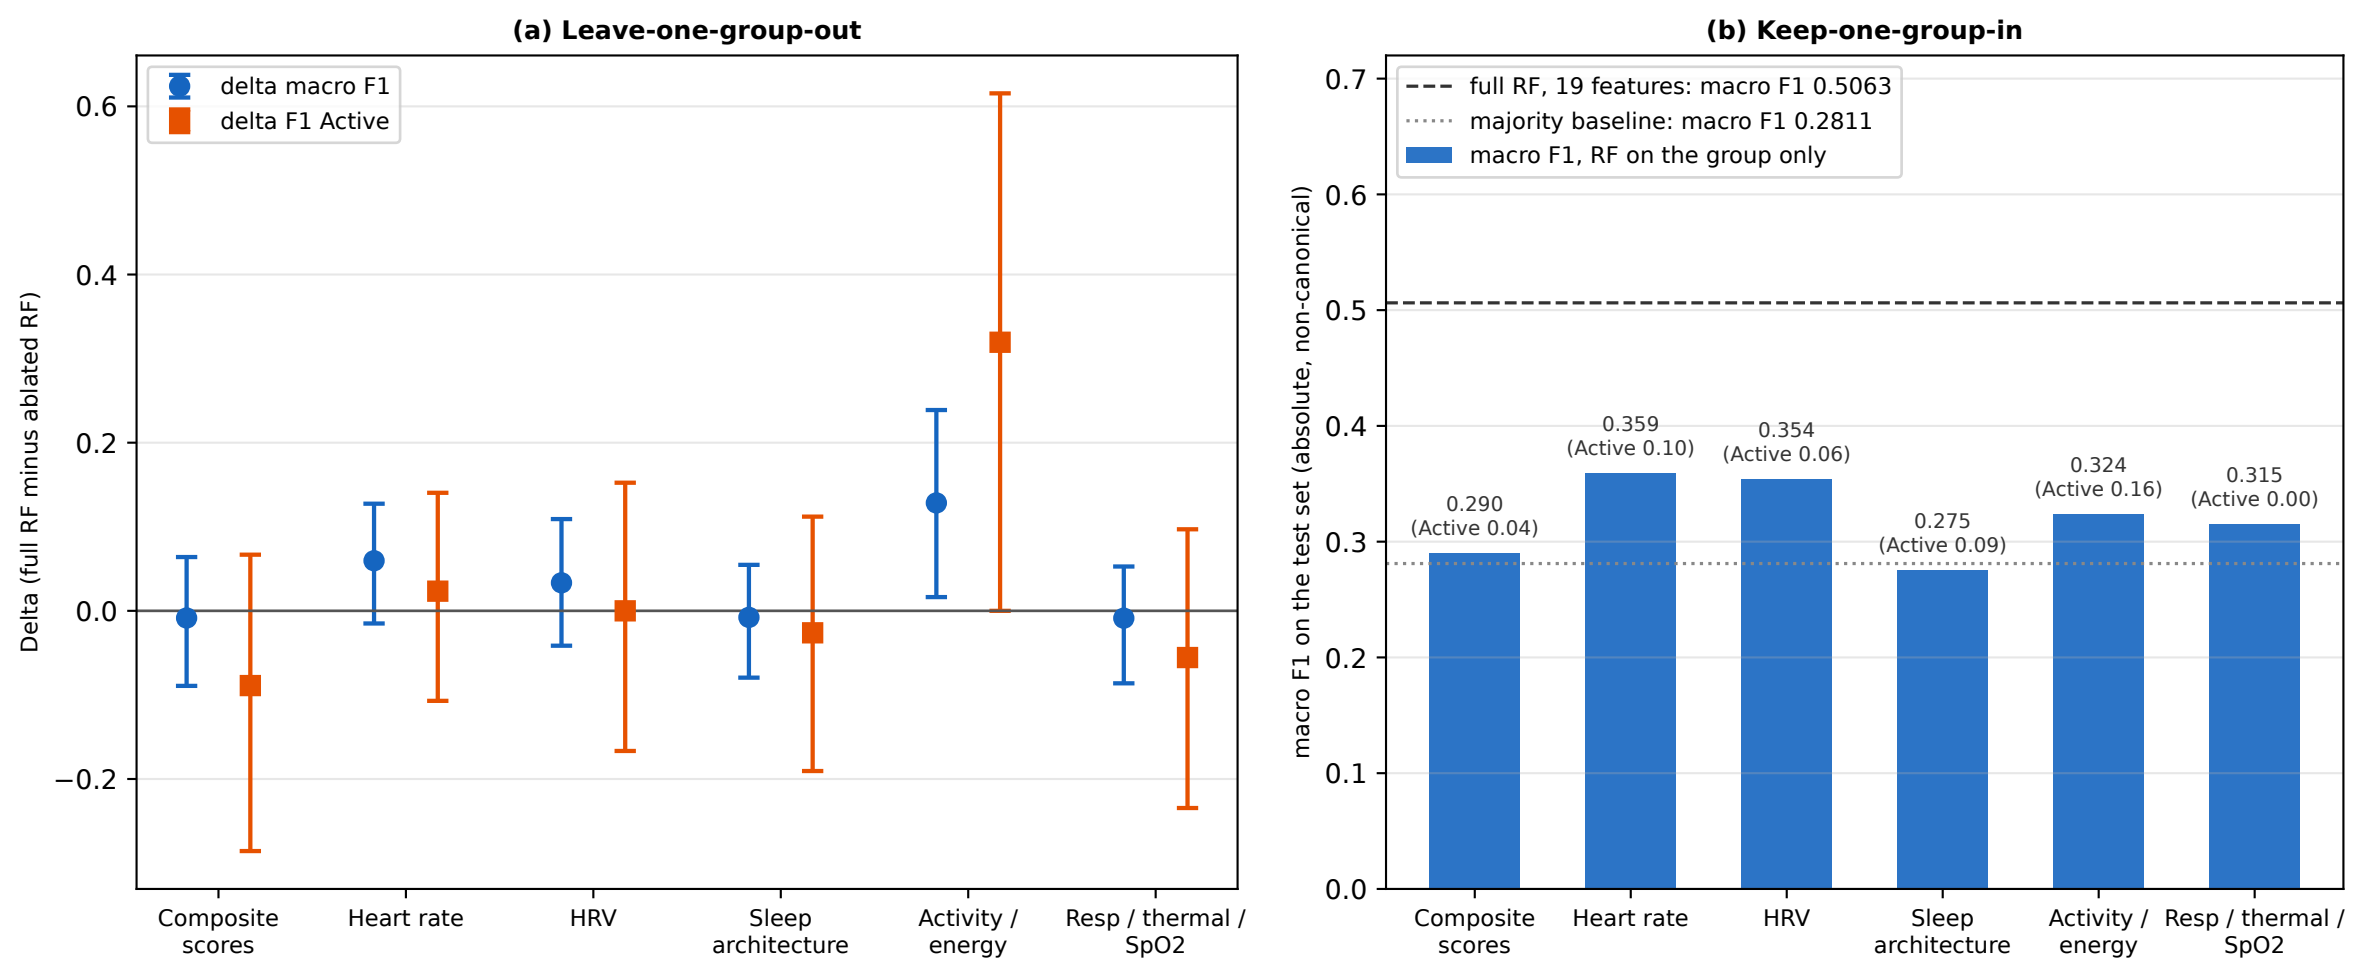
(a) Leave-one-group-out
delta macro F1
delta F1 Active
Delta (full RF minus ablated RF)
0.6
0.4
0.2
0.0
−0.2
Composite scores
Heart rate
HRV
Sleep architecture
Activity / energy
Resp / thermal / SpO2
(b) Keep-one-group-in
full RF, 19 features: macro F1 0.5063
majority baseline: macro F1 0.2811
macro F1, RF on the group only
macro F1 on the test set (absolute, non-canonical)
0.7
0.6
0.5
0.4
0.3
0.2
0.1
0.0
0.290
(Active 0.04)
0.359
(Active 0.10)
0.354
(Active 0.06)
0.275
(Active 0.09)
0.324
(Active 0.16)
0.315
(Active 0.00)
Composite scores
Heart rate
HRV
Sleep architecture
Activity / energy
Resp / thermal / SpO2