

Bottle_filling_capping_conveyor / PLC_1 [CPU 1215C DC/DC/DC] / Program blocks

Main [OB1]

Main Properties

General

Name	Main	Number	1	Type	OB
Language	LAD	Numbering	Automatic		


Information

Title	"Main Program Sweep (Cycle)"	Author		Comment	
Family		Version	0.1	User-defined ID	


Main

Name	Data type	Default value	Comment
▼ Input			
Initial_Call	Bool		Initial call of this OB
Remanence	Bool		=True, if remanent data are available
Temp			
Constant			

Network 1: SYSTEM MEMORY

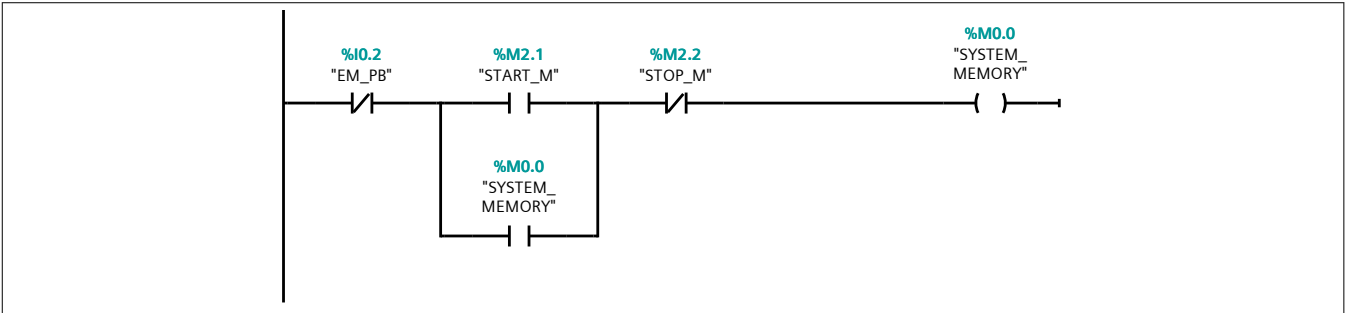

Network 2: GRABBER BOTTLE DETECT AND HAND MOVEMENTS

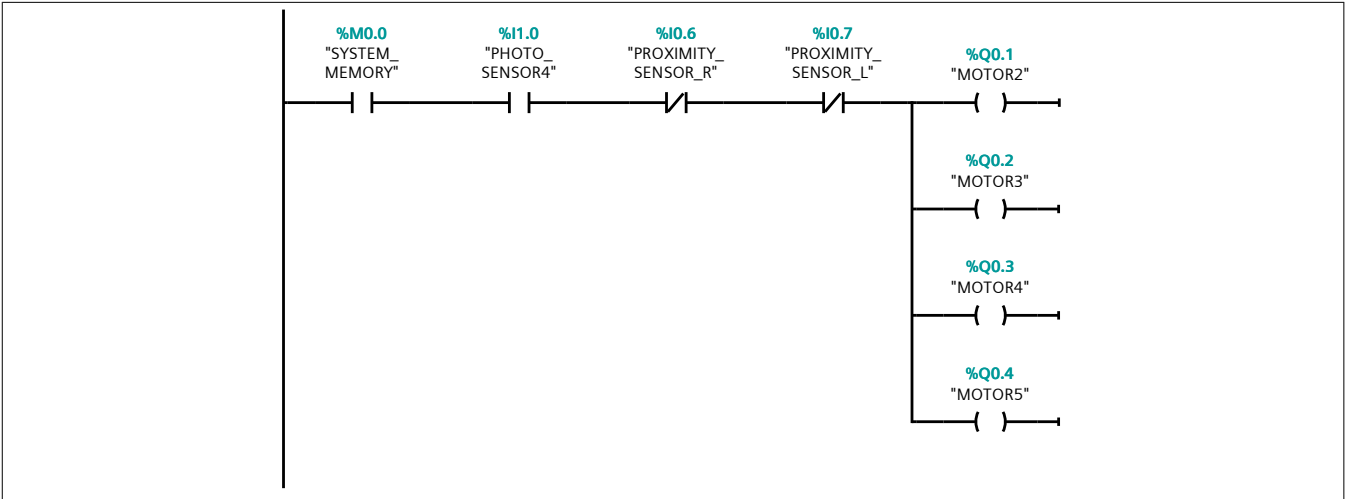


Network 3: GRABBER STATUS




Network 4: IF GRABBER ACTIVE, NOZZLE CYLINDER GOES DOWN UNTIL END.PUMP STARTSAND STOPS

AFTER LIQUID FILLING, NOZZLE WILL GO BACK TO HOME POSITION

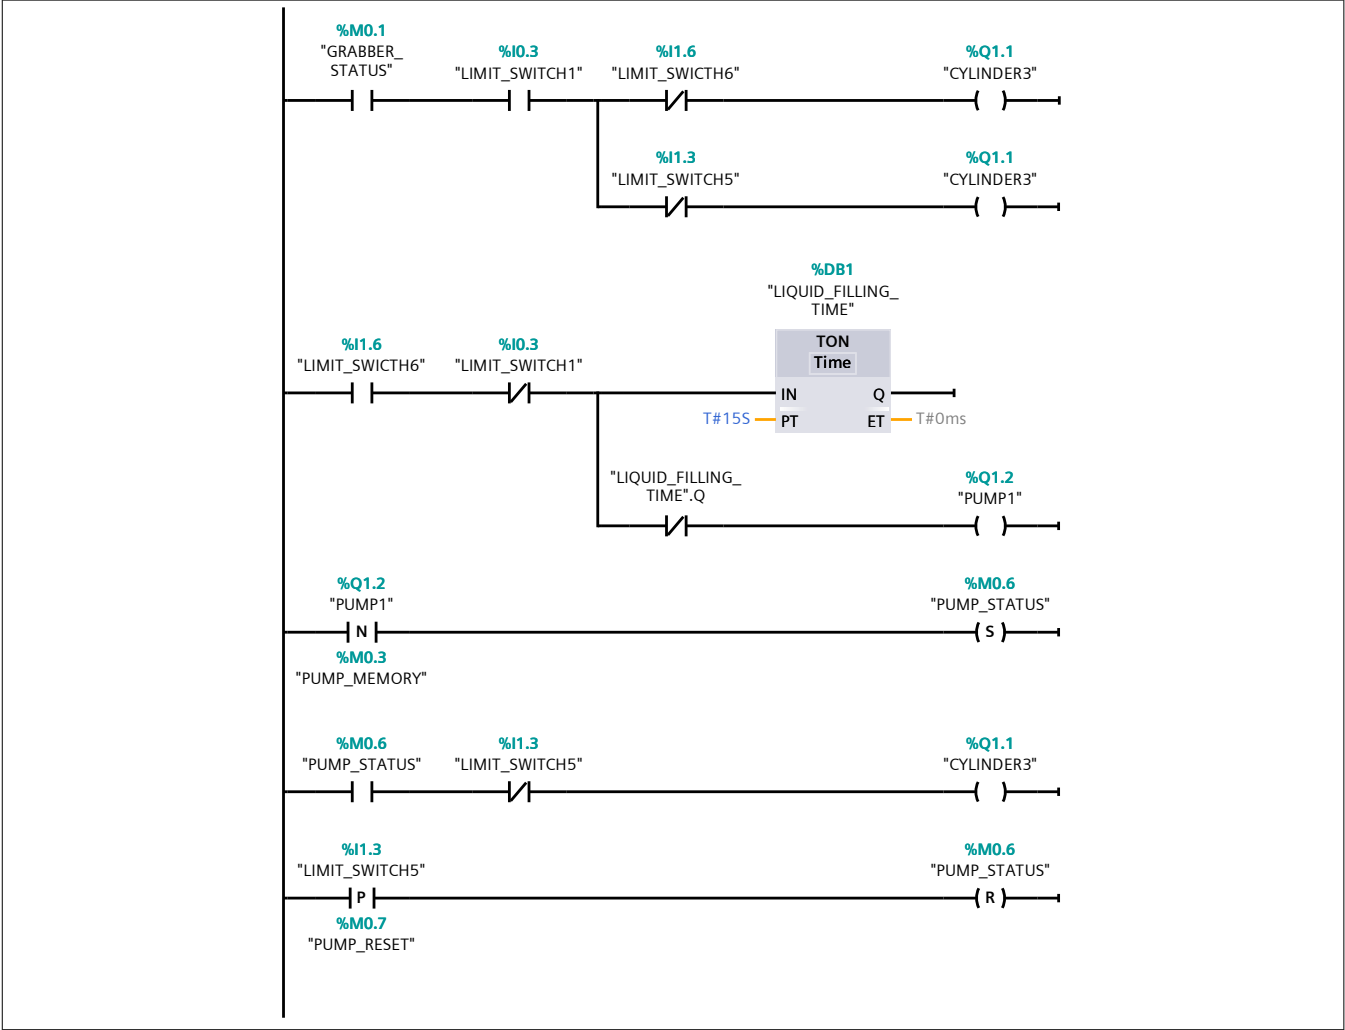


Network 5: NOZZLE FILLER STATUS

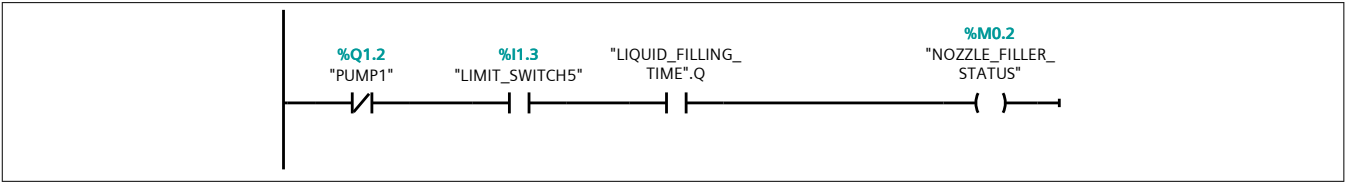


Network 6: CAP DISPENSER OPERATION

PHOTO SENSOR ACTIVATES MOTOR, DISPENSES ONE CAP AND TURN OFF MOTOR. SAME THING REPEATS EVERYTIME WITH S/R

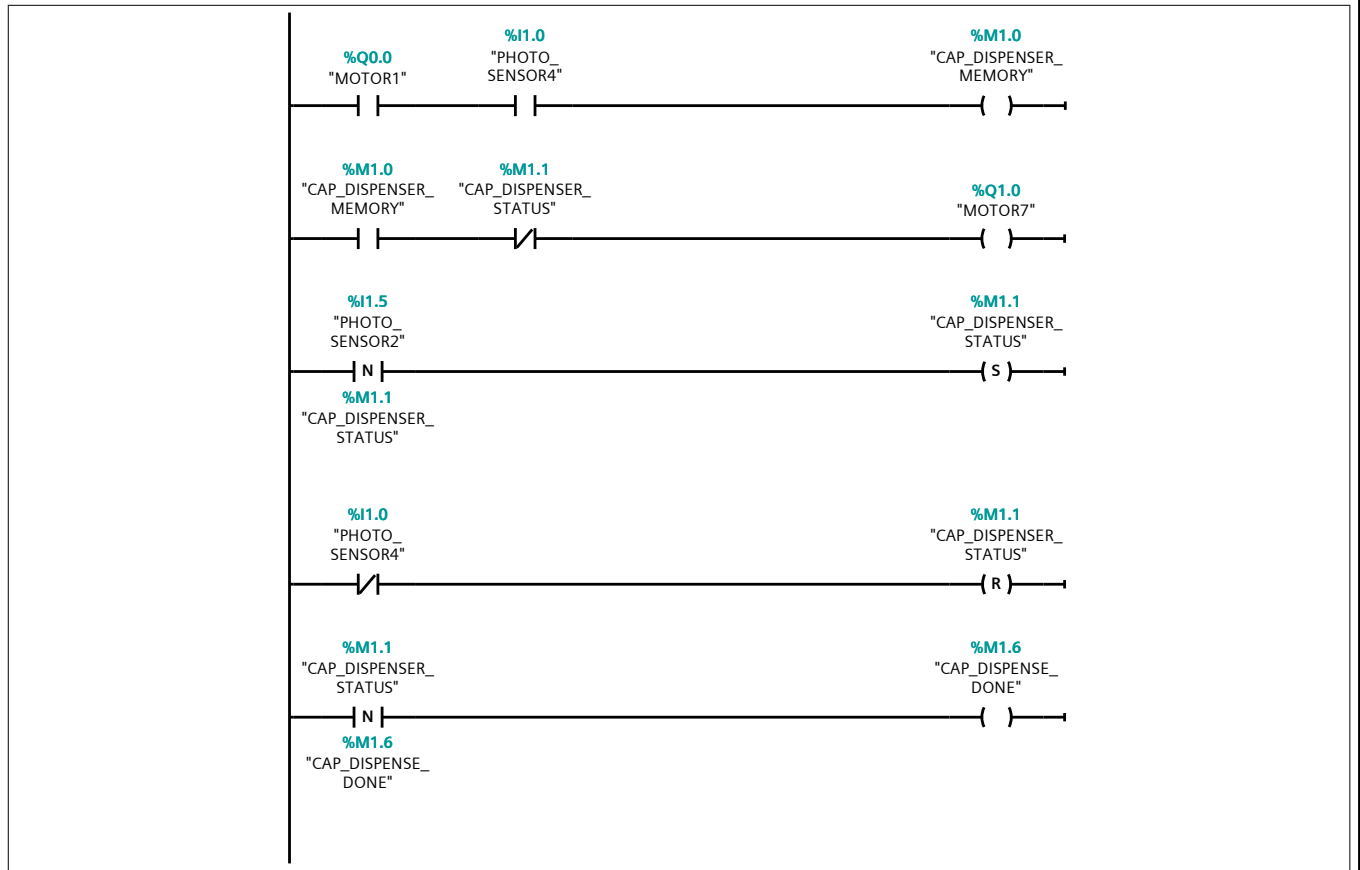

Network 7: CAPPING MECHANISM

CYLINDER PUSHES THE MOTOR DOWN. CAPPING FOR 10S. RETURN TO HOME POSITION.REPEAT.

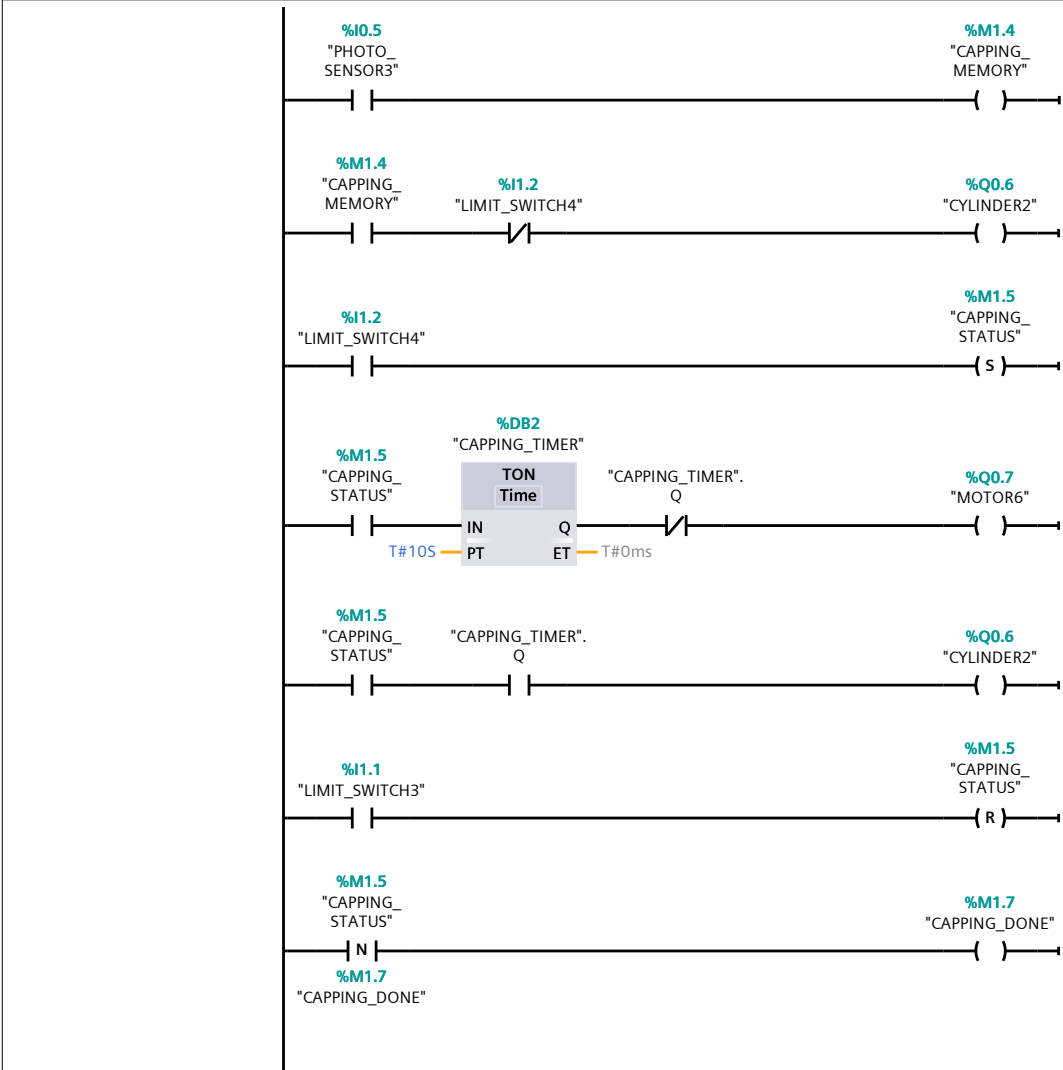

Network 8: ACTIVE STATUS WILL START MOTOR 1 UNTIL IT REACHES END

