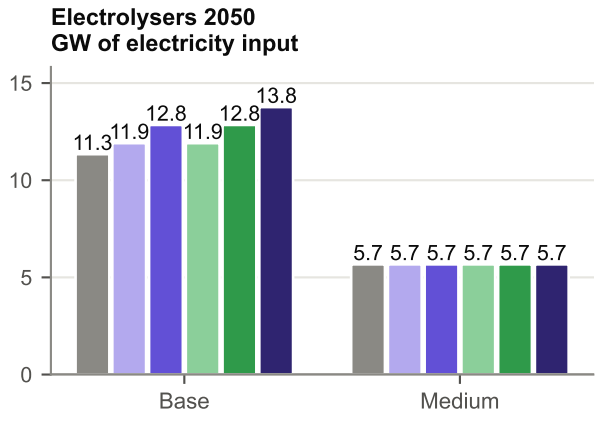


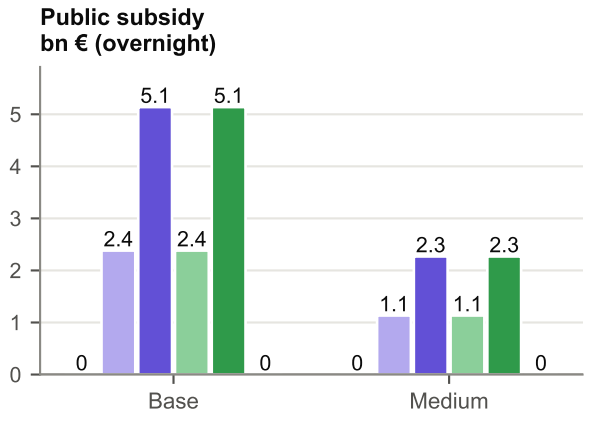


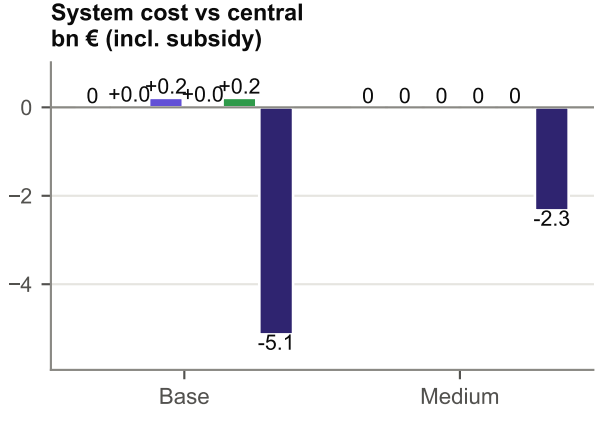


**Electrolysis share, 2050:**
Base: 84% → 86-89%
Medium: 43% in every run

A subsidy is a transfer: the system cost counts it back in.

**Value of 1 kW more electrolyser**
in Medium (€/kW of $H_2$, present value):

- central 985
- subsidy 20% 1,159
- subsidy 40% 1,333
- infrastructure subsidy 20% 1,159
- infrastructure subsidy 40% 1,333
- low CAPEX 1,572

central subsidy 20% subsidy 40% infrastructure subsidy 20% infrastructure subsidy 40% low electrolyser CAPEX