Caution

Unit ID: **342.BE050 R** Asset ID: **51526793**

Description: **Bucket Elevator GB - R**

Account Information

ID: **208948**

Name: **Reliance Heavy Industries**

Address: **Kattameya-Sokhna Road, Suez, 00000 EG**

Sample Information

Sample ID: **26124405276**

Service Level: **Enhanced**

Bottle ID: **b108137746**

Tested Lubricant: **MOBIL SHC 632**

Equipment Information

Asset Class: **Gear Drive**

Manufacturer: **FLENDER**

Model: **N/A**

Lubricant: **MOBIL SHC 632**

Sample Data & Trends

Sample Info	Report Status	Alert	Alert	Caution	Caution	Caution
	Sample ID	25107174214	25180296225	25258159233	25295220231	26124405276
	Service Level	Enhanced	Enhanced	Enhanced	Enhanced	Enhanced
	Bottle ID	b098244840	b098249818	b098287771	b098287664	b108137746
	Tested Lubricant	MOBIL SHC 632	MOBIL SHC 632	MOBIL SHC 632	MOBIL SHC 632	MOBIL SHC 632
	Sampled	10 Apr 2025	18 Jun 2025	09 Sep 2025	16 Oct 2025	26 Apr 2026
	Reported	17 Apr 2025	01 Jul 2025	17 Sep 2025	23 Oct 2025	05 May 2026
	Equipment Age					
	Oil Age					
	Make-up Volume					
	Oil Changed					
	Filter Changed					
Lubricant	Contamination Rating	Alert	Alert	Caution	Caution	Caution
	Equipment Rating	Caution	Caution	Normal	Normal	Normal
	Lubricant Rating	Caution	Caution	Caution	Caution	Caution
	ISO Code (4/6/14)					
	Particle Count >4um					
	Particle Count >6um					
	Particle Count>14um					
	PQ Index	49	83	16	18	20
	Visc@40C (cSt)	316.0	318.7	282.6	289.5	287.7
	TAN (mg KOH/g)	1.50	1.90	1.70	1.60	1.50
	Water (Vol%)	0.600	0.500	0.050	0.080	0.050
Wear (ppm)	Ag (Silver)	0	0	0	0	0
	Al (Aluminum)	1	1	13	0	0
	Cr (Chromium)	0	0	1	0	0
	Cu (Copper)	0	0	2	0	0
	Fe (Iron)	222	206	39	4	10
	Mo (Molybdenum)	0	2	0	0	0
	Ni (Nickel)	0	0	0	0	0
	Pb (Lead)	0	1	1	0	0
	Sn (Tin)	0	0	0	0	0
Contaminant (ppm)	K (Potassium)	0	0	2	0	0
	Na (Sodium)	0	2	0	0	0
	Si (Silicon)	17	7	2	0	0
Additive (ppm)	B (Boron)	0	41	14	14	27
	Ba (Barium)	0	0	0	0	0
	Ca (Calcium)	49	62	48	2	38
	Mg (Magnesium)	7	7	5	2	0
	P (Phosphorus)	379	380	454	525	443
	Zn (Zinc)	99	90	34	46	69

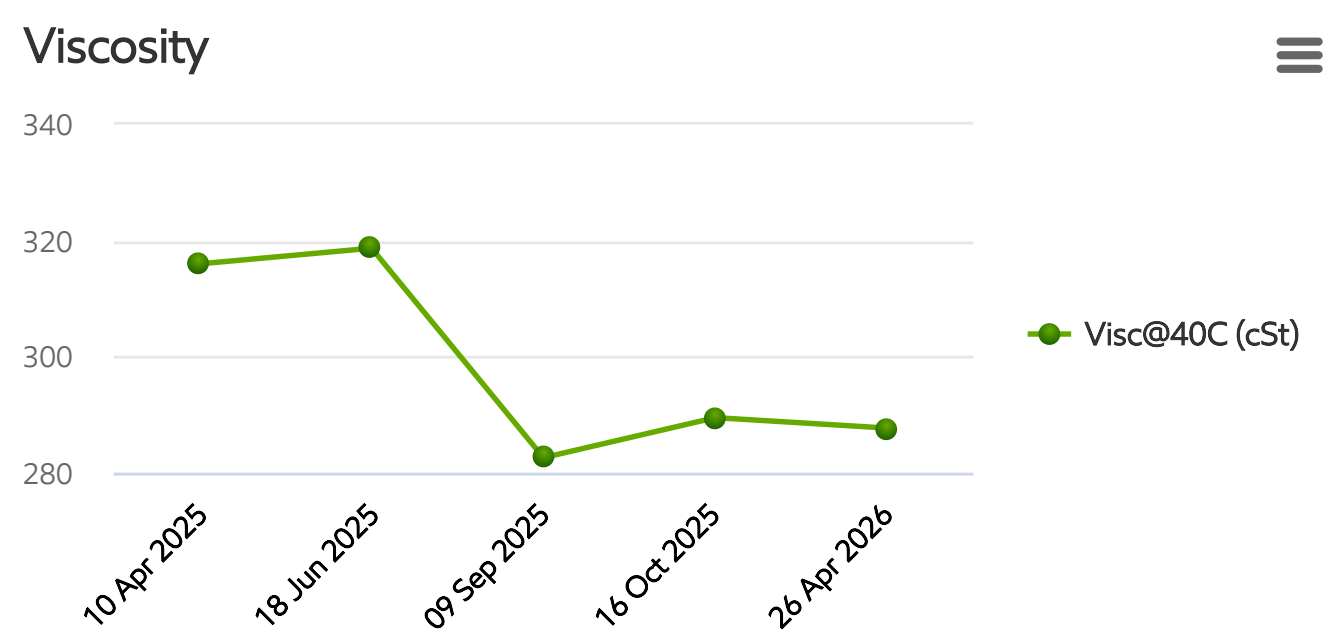

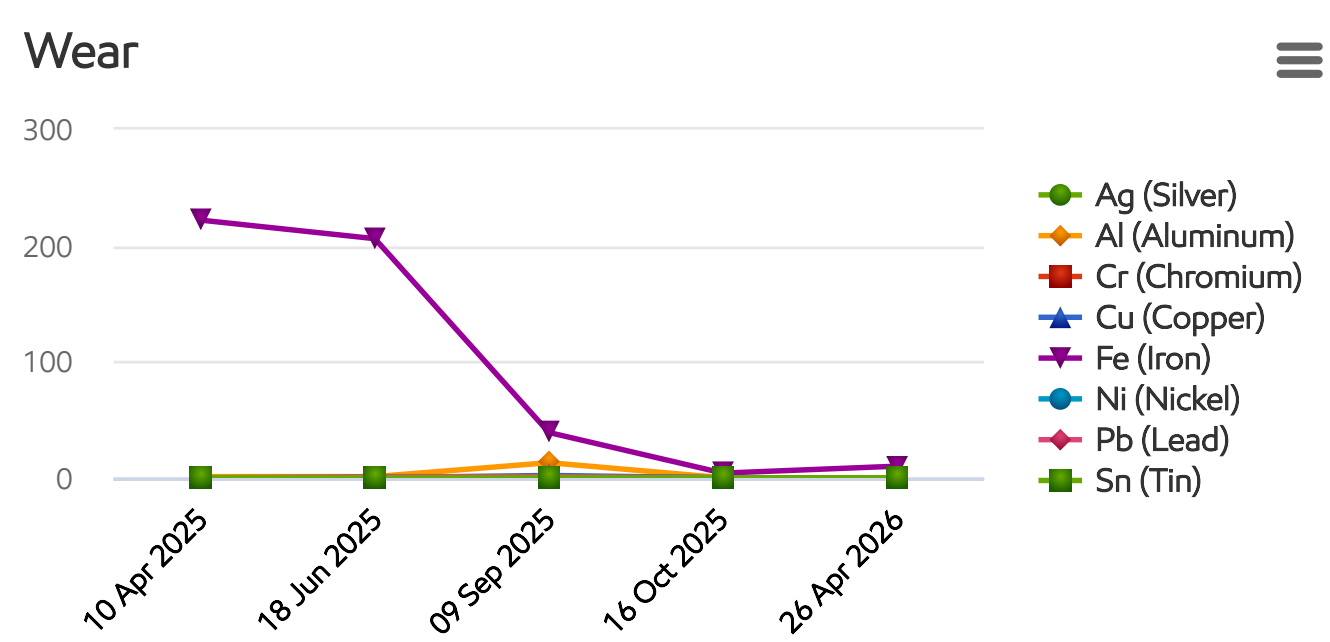

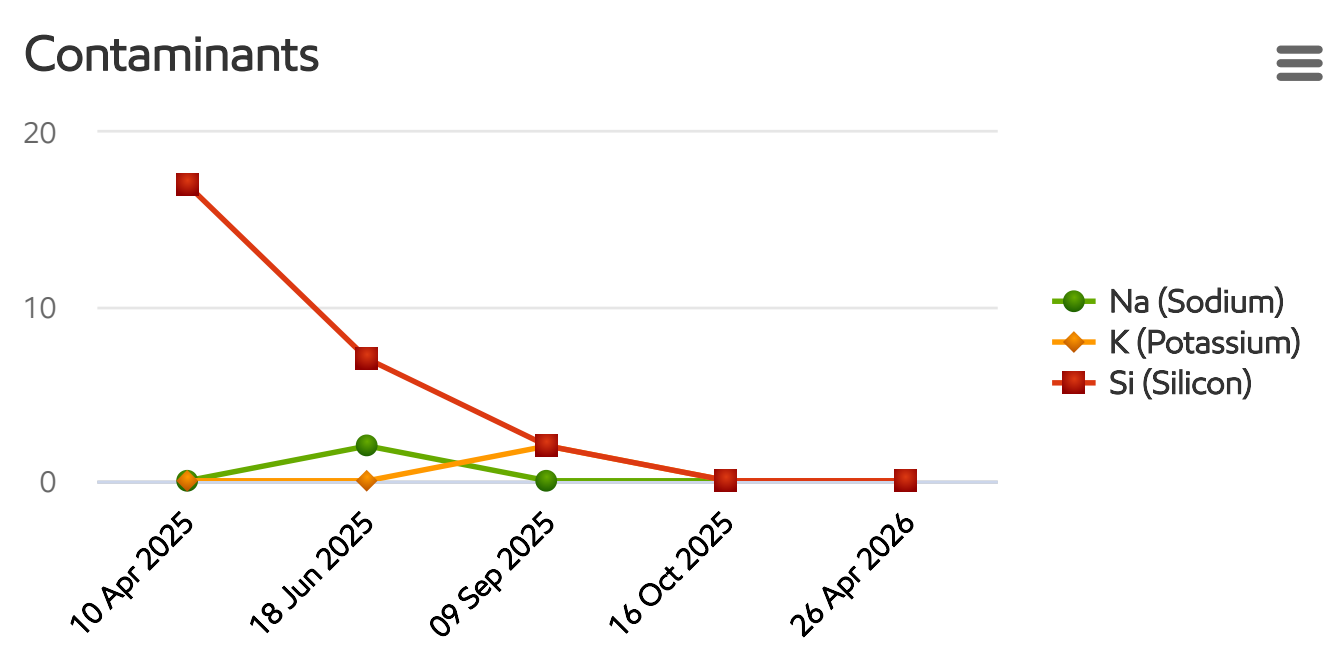

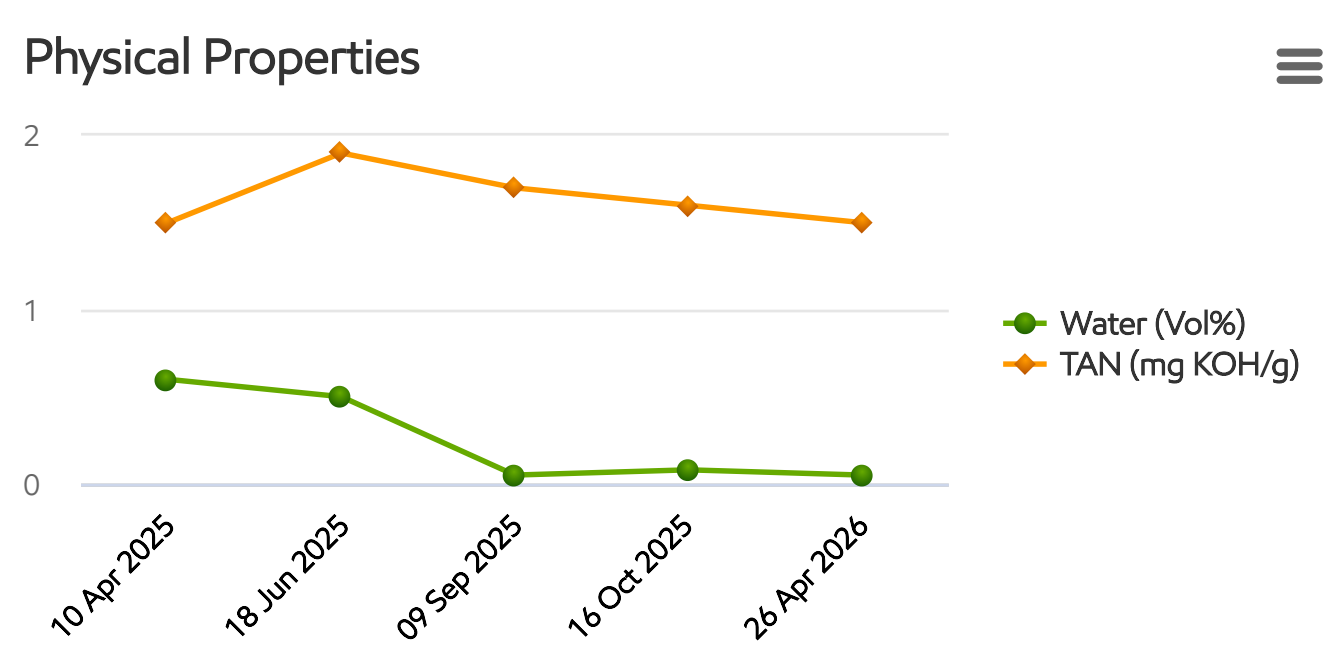

Mobil™

Caution

Unit ID: **342.BE050 R** Asset ID: **51526793**

Description: **Bucket Elevator GB - R**

Account Information	Sample Information	Equipment Information
ID: **208948**	Sample ID: **26124405276**	Asset Class: **Gear Drive**
Name: **Reliance Heavy Industries**	Service Level: **Enhanced**	Manufacturer: **FLENDER**
Address: **Kattameya-Sokhna Road, Suez, 00000 EG**	Bottle ID: **b108137746**	Model: **N/A**
	Tested Lubricant: **MOBIL SHC 632**	Lubricant: **MOBIL SHC 632**

Recommendation/Comments

ACTION REQUIRED - EXCESSIVE WATER CONTAMINATION. Determine source of water and take corrective action. Analyze the oil with an on-site water test if accessible. Potential sources of water include: a. Leaking seals; b. Condensation resulting from low operating temperatures or prolonged shutdowns; c. Compromised oil cooler; d. Direct exposure to atmosphere as a result of compromises to system components (i.e. improperly sealed tank fill access point. Remove water from oil using centrifuges or dehydration units, or drain the oil and recharge the system with new oil. Resample the system after corrective measures have been implemented. Contact your ExxonMobil representative for further assistance if necessary.

ACTION REQUIRED - ELEVATED TAN. The Total Acid Number (TAN) of the sampled oil is above the Original Equipment Manufacturer (OEM) limits for this grade. Determine cause of elevated TAN and take corrective action. If the TAN is elevated for the first time with no history of an increasing trend, then resample immediately to confirm condition. Possible causes of an elevated TAN include: a. High oil temperature; b. Localized hot spots; c. Over-extended oil service life; d. Contamination with an oil that has a higher TAN; e. High rates of oxidation and nitration resulting in the formation of organic and inorganic acids. Contact your ExxonMobil representative for further assistance if necessary.

ADMINISTRATION - PARTICLE COUNT DATA NOT REPORTED. The sample is heavily contaminated with visible sediment. Oil samples that contain significant levels of any contaminant can damage the laboratory's precision equipment. As a result, the particle count test was not completed, and analysis could not be provided. Before sending future samples to the laboratory, please ensure that no signs of visible sediment contamination are present. Consider the following: 1. The sample may not be representative of the system if it was acquired from a non-turbulent area (i.e. tank bottom); 2. Installing sample ports helps ensure that the sample is taken from the same location every time; 3. Tank fill caps and breathers might not be properly secured; 4. The filter / centrifuge may be operating incorrectly. If the sample was representative of the system, change the oil immediately to prevent equipment damage. Contact your ExxonMobil representative for further assistance if necessary.

Sample Timeline

- 26 Apr 2026 11:44 AM - Hassan Mostafa - In Service Oil Sample : Comments: Photo: