


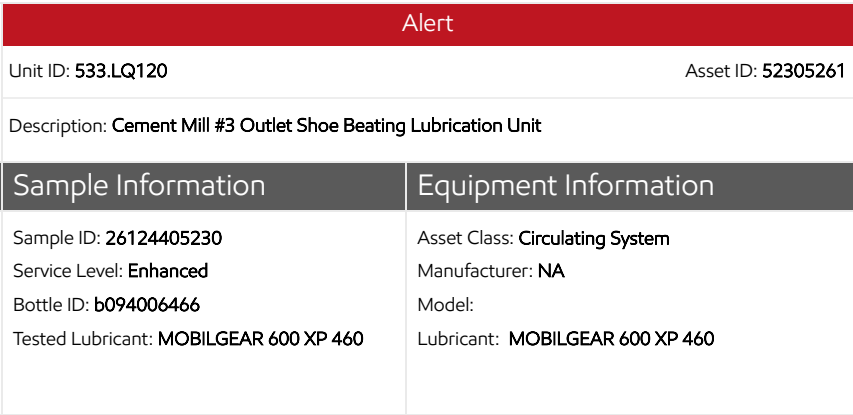
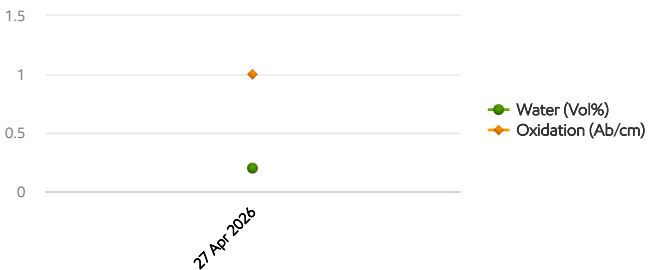


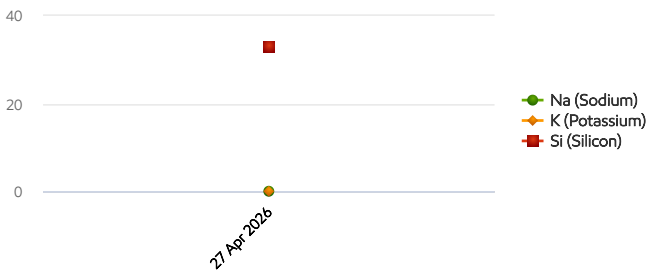

Account Information	Sample Information	Equipment Information
ID: 462031 Name: ASEC - ACC Address: , , EG	Sample ID: 26124405230 Service Level: Enhanced Bottle ID: b094006466 Tested Lubricant: MOBILGEAR 600 XP 460	Asset Class: Circulating System Manufacturer: NA Model: Lubricant: MOBILGEAR 600 XP 460

Sample Info	Report Status	Alert
	Sample ID	26124405230
	Service Level	Enhanced
	Bottle ID	b094006466
	Tested Lubricant	MOBILGEAR 600 XP 460
	Sampled	27 Apr 2026
	Reported	05 May 2026
	Equipment Age	
	Oil Age	
	Make-up Volume	
	Oil Changed	
	Filter Changed	
	Lubricant	Contamination Rating
Equipment Rating		Normal
Lubricant Rating		Normal
ISO Code (4/6/14)		
Particle Count >4um		
Particle Count >6um		
Particle Count>14um		
PQ Index		41
Visc@40C (cSt)		442.6
Oxidation (Ab/cm)		1
Water (Vol%)		0.200
Wear (ppm)	Ag (Silver)	0
	Al (Aluminum)	4
	Cr (Chromium)	0
	Cu (Copper)	18
	Fe (Iron)	29
	Mo (Molybdenum)	0
	Ni (Nickel)	0
	Pb (Lead)	2
	Sn (Tin)	0
Contaminant (ppm)	K (Potassium)	0
	Na (Sodium)	0
	Si (Silicon)	33
Additive (ppm)	B (Boron)	16
	Ba (Barium)	0
	Ca (Calcium)	125
	Mg (Magnesium)	2
	P (Phosphorus)	385
	Zn (Zinc)	5

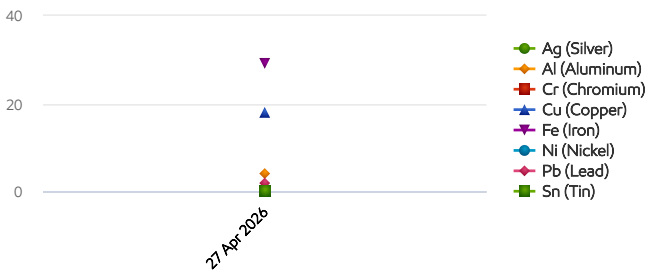

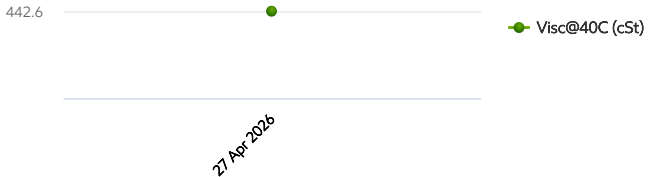

Alert

Unit ID: 533.LQ120

Asset ID: 52305261

Description: Cement Mill #3 Outlet Shoe Beating Lubrication Unit

Account Information

ID: 462031
Name: ASEC - ACC
Address: , , EG

Sample Information

Sample ID: 26124405230
Service Level: Enhanced
Bottle ID: b094006466
Tested Lubricant: MOBILGEAR 600 XP 460

Equipment Information

Asset Class: Circulating System
Manufacturer: NA
Model:
Lubricant: MOBILGEAR 600 XP 460

Recommendation/Comments

ACTION REQUIRED - ELEVATED SILICON LEVEL. Determine source of Silicon (Si) and take corrective action. If the silicon level is elevated for the first time with no history of an increasing trend, then resample immediately to confirm condition. If the wear metals levels are low, then the silicon likely exists in a non-abrasive form. Possible sources of non-abrasive silicon include: a. Defoamants; b. Sealant compounds. If wear metals levels are elevated, then the silicon likely exists in an abrasive form. Possible sources of abrasive silicon include: a. Abrasive dirt; b. Contamination from environment during an equipment overhaul or shutdown. Other possible sources of silicon include: a. Inefficient or leaking air intake filters; b. Leaking pipes; c. Clogged oil bath air filter; d. Poor oil filtration; e. Dirty sample containers or improper sampling procedures. In landfill gas applications, silicon can enter the engine as a siloxane. This material is a gas and is not normally abrasive; however, siloxanes can easily mask the presence dirt. The oil may be unfit for continued use and should be monitored closely for further condition regressions. Prolonged usage of lubricants with elevated levels of abrasive silicon can cause severe wear and damage to the equipment. Inspect the equipment for signs of excessive wear and change the oil immediately if damage is detected. Contact your ExxonMobil representative for further assistance if necessary.

ACTION REQUIRED - EXCESSIVE WATER CONTAMINATION. Determine source of water and take corrective action. Analyze the oil with an on-site water test if accessible. Potential sources of water include: a. Leaking seals; b. Condensation resulting from low operating temperatures or prolonged shutdowns; c. Compromised oil cooler; d. Direct exposure to atmosphere as a result of compromises to system components (i.e. improperly sealed tank fill access point. Remove water from oil using centrifuges or dehydration units, or drain the oil and recharge the system with new oil. Resample the system after corrective measures have been implemented. Contact your ExxonMobil representative for further assistance if necessary.

ACTION REQUIRED - UNSATISFACTORY OIL CONDITION. Test results indicate that the condition of this oil sample is unsatisfactory. The oil may be unfit for continued use and should be closely monitored further condition regressions. Contact your ExxonMobil representative for further assistance if necessary.

ADMINISTRATION - PARTICLE COUNT DATA NOT REPORTED. The sample is heavily contaminated with visible sediment. Oil samples that contain significant levels of any contaminant can damage the laboratory's precision equipment. As a result, the particle count test was not completed, and analysis could not be provided. Before sending future samples to the laboratory, please ensure that no signs of visible sediment contamination are present. Consider the following: 1. The sample may not be representative of the system if it was acquired from a non-turbulent area (i.e. tank bottom); 2. Installing sample ports helps ensure that the sample is taken from the same location every time; 3. Tank fill caps and breathers might not be properly secured; 4. The filter / centrifuge may be operating incorrectly. If the sample was representative of the system, change the oil immediately to prevent equipment damage. Contact your ExxonMobil representative for further assistance if necessary.

Sample Timeline

- 27 Apr 2026 1:02 PM - Abd El Rahman Khaled - In Service Oil Sample: Comments: Photo: