

4' LEACHING GALLEY FOR SUFFOLK & NASSAU COUNTY


ASTRO MASONRY©2025-26 | ALL RIGHTS RESERVED

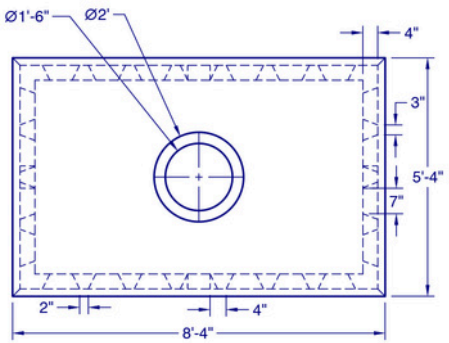


TOP VIEW (1:25)

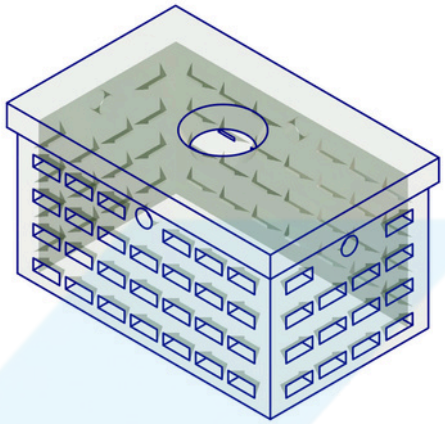


ISOMETRIC VIEW (1:25)

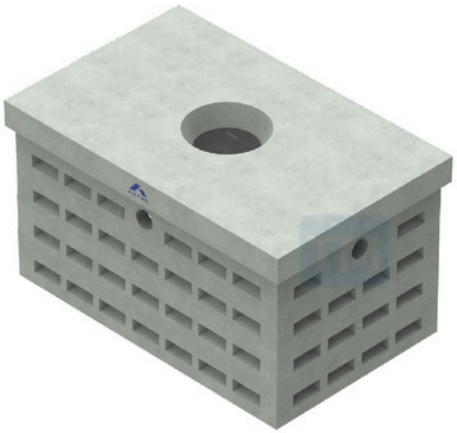


3D RENDER

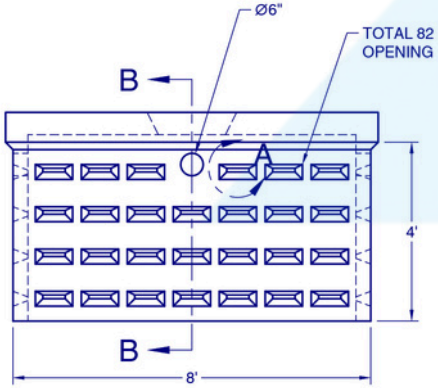

PLAN VIEW (1:25)



DETAIL A
SCALE 1" = 1'-0"

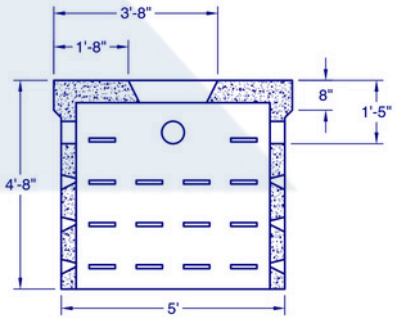

SECTION B-B
SCALE 1:25

ADDITIONAL NOTES:

REINFORCEMENT: WWF 6" × 12" - 6&8,
W2.0 × W2.0 (ASTM A1064) GRADE 60 ASTM A-185-02
MESH CENTERED WITH 1.5"MIN COVER

PRODUCT NO.	AR 4 LG
DESCRIPTION	4' LEACHING GALLEY
STANDARD	SUFFOLK & NASSAU COUNTY
THICKNESS	4"
SIZES	HEIGHT - 4'
	WIDTH - 5'4"
	LENGTH - 8'4"
OPENINGS	NO. OF OPENING - 84
	SIZE - 10"/4"
WEIGHT	5500 LBS
LOAD RATING	A.A.S.H.T.O. HS20-44
TESTING BY	ALL ISLAND TESTING
ENGINEERING BY	FIONA S.

ENGINEERS APPROVAL SPACE

SPECIFICATIONS

1. CONCRETE TO HAVE A MINIMUM 28 DAY
2. COMPRESSIVE STRENGTH OF 4000 PSI.
3. REINFORCING STEEL TO COMPLY WITH ASTM A-615 GRADE 60 ASTM A-185-02
4. DRAWING SCALE 1:25
5. ALL DIMENSIONS ARE IN INCHES
6. TOLERANCE X ± 0.5"
7. CONFORMS TO LOCAL STANDARDS & SPECIFICATIONS AS APPLICABLE
8. INSTALLING INSTRUCTIONS AVAILABLE SEPERATELY

PROPRIETARY & CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DOCUMENTS IS THE SOLE PROPERTY OF ASTRO MASONRY. ANY REPRODUCTION, MANUFACTURING, DISCLOSURE IN PART OR AS A WHOLE WITHOUT THE WRITTEN CONSENT OF IS PROHIBITED.


COMPANY ADDRESS


928, LONG ISLAND AVENUE
DEER PARK, NY 11729
☎ 631-667-3300
www.astromasonry.com

ASTRO

ASTRO™

PRECAST CONCRETE LOW DOMES

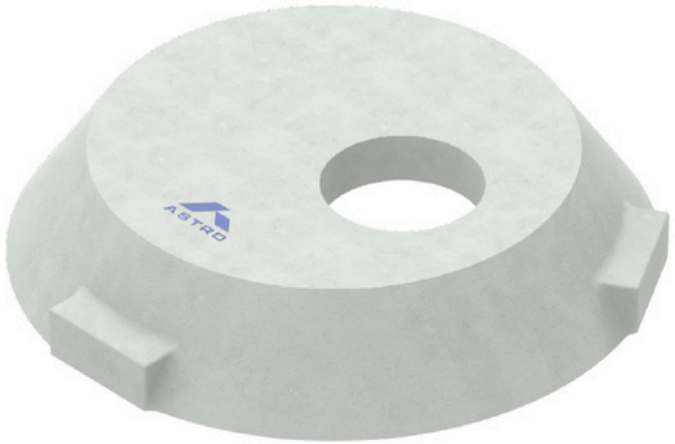

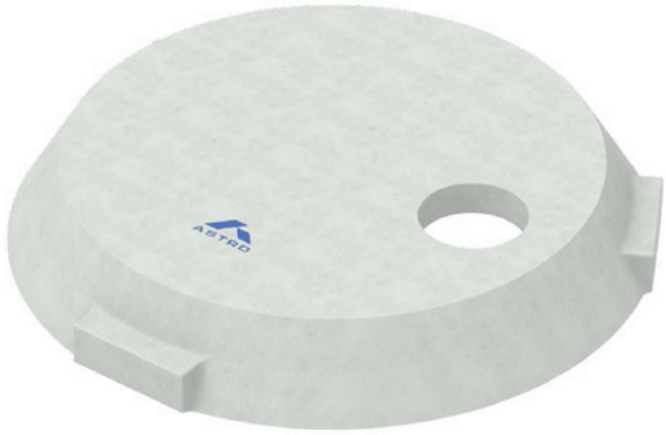

LOW DOMES

6' LOW DOME


8' LOW DOME

10' LOW DOME


12' LOW DOME

6' CONCRETE LOW DOME


ASTRO MASONRY©2025-26 I ALL RIGHTS RESERVED

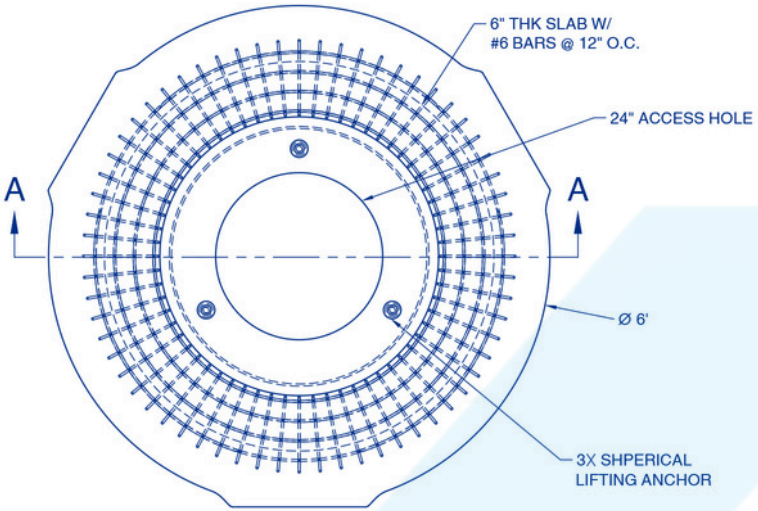


TOP VIEW 1:14

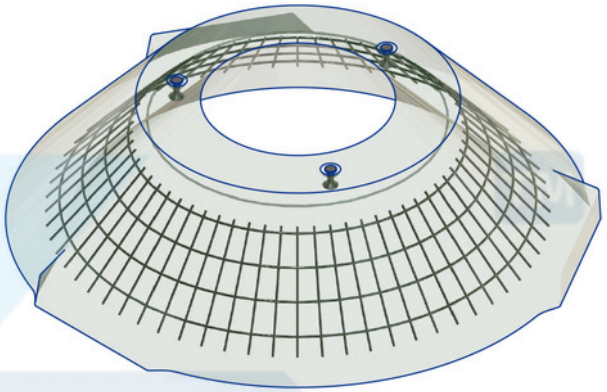

ISOMETRIC VIEW 1:12

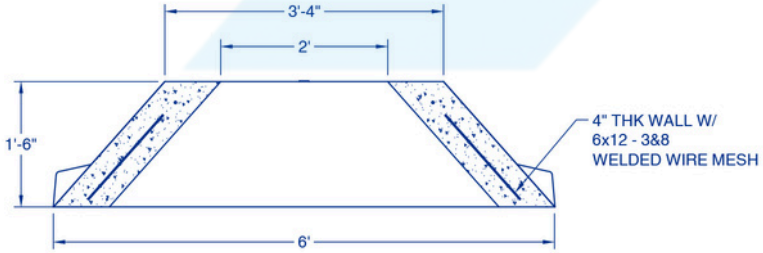

SECTION A-A
SCALE 1:14

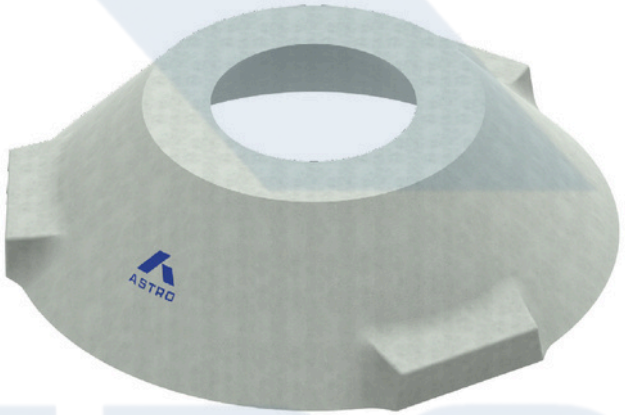

3D RENDER
REFERANCE ONLY

PRODUCT NO.	AR 6 LD
DESCRIPTION	6' LOW DOME
STANDARD	SUFFOLK & NASSAU COUNTY
HEIGHT	18"
SLAB DIAMETER	6'
ACCESS OPENING	24" DIA STANDARD
THICKNESS	TOP SLAB - 6"
	SIDE WALL- 4"
WEIGHT	6400 LBS
LOAD RATING	A.A.S.H.T.O. HS20-44
TESTING BY	ALL ISLAND TESTING
ENGINEERING BY	FIONA S.

ENGINEERS APPROVAL SPACE

SPECIFICATIONS

1. CONCRETE TO HAVE A MINIMUM 28 DAY
2. COMPRESSIVE STRENGTH OF 4000 PSI.
3. REINFORCING STEEL TO COMPLY WITH ASTM A-615 GRADE 60 ASTM A-185-02
4. DRAWING SCALE 1:14
5. ALL DIMENSIONS ARE IN INCHES
6. TOLERANCE X ± 0.5"
7. CONFORMS TO LOCAL STANDARDS & SPECIFICATIONS AS APPLICABLE
8. INSTALLING INSTRUCTIONS AVAILABLE SEPERATELY

PROPRIETARY & CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DOCUMENTS IS THE SOLE PROPERTY OF ASTRO MASONRY. ANY REPRODUCTION, MANUFACTURING, DISCLOSURE IN PART OR AS A WHOLE WITHOUT THE WRITTEN CONSENT OF IS PROHIBITED.

COMPANY ADDRESS

928, LONG ISLAND AVENUE
DEER PARK, NY 11729
☎ 631-667-3300
www.astromasonry.com

ASTRO


ADDITIONAL NOTES:

3 SHPERICAL LIFTING ANCHORS WITH SWL OF 1500 LBS


REINFORCEMENT: WWF 6" × 12" - 6&8, W2.0 × W2.0 (ASTM A1064)
MESH CENTERED IN 6" TOP SLAB AND 4" SIDE WALL WITH 1.5" MIN COVER.

8' CONCRETE LOW DOME


ASTRO MASONRY©2025-26 I ALL RIGHTS RESERVED

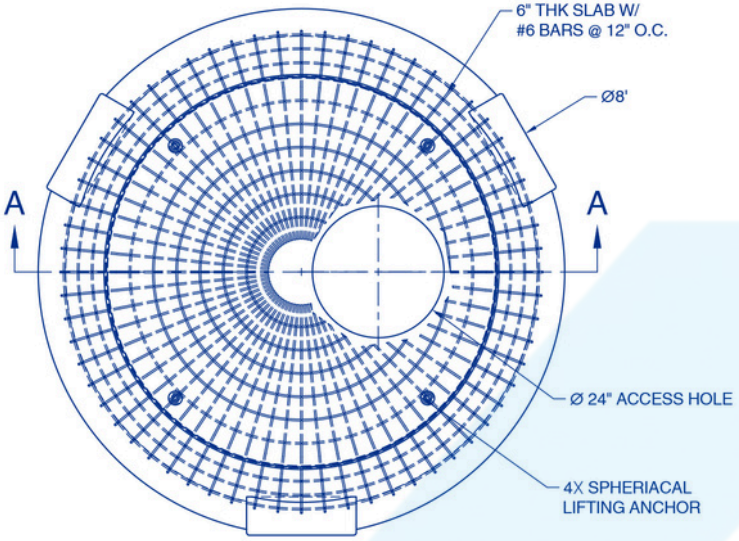


TOP VIEW 1:18

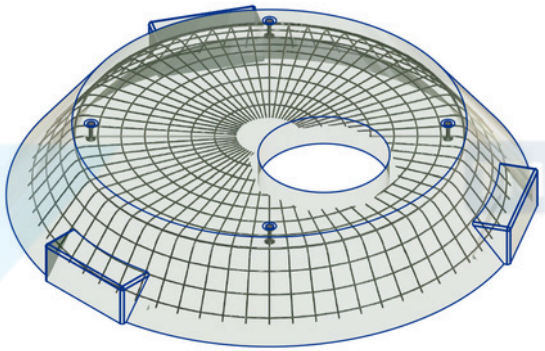

ISOMETRIC VIEW 1:18

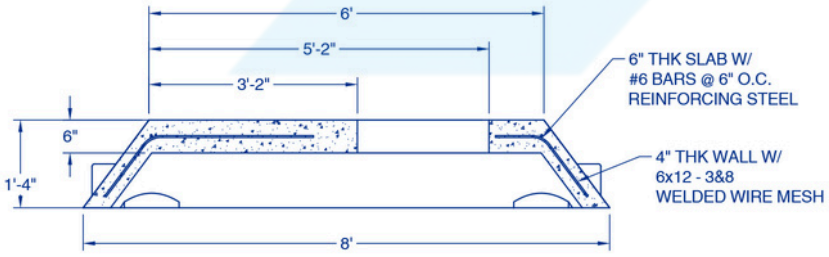

SECTION A-A
SCALE 1:18

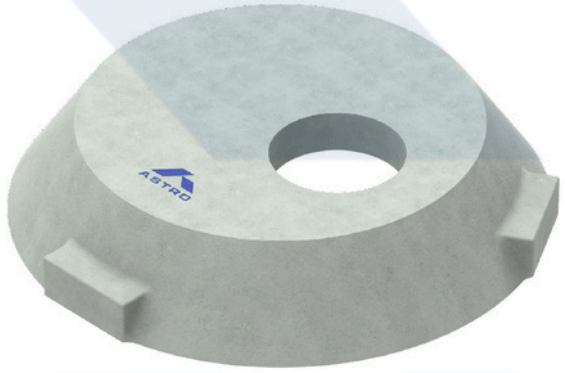

3D RENDER
REFERENCE ONLY

PRODUCT NO.	AR 8 LD
DESCRIPTION	8' LOW DOME
STANDARD	SUFFOLK & NASSAU COUNTY
HEIGHT	18"
SLAB DIAMETER	8'
ACCESS OPENING	24" DIA STANDARD
THICKNESS	TOP SLAB - 6"
	SIDE WALL - 4"
WEIGHT	7200 LBS
LOAD RATING	A.A.S.H.T.O. HS20-44
TESTING BY	ALL ISLAND TESTING
ENGINEERING BY	FIONA S.

ENGINEERS APPROVAL SPACE

SPECIFICATIONS

1. CONCRETE TO HAVE A MINIMUM 28 DAY
2. COMPRESSIVE STRENGTH OF 4000 PSI.
3. REINFORCING STEEL TO COMPLY WITH ASTM A-615 GRADE 60 ASTM A-185-02
4. DRAWING SCALE 1:25
5. ALL DIMENSIONS ARE IN INCHES
6. TOLERANCE X ± 0.5"
7. CONFORMS TO LOCAL STANDARDS & SPECIFICATIONS AS APPLICABLE
8. INSTALLING INSTRUCTIONS AVAILABLE SEPERATELY

PROPRIETARY & CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DOCUMENTS IS THE SOLE PROPERTY OF ASTRO MASONRY. ANY REPRODUCTION, MANUFACTURING, DISCLOSURE IN PART OR AS A WHOLE WITHOUT THE WRITTEN CONSENT OF IS PROHIBITED.

COMPANY ADDRESS

928, LONG ISLAND AVENUE
DEER PARK, NY 11729
☎ 631-667-3300
www.astromasonry.com

ASTRO


ADDITIONAL NOTES:

4 SHPERICAL LIFTING ANCHORS WITH SWL OF 1500 LBS


REINFORCEMENT: WWF 6" × 12" - 6&8, W2.0 × W2.0 (ASTM A1064)
MESH CENTERED IN 6" TOP SLAB AND 4" SIDE WALL WITH 1.5" MIN COVER.

10' CONCRETE LOW DOME


ASTRO MASONRY©2025-26 I ALL RIGHTS RESERVED

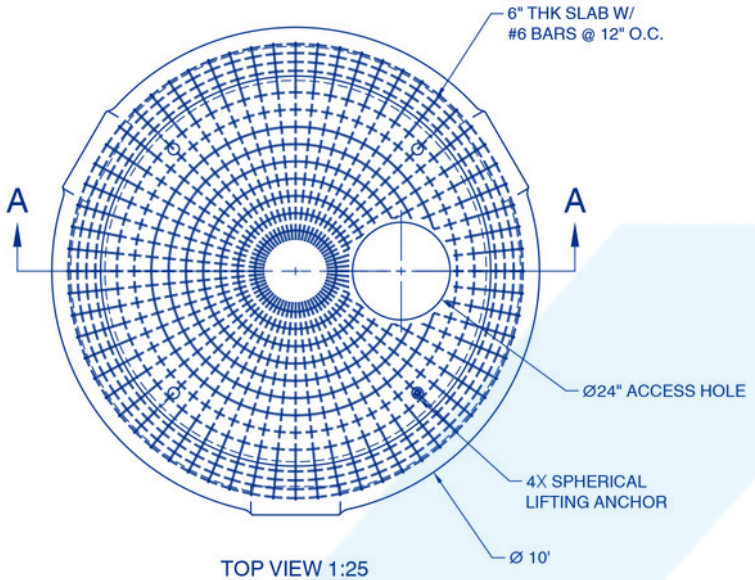


TOP VIEW 1:25

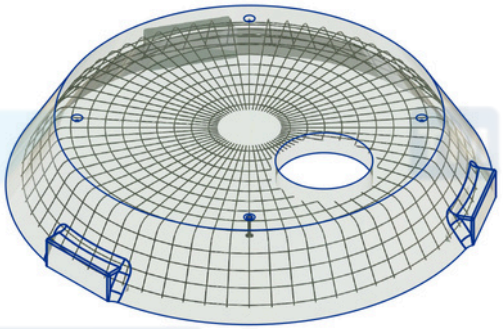

ISOMETRIC VIEW 1:25

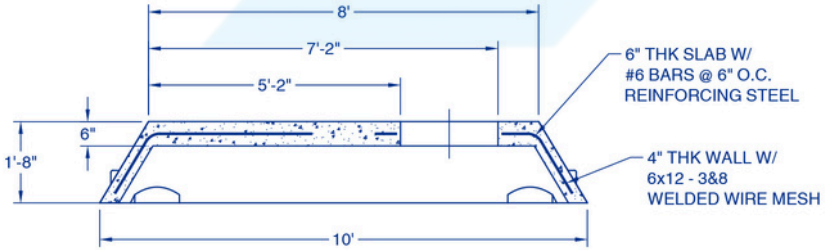

SECTION A-A
SCALE 1:25

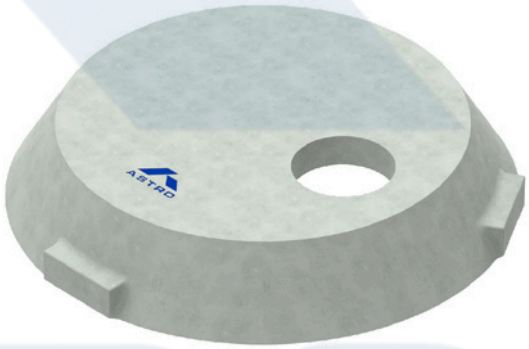

3D RENDER
REFERENCE ONLY

PRODUCT NO.	AR 10 LD
DESCRIPTION	10' LOW DOME
STANDARD	SUFFOLK & NASSAU COUNTY
HEIGHT	20"
SLAB DIAMETER	10'
ACCESS OPENING	24" DIA STANDARD
THICKNESS	TOP SLAB - 6"
	SIDE WALL - 4"
WEIGHT	8140 LBS.
LOAD RATING	A.A.S.H.T.O. HS20-44
TESTING BY	ALL ISLAND TESTING
ENGINEERING BY	FIONA S.

ENGINEERS APPROVAL SPACE

SPECIFICATIONS

1. CONCRETE TO HAVE A MINIMUM 28 DAY
2. COMPRESSIVE STRENGTH OF 4000 PSI.
3. REINFORCING STEEL TO COMPLY WITH ASTM A-615 GRADE 60 ASTM A-185-02
4. DRAWING SCALE 1:25
5. ALL DIMENSIONS ARE IN INCHES
6. TOLERANCE X ± 0.5"
7. CONFORMS TO LOCAL STANDARDS & SPECIFICATIONS AS APPLICABLE
8. INSTALLING INSTRUCTIONS AVAILABLE SEPERATELY

PROPRIETARY & CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DOCUMENTS IS THE SOLE PROPERTY OF ASTRO MASONRY. ANY REPRODUCTION, MANUFACTURING, DISCLOSURE IN PART OR AS A WHOLE WITHOUT THE WRITTEN CONSENT OF IS PROHIBITED.

COMPANY ADDRESS

928, LONG ISLAND AVENUE
DEER PARK, NY 11729
☎ 631-667-3300
www.astromasonry.com

ASTRO

ADDITIONAL NOTES:

4 SHPERICAL LIFTING ANCHORS WITH SWL OF 3000 LBS

REINFORCEMENT: WWF 6" × 12" - 6&8, W2.0 × W2.0 (ASTM A1064)
MESH CENTERED IN 6" TOP SLAB AND 4" SIDE WALL WITH 1.5" MIN COVER.