

\$127.16M

Total Electrical Cost (USD)

\$2.192M

Total Maintenance Cost (...)

\$129.35M

Combined OPEX (USD)


707.20

Total Lost Time (Hours)

99.28%


Average Uptime %

Total Maintenance Cost (USD) by Maintenance_Type

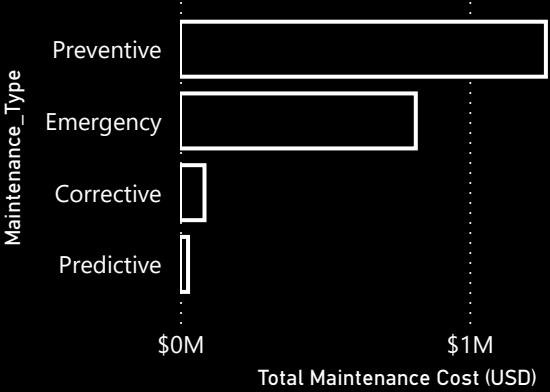

Average Health Index by DATE and Equipment_ID

Equipment_ID ● DEA-ALPHA ● DEA-BETA ● INJ-ALPHA ● INJ-BETA ● INJ-DELTA ● INJ-GAMMA ● ITK-ALPHA ● ITK-BETA ● ITK-DELTA ● ITK-EPSILON

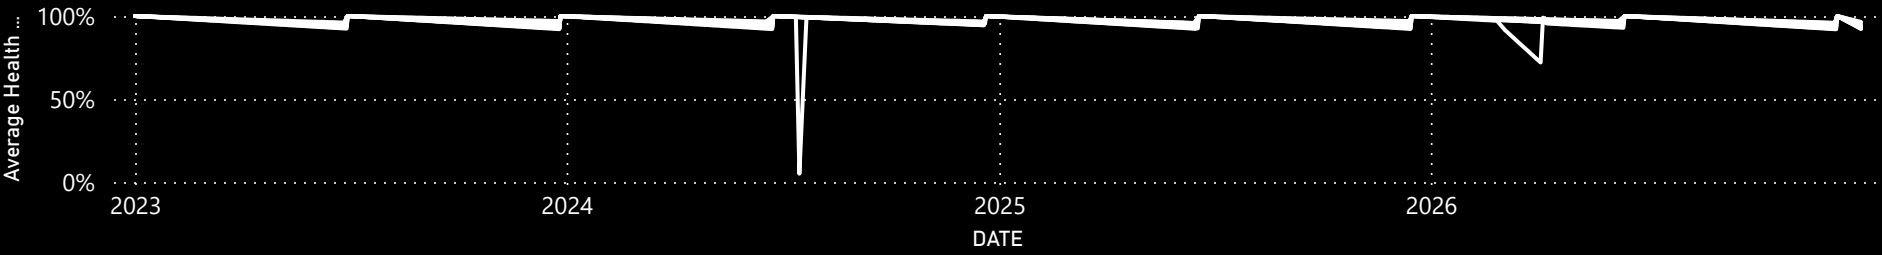

Date

1/1/2023

12/31/2026



Equipment_ID

☐ DEA-ALPHA

Day	Equipment_ID	Maintenance_Type	Trigger	Sum of Downtime_Hours	Fail
1	DEA-ALPHA	Preventive	Scheduled	3.00	
1	DEA-BETA	Preventive	Scheduled	4.50	
1	INJ-ALPHA	Preventive	Scheduled	2.70	
1	INJ-BETA	Preventive	Scheduled	4.70	
1	INJ-DELTA	Preventive	Scheduled	3.80	
1	INJ-GAMMA	Preventive	Scheduled	2.00	
Total				707.20	

Equipment_ID	Average of Health Index	Risk	Predicted_Failure
DEA-ALPHA	96.39	Low	
DEA-BETA	96.39	Low	
INJ-ALPHA	97.11	Low	
INJ-BETA	23.53	Critical	
INJ-BETA	60.00	High	
INJ-BETA	67.28	Low	
Total	97.09		