


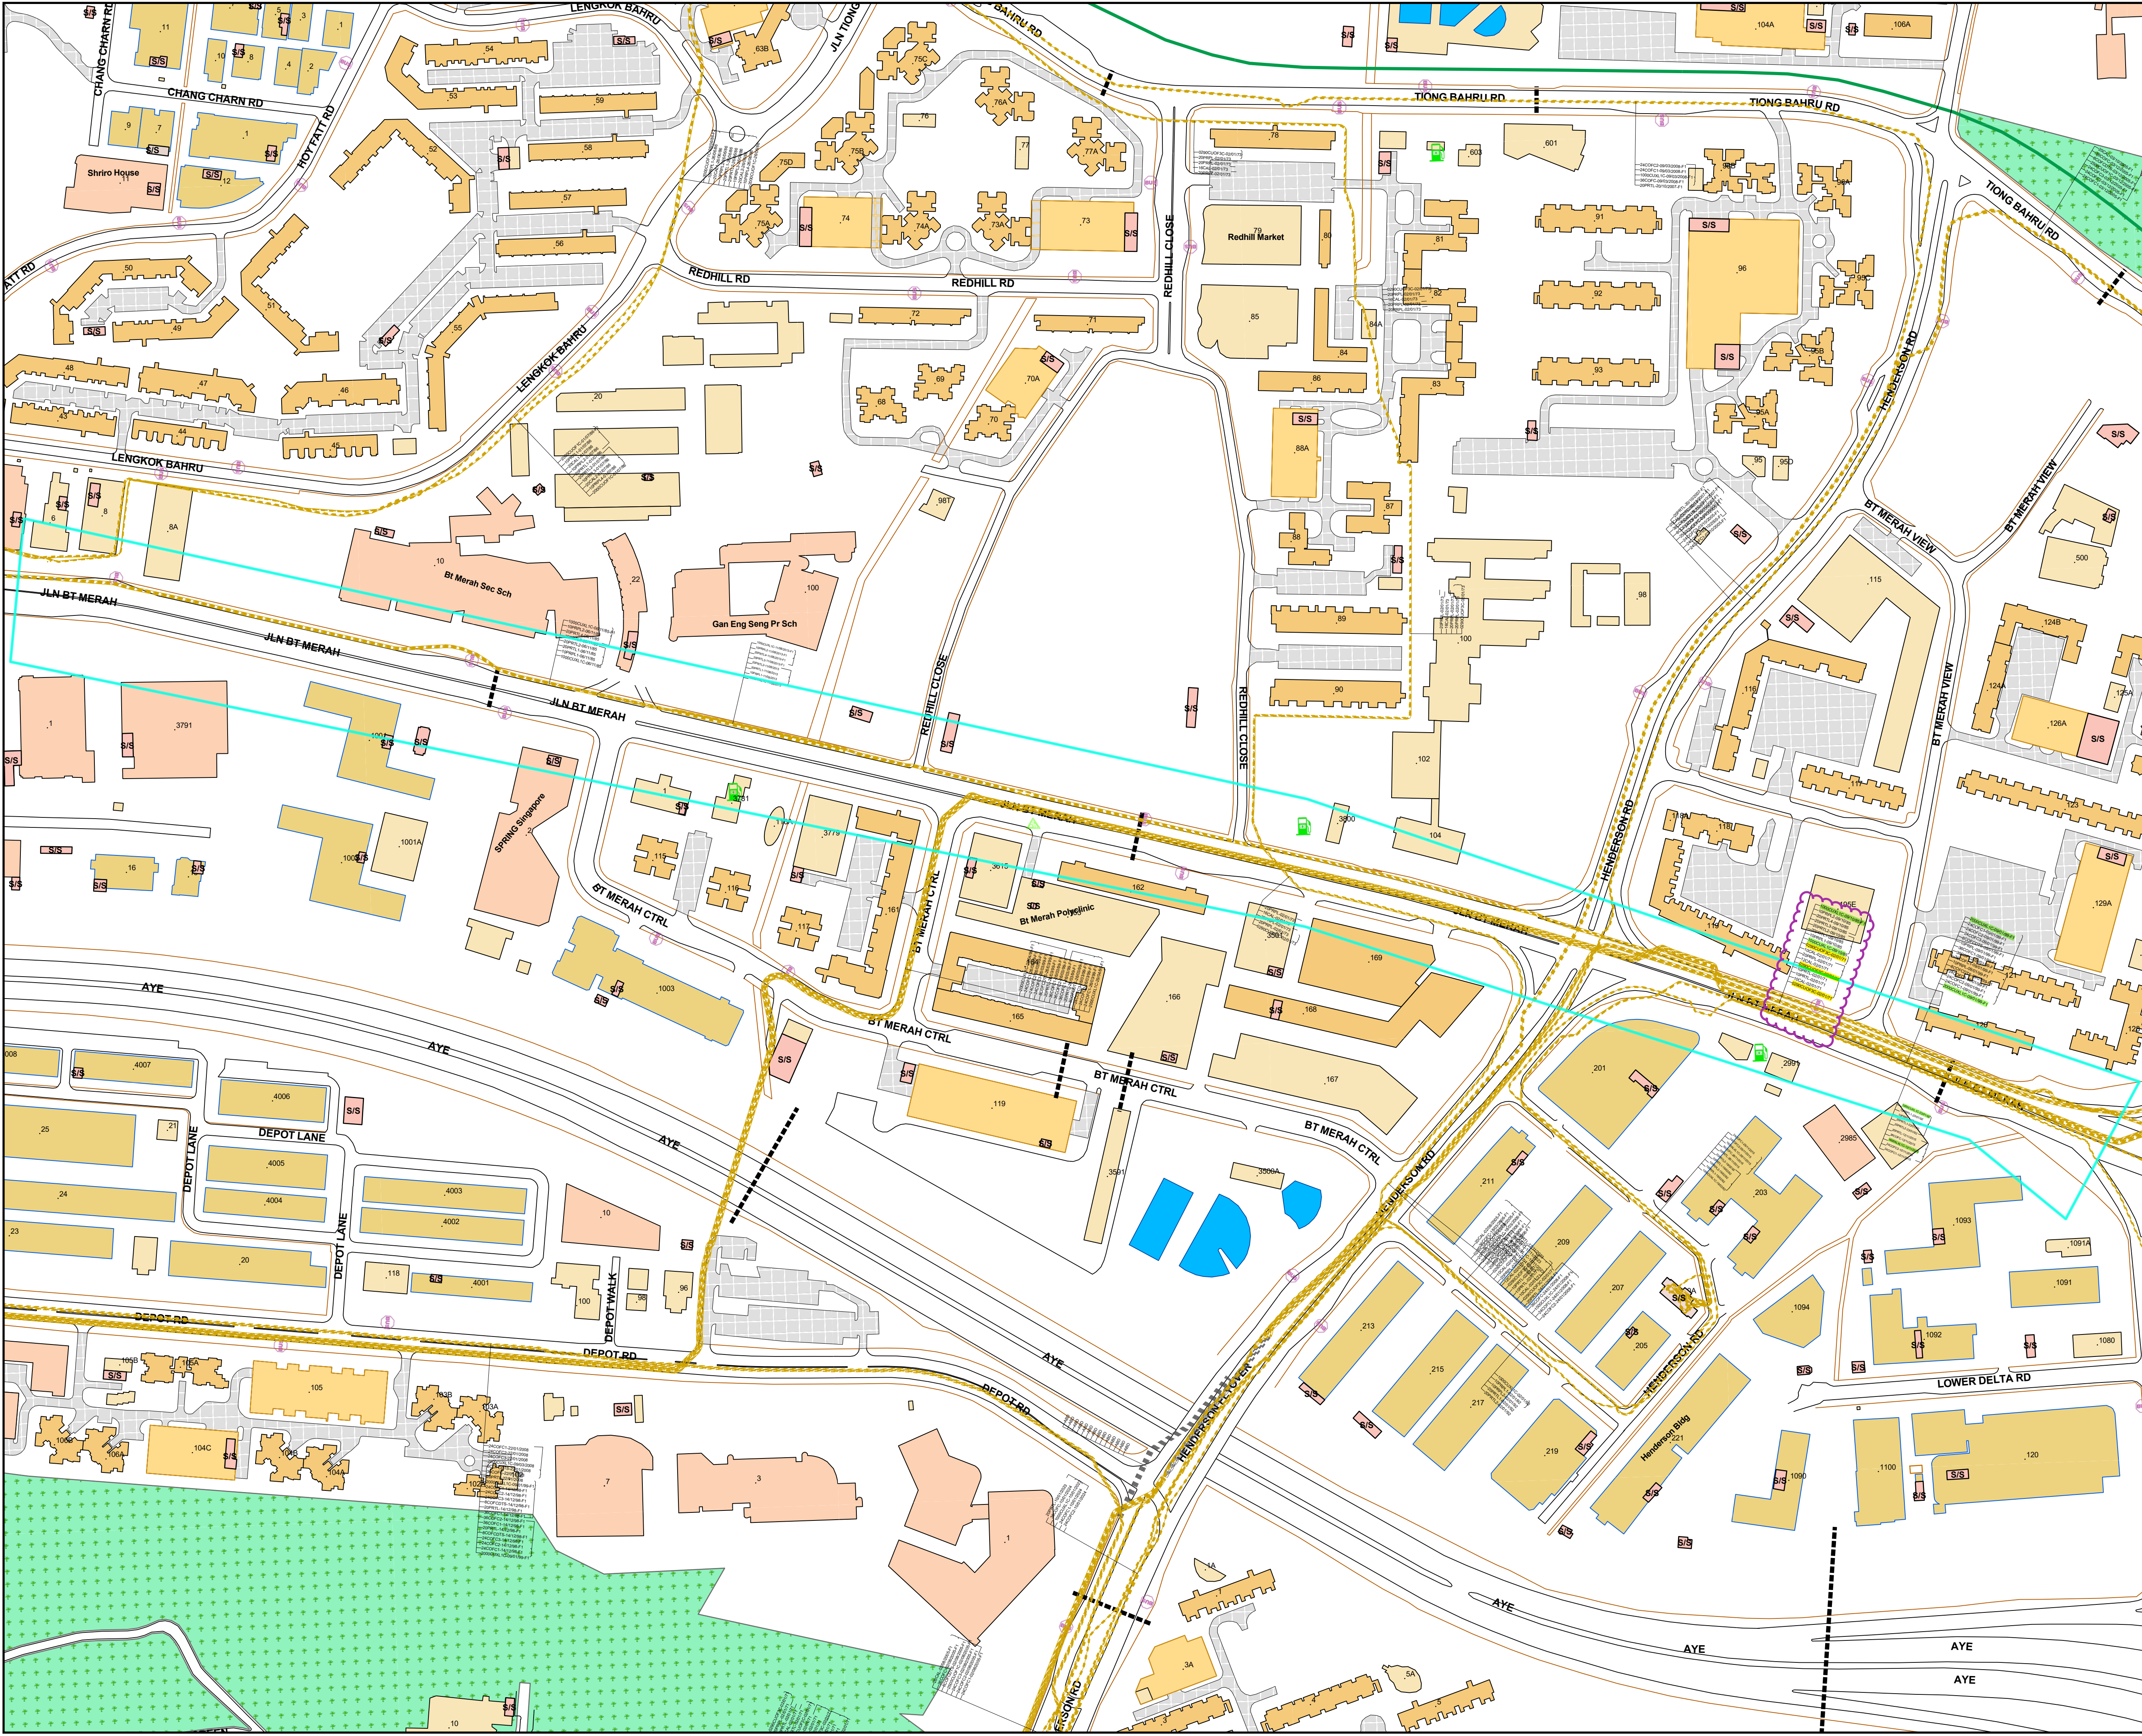

Legend

- Cable Marking Point
- Cable Marking Plot
- EHV Power Cable
- EHV Auxilliary Cable
- EHV Abandoned Cable

230KV & 66KV

The plan & information herein are strictly confidential and solely for the use of the requester to whom these Documents have been issued. These Documents shall in no event, for any purpose whatsoever be reproduced, republished, uploaded, posted, transmitted or otherwise distributed in any way.

"HDD" pipes for underground cables are installed using Horizontal Directional Drilling method without cable identification markers and pipes may vary in depth. Contact SP Power Grid Ltd if the earthworks come within the vicinity of "HDD" pipes.

This cable route drawing serves only as a guide for locating underground cables. There may be departures from the sources shown and services of which no record is held. Contractors are required to engage Licensed Cable Detection Workers to carry out the requisite cable detection works and dig adequate and appropriate number of trial holes manually to positively identify and locate all cables prior to earthworks.

Note: The drawing is issued for the use of this project only and is to be destroyed after use. This drawings is only valid for three months from the date of purchase.

APPLICATION NO : ASPR-2603244840

ISSUED TO : KYAW ZAW LIN

SCALE : NOT TO SCALE

PLOT BY : norhashimah

DATE OF PLOT : 23/03/2026

Zone : DN4

SPgroup
Empowering the Future of Energy



Legend

- Cable Marking Point
- Cable Marking Plot
- HV Power Cable
- HV Auxiliary Cable
- HV Abandoned Cable

6.6KV & 22KV

The plan & information herein are strictly confidential and solely for the use of the requester to whom these Documents have been issued. These Documents shall in no event, for any purpose whatsoever be reproduced, republished, uploaded, posted, transmitted or otherwise distributed in any way.

"HDD" pipes for underground cables are installed using Horizontal Directional Drilling method without cable identification markers and pipes may vary in depth. Contact SP Power Grid Ltd if the earthworks come within the vicinity of "HDD" pipes.

This cable route drawing serves only as a guide for locating underground cables. There may be departures from the sources shown and services of which no record is held. Contractors are required to engage Licensed Cable Detection Workers to carry out the requisite cable detection works and dig adequate and appropriate number of trial holes manually to positively identify and locate all cables prior to earthworks.

Note: The drawing is issued for the use of this project only and is to be destroyed after use. This drawings is only valid for three months from the date of purchase.

APPLICATION NO : ASPR-2603244840

ISSUED TO : KYAW ZAW LIN


SCALE : NOT TO SCALE

PLOT BY : norhashimah

DATE OF PLOT : 23/03/2026

Zone : DN4

SPgroup
Empowering the Future of Energy

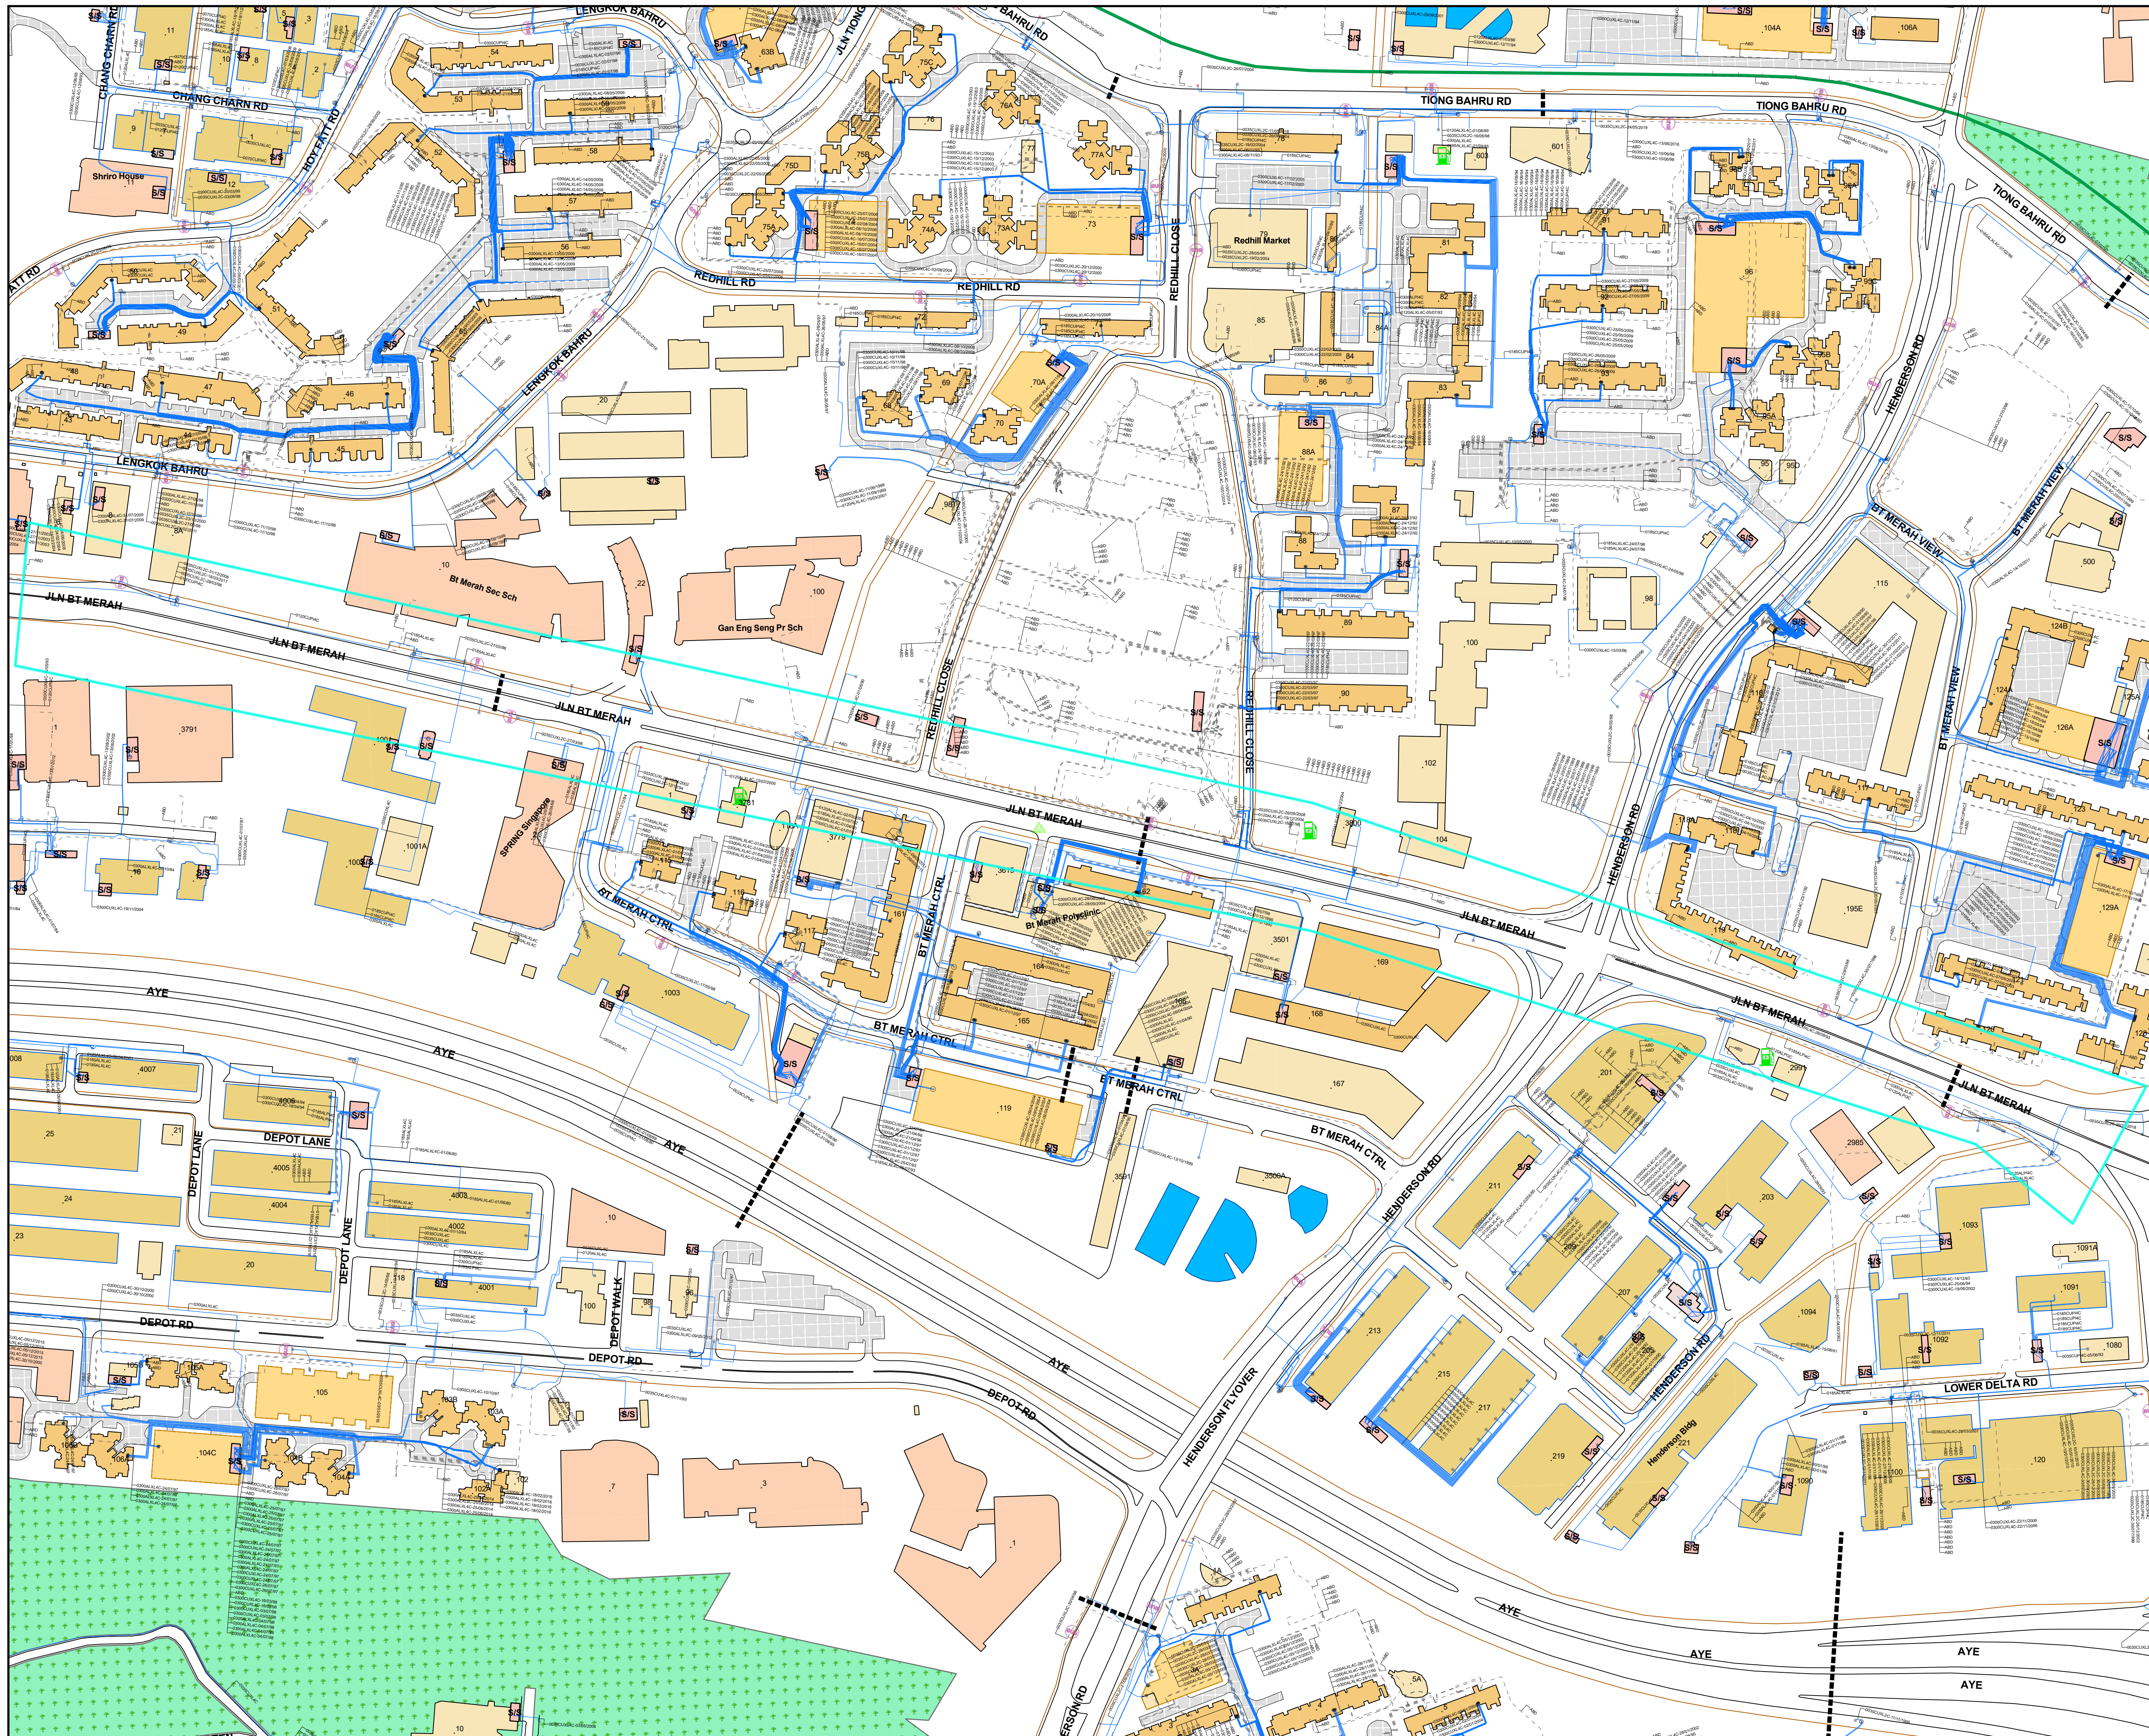

Legend

- ▲ Cable Marking Point
- ▭ Cable Marking Plot
- LV Cable
- - - LV Abandoned Cable

LV

The plan & information herein are strictly confidential and solely for the use of the requester to whom these Documents have been issued. These Documents shall in no event, for any purpose whatsoever be reproduced, republished, uploaded, posted, transmitted or otherwise distributed in any way.

"HDD" pipes for underground cables are installed using Horizontal Directional Drilling method without cable identification markers and pipes may vary in depth. Contact SP Power Grid Ltd if the earthworks come within the vicinity of "HDD" pipes.

This cable route drawing serves only as a guide for locating underground cables. There may be departures from the sources shown and services of which no record is held. Contractors are required to engage Licensed Cable Detection Workers to carry out the requisite cable detection works and dig adequate and appropriate number of trial holes manually to positively identify and locate all cables prior to earthworks.

Note: The drawing is issued for the use of this project only and is to be destroyed after use. This drawings is only valid for three months from the date of purchase.

APPLICATION NO : ASPR-2603244840

ISSUED TO : KYAW ZAW LIN

SCALE : NOT TO SCALE

PLOT BY : norhashimah

DATE OF PLOT : 23/03/2026

Zone : DN4



SPgroup
Empowering the Future of Energy



N