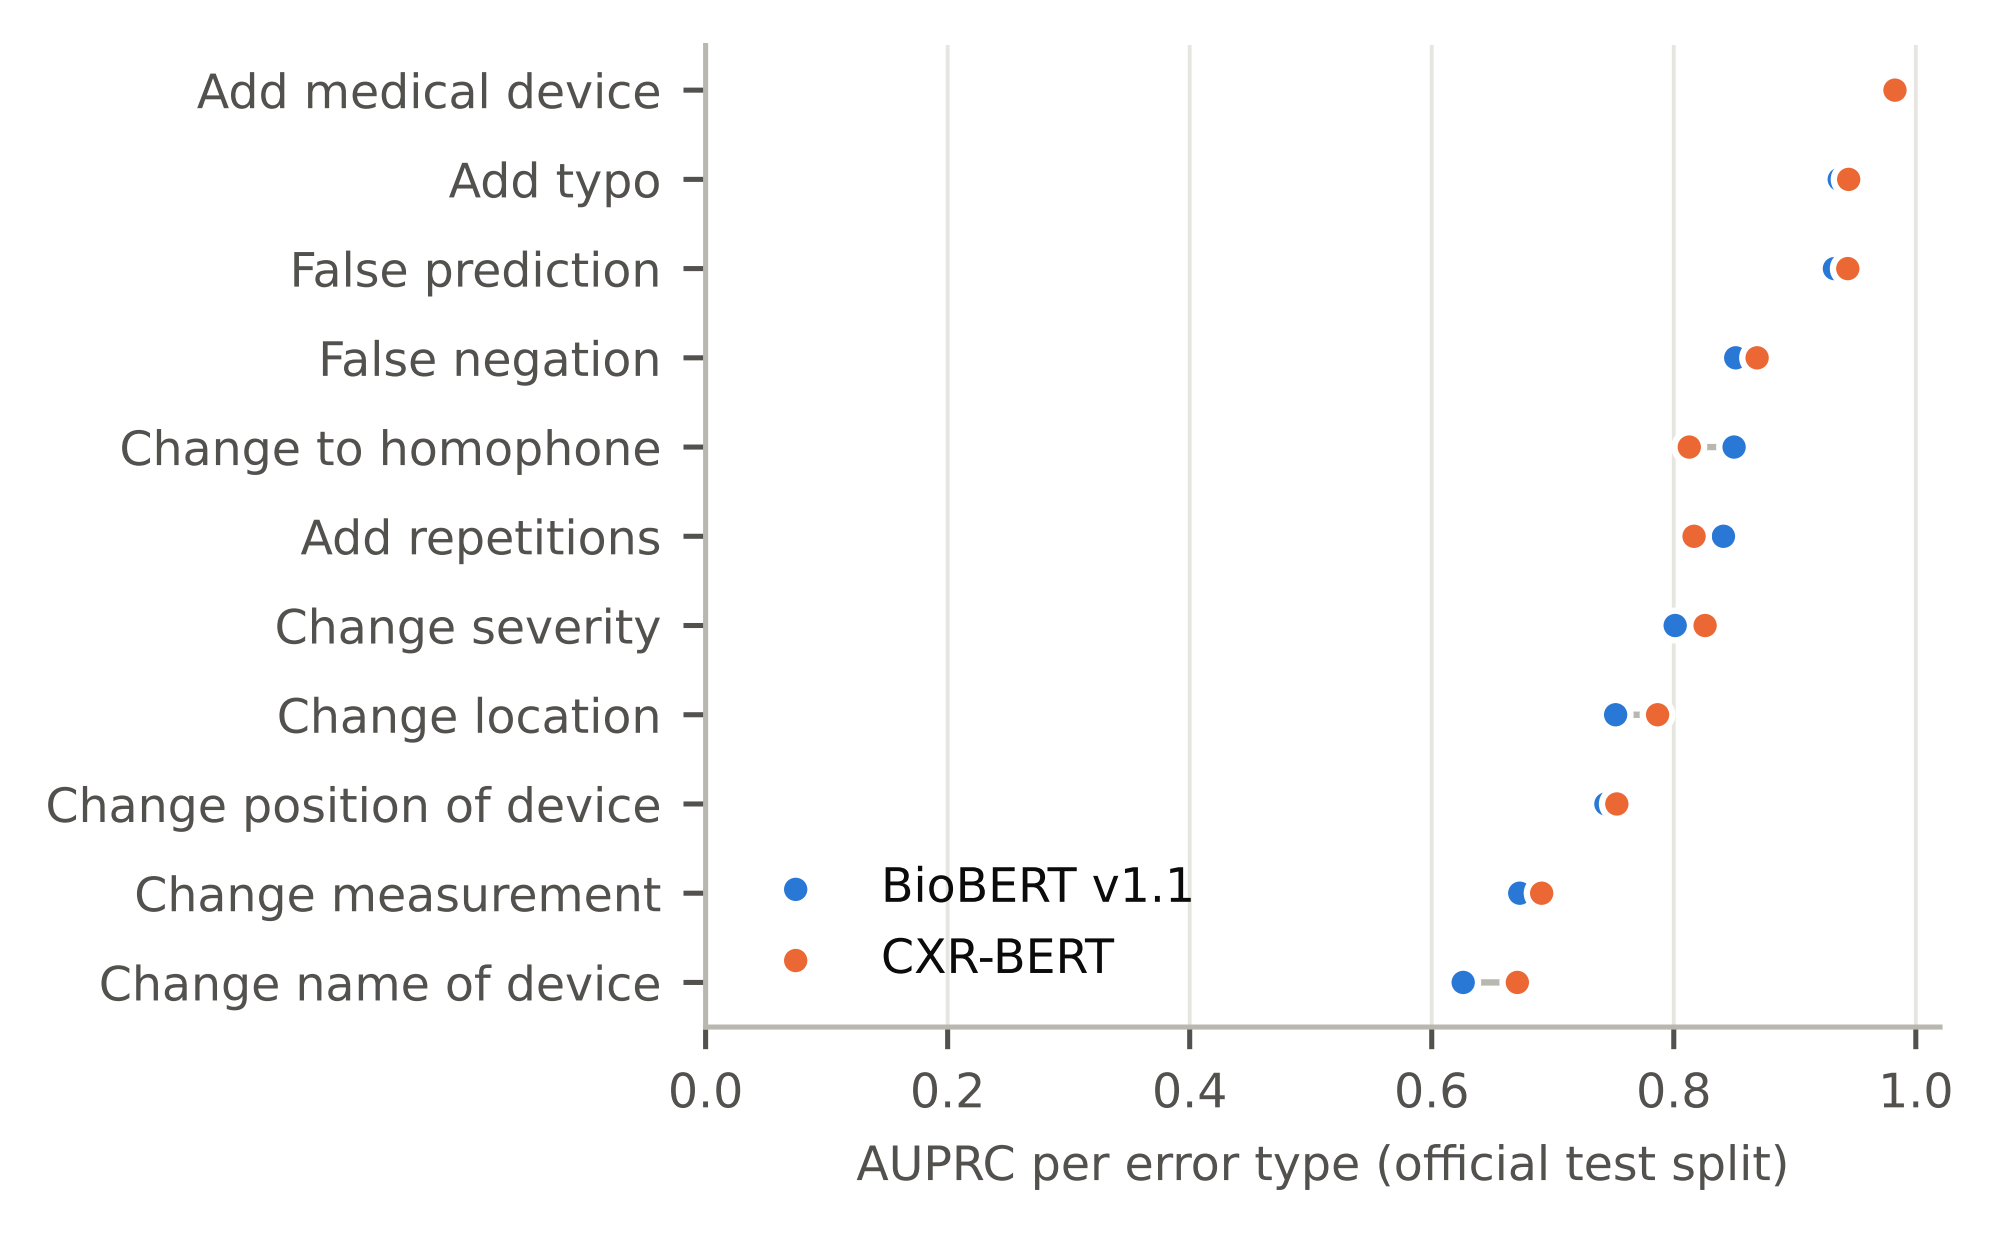
Add medical device
Add typo
False prediction
False negation
Change to homophone
Add repetitions
Change severity
Change location
Change position of device
Change measurement
Change name of device
BioBERT v1.1
CXR-BERT
0.0
0.2
0.4
0.6
0.8
1.0
AUPRC per error type (official test split)