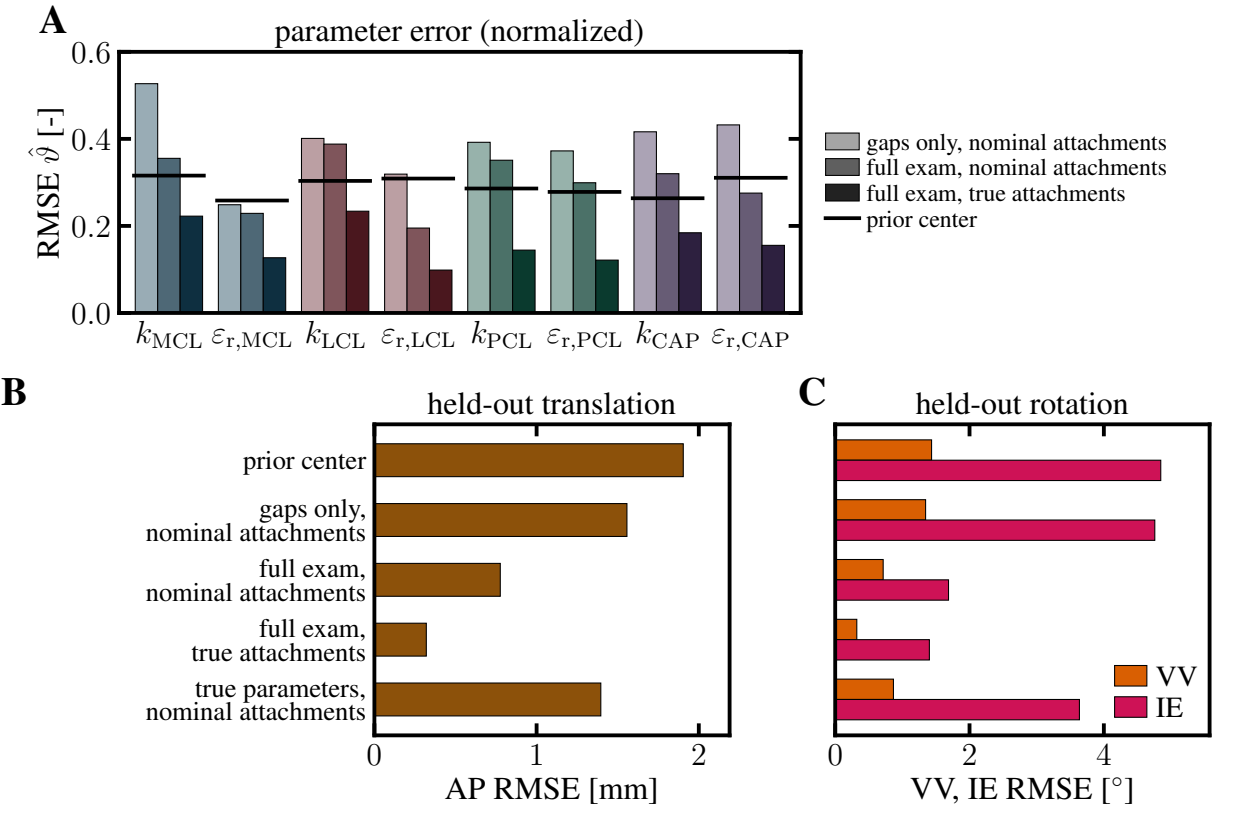

A
parameter error (normalized)
RMSE $\hat{\vartheta}$ [-]
0.6
0.4
0.2
0.0
k_{MCL} $\varepsilon_{\mathrm{r,MCL}}$ k_{LCL} $\varepsilon_{\mathrm{r,LCL}}$ k_{PCL} $\varepsilon_{\mathrm{r,PCL}}$ k_{CAP} $\varepsilon_{\mathrm{r,CAP}}$
gaps only, nominal attachments
full exam, nominal attachments
full exam, true attachments
prior center
B
held-out translation
prior center
gaps only, nominal attachments
full exam, nominal attachments
full exam, true attachments
true parameters, nominal attachments
0
1
2
AP RMSE [mm]
C
held-out rotation
VV
IE
0
2
4
VV, IE RMSE [°]