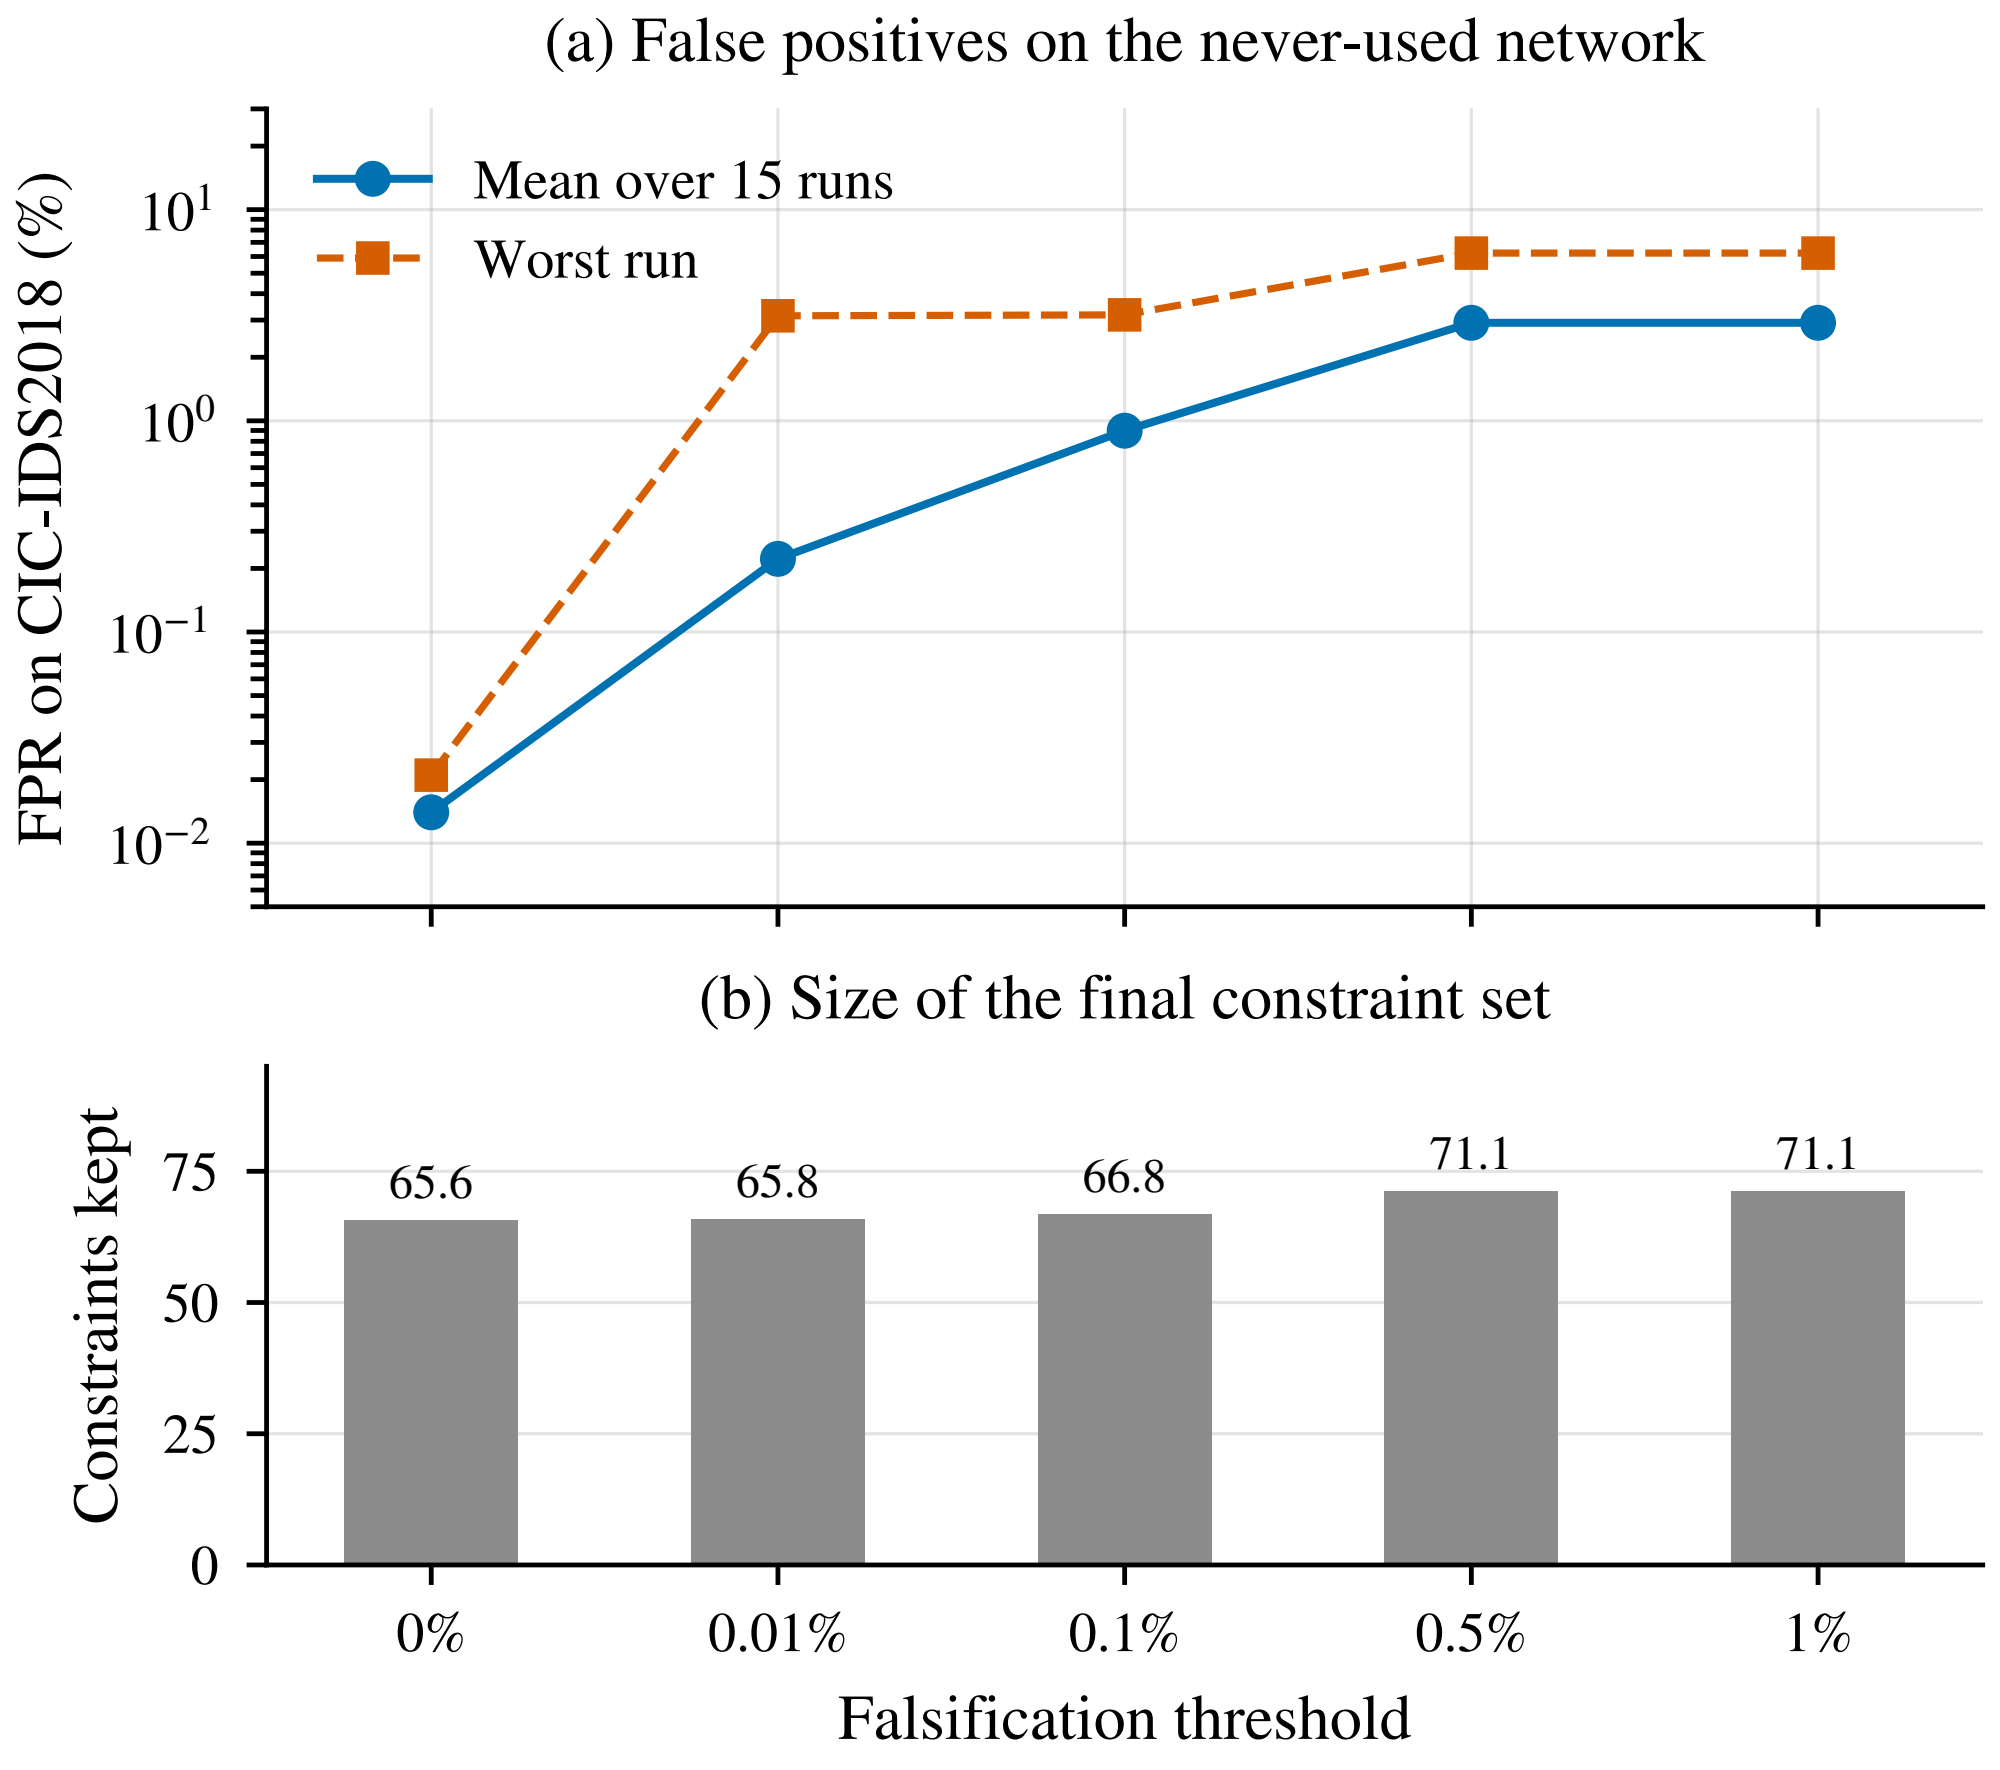
(a) False positives on the never-used network
Mean over 15 runs
Worst run
FPR on CIC-IDS2018 (%)
10^{1}
10^{0}
10^{-1}
10^{-2}
(b) Size of the final constraint set
Constraints kept
75
50
25
0
65.6
65.8
66.8
71.1
71.1
0%
0.01%
0.1%
0.5%
1%
Falsification threshold