

The Big

Request for Information (RFI)

Project:	The Big Business District	RFI No.:	BD-CW-SAMCO-PCO-RFI-MECH-003
Owner:	ROYA Developments	Rev.:	R00
Project Manager:	ACE-PM	Date:	08 / 03 / 2026
Consultant:	Prime Consultant		
Contractor:	SAMCO National Construction		
To:	PCO		

Subject

Discrepancy in Sump Pit Configuration Between Structural approved shopdrawing and Mechanical Drawing – Basement 2

With reference to the approved structural drawings No. **SAMCO-PCO-SHD-STR-005-REV00**, we would like to highlight the following coordination matters related to the sumpits located at Basement 2 within the area serving B2 and B3 buildings.
Kindly review and advise accordingly:

1) Sumpit Configuration Discrepancy:

As per the approved structural drawings, there are two sumpits located in Basement 2 within the mentioned zone.

Sumpit at Axis 20 / Axis BF:

No discrepancy has been observed, as the configuration is consistent with the mechanical package in terms of the number of compartments (3 compartments).

Sumpit at Axis 25 / Axis BB & GG:

As per the approved structural drawings, this sumpit consists of 2 compartments, while according to the mechanical drawings, it consists of 3 compartments.

In addition, the overall dimensions of the sumpit differ between the structural approved shopdrawing and mechanical packages.

Kindly clarify which configuration and dimensions shall be followed.

2) Required Sections for Penetrating Pipes:

We also kindly request detailed sections or drawings indicating the levels and exact locations of the penetrating pipes, including but not limited to:

Inlet pipes to the sand trap

Pipes between the sand trap and sumpit

Any other related connections

Currently, no sections or CAD drawings clearly indicate the required levels for these pipes, and the Revit model does not show these connections.

Providing these details is essential to ensure proper coordination and avoid potential clashes during execution.

Attachments: Approved Shopdrawing (SAMCO-PCO-SHD-STR-005-REV00) and the sumpit in the mechanical package

For Contractor

Signature: _____

Date: _____

Supervision Consultant Response:

- * Regarding the Conflict mentioned above, the Contractor Follow The structure Package.
- * Any Penetrating Pipes will be constructed by MEP contractor.

RE: open way

Signature: _____

Date: 7/4/2026

Project Manager Response (if required)

ACEPM:

Signature: _____

Date: _____

Distribution
CC:

ACEPM

This is not a Variation document. If the Contractor considers that the response affects its cost or time of performance, the Contractor is required to give notice in accordance with the Conditions of Contract.



The Big

SHOP DRAWING (SDW)

Project	The Big Business District	S.D/Submittal No.	Rev.
Owner	ROYA Developments	BD-CW-SAMCO-PCO-SDW-STR-005	00
Project Manager	ACE-PM	Date: 14-10-2025	
Supervision Consultant	PRIME CONSULTING OFFICE	Submitted For	
Contractor	SAMCO National Construction	Approval	
		Information	

SD Subject	SUM PITS
Location	B2 & B3
Attachment	(3) A3 Sheet

Action (2)	
Approved	A
Approved as Noted	B
Revise and Resubmit	C
Rejected	D

WE TRANSMIT HERewith / UNDER SEPARATE COVER, THE DRAWINGS,CALCULATION,ETC. LISTED BELOW.

Ser.	Drawing No.	Rev.	DESCRIPTION	SUBMITTAL CODE*	ACTION CODE **
1	SAMCO-PCO-SHD-STR-005-001-REV00	0	KEY PLAN OF SUM PIT		Code / B
2	SAMCO-PCO-SHD-STR-005-002-REV00		CONCRETE DIMENSION & RFT OF SUMPIT (01)		Code / B
3	SAMCO-PCO-SHD-STR-005-003-REV00		CONCRETE DIMENSION & RFT OF SUMPIT (02)		Code / B

CONTRACTOR :

RECEIVED BY :

COPIES:



DATE :

DATE :

Consultant to enter ACTION CODE and REMARKS

Supervision Consultant Remarks :

- 1- Any modifications in concrete dimensions shop drawings should be reflected in these drawings
- 2- Finally BBS quantities are subject to final approval for as built take-off.
- 3- The contractor must coordinate with the mechanical works and consider for any required openings or sleeves before starting the reinforced concrete casting.

Supervision Consultant: **M.Mamdouh**
Fathi Gouda



DATE : 28/10/2025

Corrections or comments made relative to submittals during this review does not relieve the contractor from compliance with the requirements of the drawings and specifications. This check is only for review of general conformance with the design concept of the project and general compliance with the information given in the contract documents. The contractor is responsible for confirming and correlating all quantities and dimensions, selecting fabrication process and techniques of construction, coordinating his work with that of other trades, and performing his work in a safe and satisfactory manner.

Project Manager Remarks (If Required):

Project Manager:

DATE :

Received by Contractor:




DATE :

COPIES:



+ TYPE:	SD	Shop Drawings	* SUBMITTAL CODE:	** ACTION CODE:
	SM	Sample	1. Submitted for Approval	A Approved
	GT	Guarantee	2. Submitted for Information	B Approved as Noted
	MD	Manufacturer's Data		C Revise and Resubmit
	CT	Certificates		D Rejected
	OT	Others		

Structure	Architecture	Surveying	Electrical	Mechanical	Landscape	Infra & Roads	Other
-----------	--------------	-----------	------------	------------	-----------	---------------	-------

The level and location of drainage inlets to sand trap, the pipe between sand trap and sump pit and the pipe between sump pit and valve box must be clarified

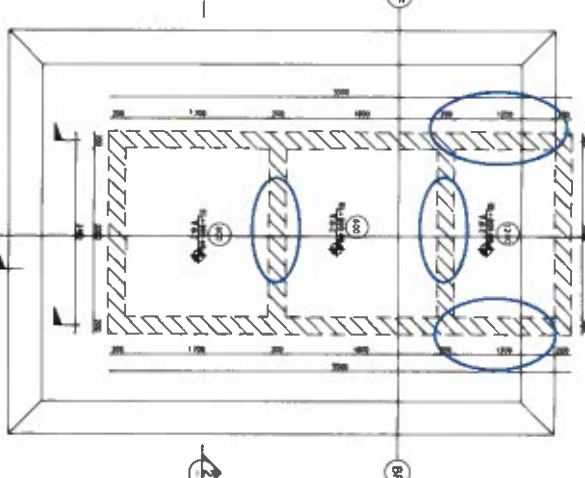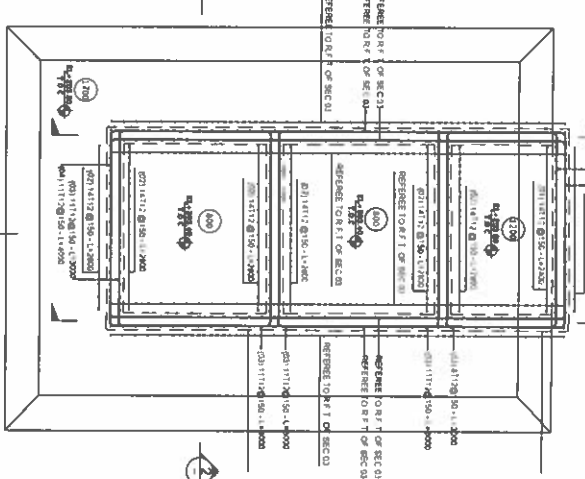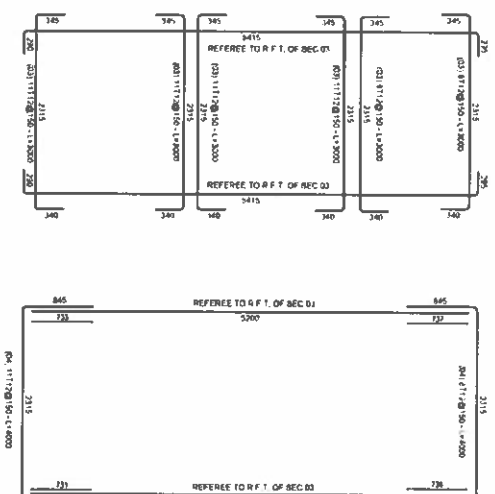

The level and location of drainage inlets to sand trap, the pipe between sand trap and sump pit and the pipe between sump pit and valve box must be clarified

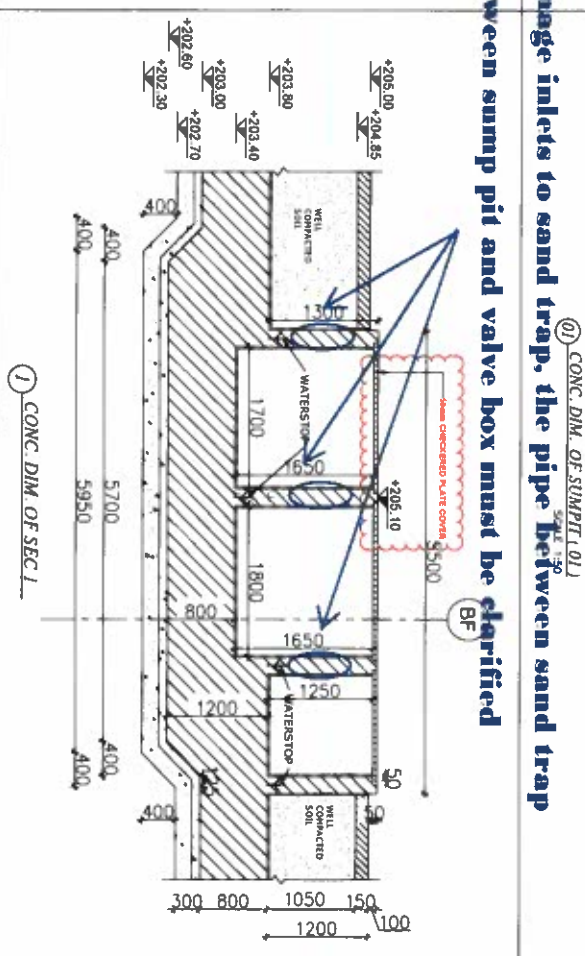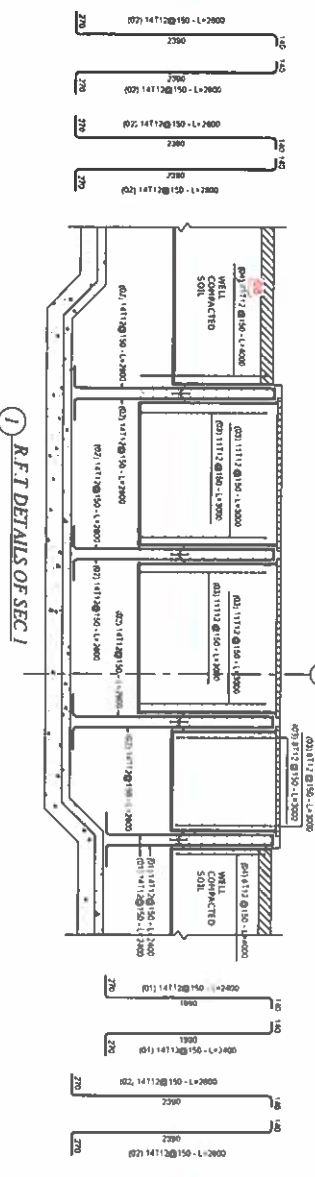


Elements	Pos.	DK.	Length (mm)	Number in the element	Total Length (mm)	Total mass (kg)
SECTION 01 (SUMP PIT)	01	12	2400.0	28	67200.0	59.67
	02	12	2800.0	84	235200.0	208.86
	03	12	3000.0	60	180000.0	159.84
	04	12	4000.0	19	76000.0	67.49
SECTION 02 (SUMP PIT)	05	12	6000.0	8	48000.0	85.25
	06	12	5200.0	8	41600.0	73.88
	07	12	2770.0 *	37	74460.0	182.02
	08	12	2770.0 *	37	74460.0	182.02
	14	12	4500.0	3	13500.0	23.96
	15	12	4900.0	3	14700.0	26.11
Average length						


Unit	Weight (kg/m)	1	1.12
Total length (mm)		120390.0	
Total weight (kg)		1069.12	
Subtotal: (kg)		1069.12	

Finally BBS quantities are subject to final approval for as built take-off

3 R.F.T. DETAILS OF SEC. 3 NO. 02

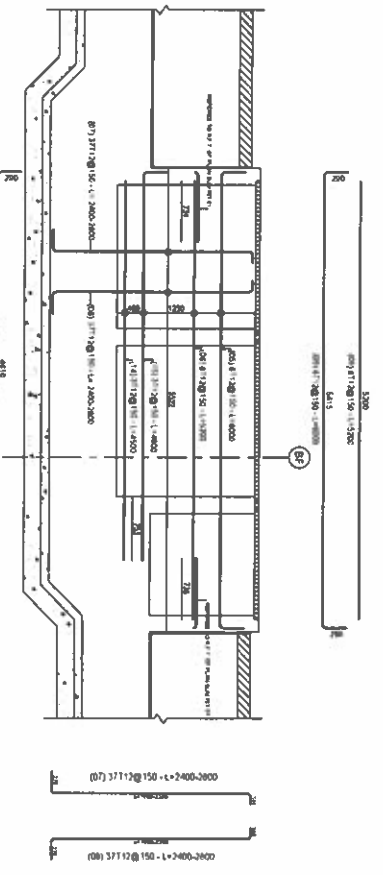

2 CONC. DIM. OF SEC. 2

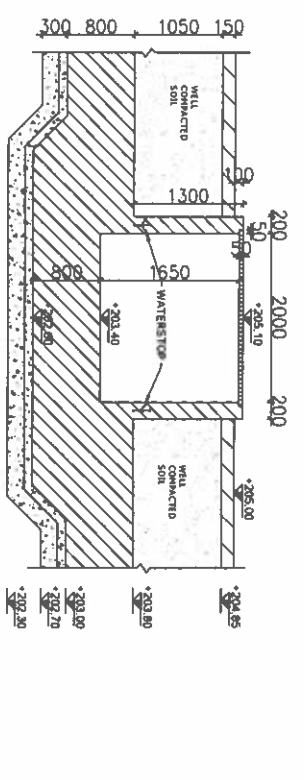

Code / B

REVISIONS

NO.	DESCRIPTION	DATE
1	ISSUED FOR TENDER	10/10/2023
2	FOR APPROVAL	10/10/2023
3	FOR APPROVAL	10/10/2023
4	FOR APPROVAL	10/10/2023
5	FOR APPROVAL	10/10/2023

PROJECT INFORMATION

PROJECT NAME	THE BIG BUSINESS DISTRICT
CLIENT	MOHARRAM BAKHOUM
DESIGNER	PRIME CONSULTING OFFICE
DATE	10/10/2023

DESIGNER INFORMATION

DESIGNER	PRIME CONSULTING OFFICE
DESIGNER ADDRESS	10/10/2023
DESIGNER PHONE	10/10/2023
DESIGNER EMAIL	10/10/2023

APPROVALS

NO.	NAME	DATE
1	DESIGNER	10/10/2023
2	CHECKER	10/10/2023
3	APPROVER	10/10/2023

PROJECT INFORMATION

PROJECT NAME	THE BIG BUSINESS DISTRICT
CLIENT	MOHARRAM BAKHOUM
DESIGNER	PRIME CONSULTING OFFICE
DATE	10/10/2023

DESIGNER INFORMATION

DESIGNER	PRIME CONSULTING OFFICE
DESIGNER ADDRESS	10/10/2023
DESIGNER PHONE	10/10/2023
DESIGNER EMAIL	10/10/2023

APPROVALS

NO.	NAME	DATE
1	DESIGNER	10/10/2023
2	CHECKER	10/10/2023
3	APPROVER	10/10/2023

PROJECT INFORMATION

PROJECT NAME	THE BIG BUSINESS DISTRICT
CLIENT	MOHARRAM BAKHOUM
DESIGNER	PRIME CONSULTING OFFICE
DATE	10/10/2023

DESIGNER INFORMATION

DESIGNER	PRIME CONSULTING OFFICE
DESIGNER ADDRESS	10/10/2023
DESIGNER PHONE	10/10/2023
DESIGNER EMAIL	10/10/2023

APPROVALS

NO.	NAME	DATE
1	DESIGNER	10/10/2023
2	CHECKER	10/10/2023
3	APPROVER	10/10/2023

- The level and location of penetrating pipes (inlets to sand trap/between sand trap

- Provide paddle flanges on all penetrating pipes (24)
- All opening thru concrete must be submitted after approval MEP work... (25)
- (26)
- (27)



Fathi Gada

The level and location of drainage inlets to sump pit & between sump pit and valve box must be clarified

[illegible]

The level and location of drainage pipe between sump pit and valve box must be clarified

Sections mark should be shown on RFT plan

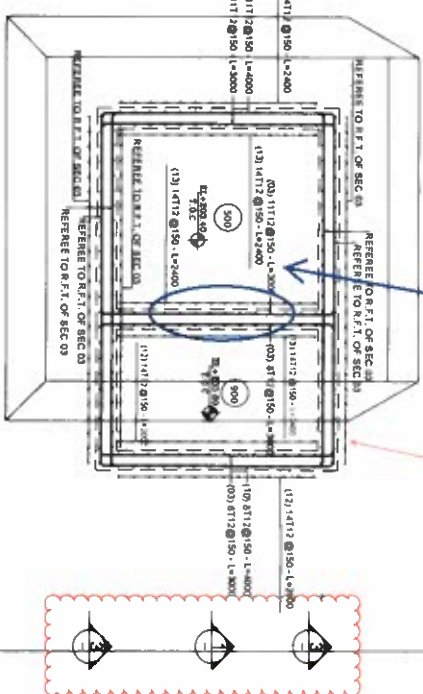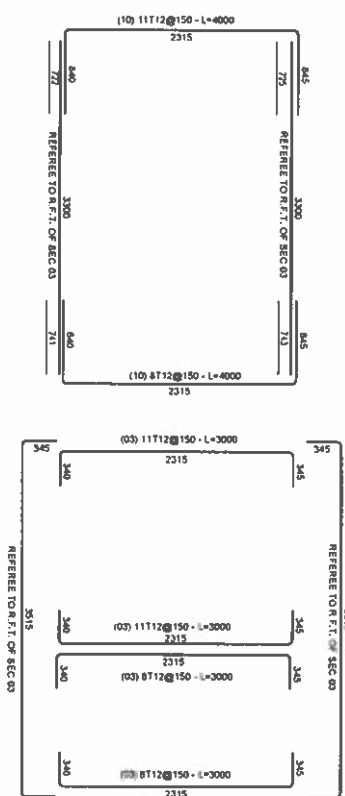


02 R.F.T. OF SUMPIT (02)

SCALE 1:30


02 CONC. DIM. OF SUMPIT (02)

SCALE 1:30

The level and location of pipe between sump pit and valve box must be clarified

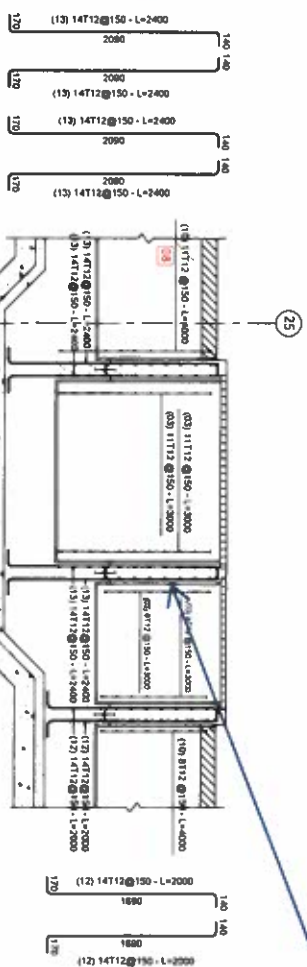

01 R.F.T. DETAILS OF SEC 1

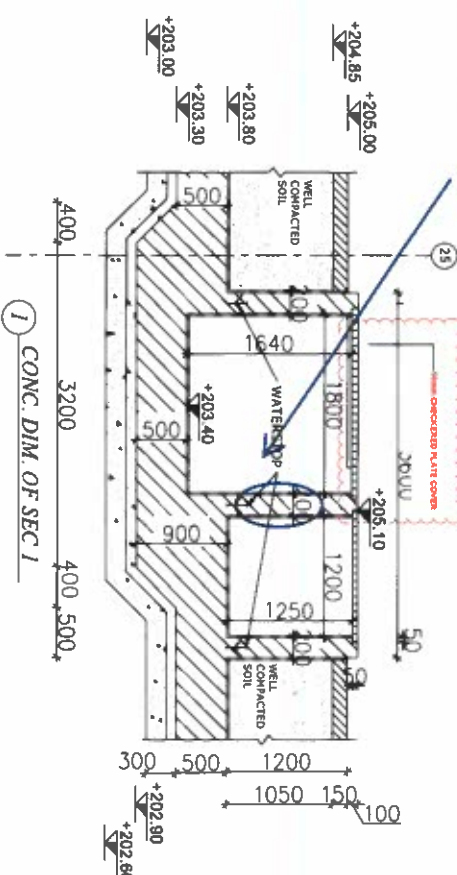

01 CONC. DIM. OF SEC 1


Elements	POS	DA	Length (mm)	Number in the element	Total Length (mm)	Mass (kg)
SECTION 01	10	12	3000.0	19	114000.0	101.23
SECTION 01	12	12	2000.0	28	56000.0	46.73
SECTION 01	13	12	2400.0	36	86400.0	71.33
SECTION 03	11	12	3000.0	19	114000.0	101.23
SECTION 03	12	12	2000.0	28	56000.0	46.73
SECTION 03	13	12	2400.0	36	86400.0	71.33
SECTION 03	14	12	2400.0	36	86400.0	71.33
SECTION 03	15	12	2400.0	36	86400.0	71.33
SECTION 03	16	12	2400.0	36	86400.0	71.33
SECTION 03	17	12	2400.0	36	86400.0	71.33
SECTION 03	18	12	2400.0	36	86400.0	71.33
SECTION 03	19	12	2400.0	36	86400.0	71.33
SECTION 03	20	12	2400.0	36	86400.0	71.33
SECTION 03	21	12	2400.0	36	86400.0	71.33
SECTION 03	22	12	2400.0	36	86400.0	71.33
SECTION 03	23	12	2400.0	36	86400.0	71.33
SECTION 03	24	12	2400.0	36	86400.0	71.33
SECTION 03	25	12	2400.0	36	86400.0	71.33
SECTION 03	26	12	2400.0	36	86400.0	71.33
SECTION 03	27	12	2400.0	36	86400.0	71.33
SECTION 03	28	12	2400.0	36	86400.0	71.33
SECTION 03	29	12	2400.0	36	86400.0	71.33
SECTION 03	30	12	2400.0	36	86400.0	71.33
SECTION 03	31	12	2400.0	36	86400.0	71.33
SECTION 03	32	12	2400.0	36	86400.0	71.33
SECTION 03	33	12	2400.0	36	86400.0	71.33
SECTION 03	34	12	2400.0	36	86400.0	71.33
SECTION 03	35	12	2400.0	36	86400.0	71.33
SECTION 03	36	12	2400.0	36	86400.0	71.33
SECTION 03	37	12	2400.0	36	86400.0	71.33
SECTION 03	38	12	2400.0	36	86400.0	71.33
SECTION 03	39	12	2400.0	36	86400.0	71.33
SECTION 03	40	12	2400.0	36	86400.0	71.33
SECTION 03	41	12	2400.0	36	86400.0	71.33
SECTION 03	42	12	2400.0	36	86400.0	71.33
SECTION 03	43	12	2400.0	36	86400.0	71.33
SECTION 03	44	12	2400.0	36	86400.0	71.33
SECTION 03	45	12	2400.0	36	86400.0	71.33
SECTION 03	46	12	2400.0	36	86400.0	71.33
SECTION 03	47	12	2400.0	36	86400.0	71.33
SECTION 03	48	12	2400.0	36	86400.0	71.33
SECTION 03	49	12	2400.0	36	86400.0	71.33
SECTION 03	50	12	2400.0	36	86400.0	71.33
SECTION 03	51	12	2400.0	36	86400.0	71.33
SECTION 03	52	12	2400.0	36	86400.0	71.33
SECTION 03	53	12	2400.0	36	86400.0	71.33
SECTION 03	54	12	2400.0	36	86400.0	71.33
SECTION 03	55	12	2400.0	36	86400.0	71.33
SECTION 03	56	12	2400.0	36	86400.0	71.33
SECTION 03	57	12	2400.0	36	86400.0	71.33
SECTION 03	58	12	2400.0	36	86400.0	71.33
SECTION 03	59	12	2400.0	36	86400.0	71.33
SECTION 03	60	12	2400.0	36	86400.0	71.33
SECTION 03	61	12	2400.0	36	86400.0	71.33
SECTION 03	62	12	2400.0	36	86400.0	71.33
SECTION 03	63	12	2400.0	36	86400.0	71.33
SECTION 03	64	12	2400.0	36	86400.0	71.33
SECTION 03	65	12	2400.0	36	86400.0	71.33
SECTION 03	66	12	2400.0	36	86400.0	71.33
SECTION 03	67	12	2400.0	36	86400.0	71.33
SECTION 03	68	12	2400.0	36	86400.0	71.33
SECTION 03	69	12	2400.0	36	86400.0	71.33
SECTION 03	70	12	2400.0	36	86400.0	71.33
SECTION 03	71	12	2400.0	36	86400.0	71.33
SECTION 03	72	12	2400.0	36	86400.0	71.33
SECTION 03	73	12	2400.0	36	86400.0	71.33
SECTION 03	74	12	2400.0	36	86400.0	71.33
SECTION 03	75	12	2400.0	36	86400.0	71.33
SECTION 03	76	12	2400.0	36	86400.0	71.33
SECTION 03	77	12	2400.0	36	86400.0	71.33
SECTION 03	78	12	2400.0	36	86400.0	71.33
SECTION 03	79	12	2400.0	36	86400.0	71.33
SECTION 03	80	12	2400.0	36	86400.0	71.33
SECTION 03	81	12	2400.0	36	86400.0	71.33
SECTION 03	82	12	2400.0	36	86400.0	71.33
SECTION 03	83	12	2400.0	36	86400.0	71.33
SECTION 03	84	12	2400.0	36	86400.0	71.33
SECTION 03	85	12	2400.0	36	86400.0	71.33
SECTION 03	86	12	2400.0	36	86400.0	71.33
SECTION 03	87	12	2400.0	36	86400.0	71.33
SECTION 03	88	12	2400.0	36	86400.0	71.33
SECTION 03	89	12	2400.0	36	86400.0	71.33
SECTION 03	90	12	2400.0	36	86400.0	71.33
SECTION 03	91	12	2400.0	36	86400.0	71.33
SECTION 03	92	12	2400.0	36	86400.0	71.33
SECTION 03	93	12	2400.0	36	86400.0	71.33
SECTION 03	94	12	2400.0	36	86400.0	71.33
SECTION 03	95	12	2400.0	36	86400.0	71.33
SECTION 03	96	12	2400.0	36	86400.0	71.33
SECTION 03	97	12	2400.0	36	86400.0	71.33
SECTION 03	98	12	2400.0	36	86400.0	71.33
SECTION 03	99	12	2400.0	36	86400.0	71.33
SECTION 03	100	12	2400.0	36	86400.0	71.33

Finally BBS quantities are subject to final approval for as built take-off

Unit	Weight (kg/m)	Length (m)	Total weight (kg)
1	1.12	7567.20	8471.97
2	0.89	7567.20	6734.81
3	0.89	7567.20	6734.81
4	0.89	7567.20	6734.81
5	0.89	7567.20	6734.81
6	0.89	7567.20	6734.81
7	0.89	7567.20	6734.81
8	0.89	7567.20	6734.81
9	0.89	7567.20	6734.81
10	0.89	7567.20	6734.81
11	0.89	7567.20	6734.81
12	0.89	7567.20	6734.81
13	0.89	7567.20	6734.81
14	0.89	7567.20	6734.81
15	0.89	7567.20	6734.81
16	0.89	7567.20	6734.81
17	0.89	7567.20	6734.81
18	0.89	7567.20	6734.81
19	0.89	7567.20	6734.81
20	0.89	7567.20	6734.81
21	0.89	7567.20	6734.81
22	0.89	7567.20	6734.81
23	0.89	7567.20	6734.81
24	0.89	7567.20	6734.81
25	0.89	7567.20	6734.81
26	0.89	7567.20	6734.81
27	0.89	7567.20	6734.81
28	0.89	7567.20	6734.81
29	0.89	7567.20	6734.81
30	0.89	7567.20	6734.81
31	0.89	7567.20	6734.81
32	0.89	7567.20	6734.81
33	0.89	7567.20	6734.81
34	0.89	7567.20	6734.81
35	0.89	7567.20	6734.81
36	0.89	7567.20	6734.81
37	0.89	7567.20	6734.81
38	0.89	7567.20	6734.81
39	0.89	7567.20	6734.81
40	0.89	7567.20	6734.81
41	0.89	7567.20	6734.81
42	0.89	7567.20	6734.81
43	0.89	7567.20	6734.81
44	0.89	7567.20	6734.81
45	0.89	7567.20	6734.81
46	0.89	7567.20	6734.81
47	0.89	7567.20	6734.81
48	0.89	7567.20	6734.81
49	0.89	7567.20	6734.81
50	0.89	7567.20	6734.81
51	0.89	7567.20	6734.81
52	0.89	7567.20	6734.81
53	0.89	7567.20	6734.81
54	0.89	7567.20	6734.81
55	0.89	7567.20	6734.81
56	0.89	7567.20	6734.81
57	0.89	7567.20	6734.81
58	0.89	7567.20	6734.81
59	0.89	7567.20	6734.81
60	0.89	7567.20	6734.81
61	0.89	7567.20	6734.81
62	0.89	7567.20	6734.81
63	0.89	7567.20	6734.81
64	0.89	7567.20	6734.81
65	0.89	7567.20	6734.81
66	0.89	7567.20	6734.81
67	0.89	7567.20	6734.81
68	0.89	7567.20	6734.81
69	0.89	7567.20	6734.81
70	0.89	7567.20	6734.81
71	0.89	7567.20	6734.81
72	0.89	7567.20	6734.81
73	0.89	7567.20	6734.81
74	0.89	7567.20	6734.81
75	0.89	7567.20	6734.81
76	0.89	7567.20	6734.81
77	0.89	7567.20	6734.81
78	0.89	7567.20	6734.81
79	0.89	7567.20	6734.81
80	0.89	7567.20	6734.81
81	0.89	7567.20	6734.81
82	0.89	7567.20	6734.81
83	0.89	7567.20	6734.81
84	0.89	7567.20	6734.81
85	0.89	7567.20	6734.81
86	0.89	7567.20	6734.81
87	0.89	7567.20	6734.81
88	0.89	7567.20	6734.81
89	0.89	7567.20	6734.81
90	0.89	7567.20	6734.81
91	0.89	7567.20	6734.81
92	0.89	7567.20	6734.81
93	0.89	7567.20	6734.81
94	0.89	7567.20	6734.81
95	0.89	7567.20	6734.81
96	0.89	7567.20	6734.81
97	0.89	7567.20	6734.81
98	0.89	7567.20	6734.81
99	0.89	7567.20	6734.81
100	0.89	7567.20	6734.81

03 R.F.T. DETAILS OF SEC 3

NO.02

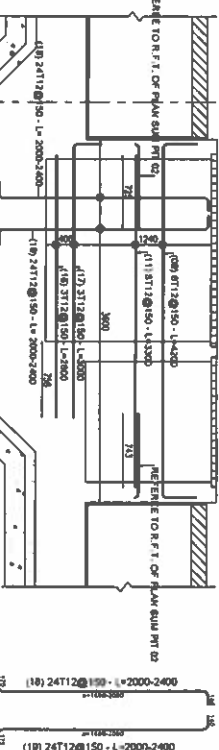

02 CONC. DIM. OF SEC 2

SCALE 1:30

Code / B

GENERAL NOTES

NO.	DESCRIPTION
1	ALL DIMENSIONS ARE IN METERS UNLESS OTHERWISE SPECIFIED.
2	ALL MATERIALS SHALL BE AS PER SPECIFICATION.
3	ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE DRAWINGS.
4	ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE SPECIFICATION.
5	ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE DRAWINGS.
6	ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE SPECIFICATION.
7	ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE DRAWINGS.
8	ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE SPECIFICATION.
9	ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE

177'18"

19'20'21'

22'23'

24'

25'

26'

