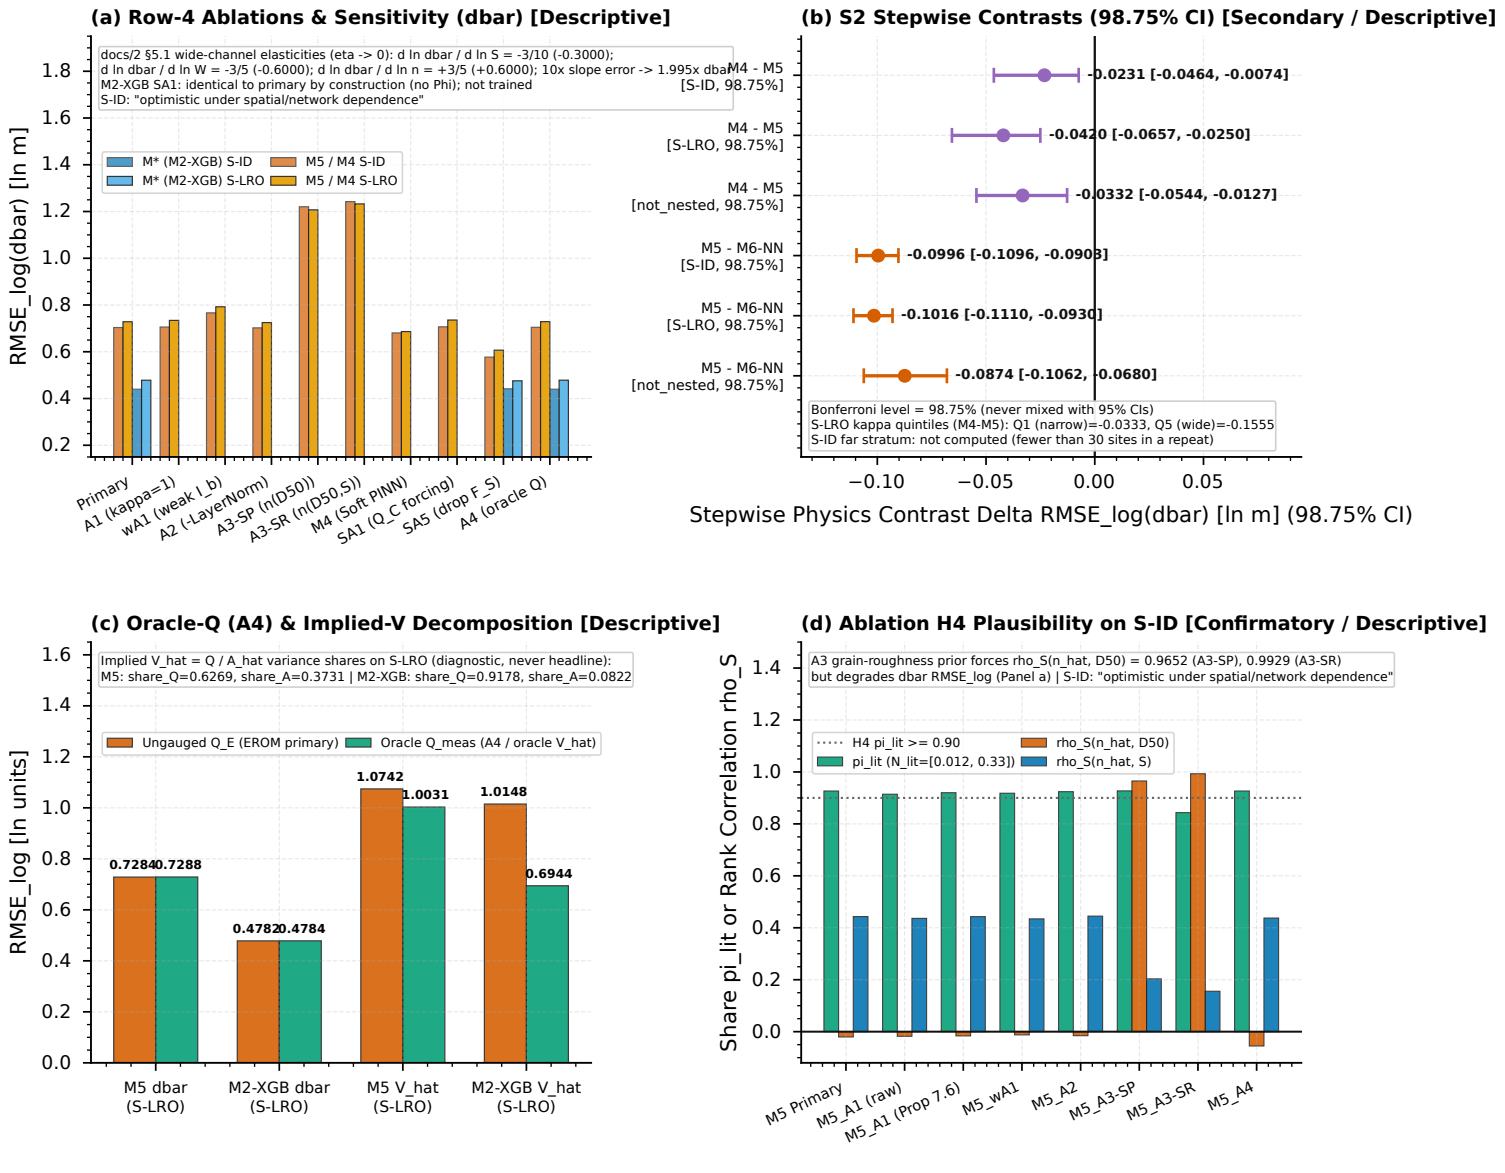


**Pre-Registered §4.7 Row 4 Decision Outcome [Confirmatory]: "M5 worse (S-LRO CI lower bound > 0)" | Venue: "ASCE; fallback per ADL-014"**
**row 4: "Diagnose with the pre-registered ablations (A1, A3, M4, SA1, SA5) and report. No post-hoc headline switch: any new variant is labelled exploratory"**