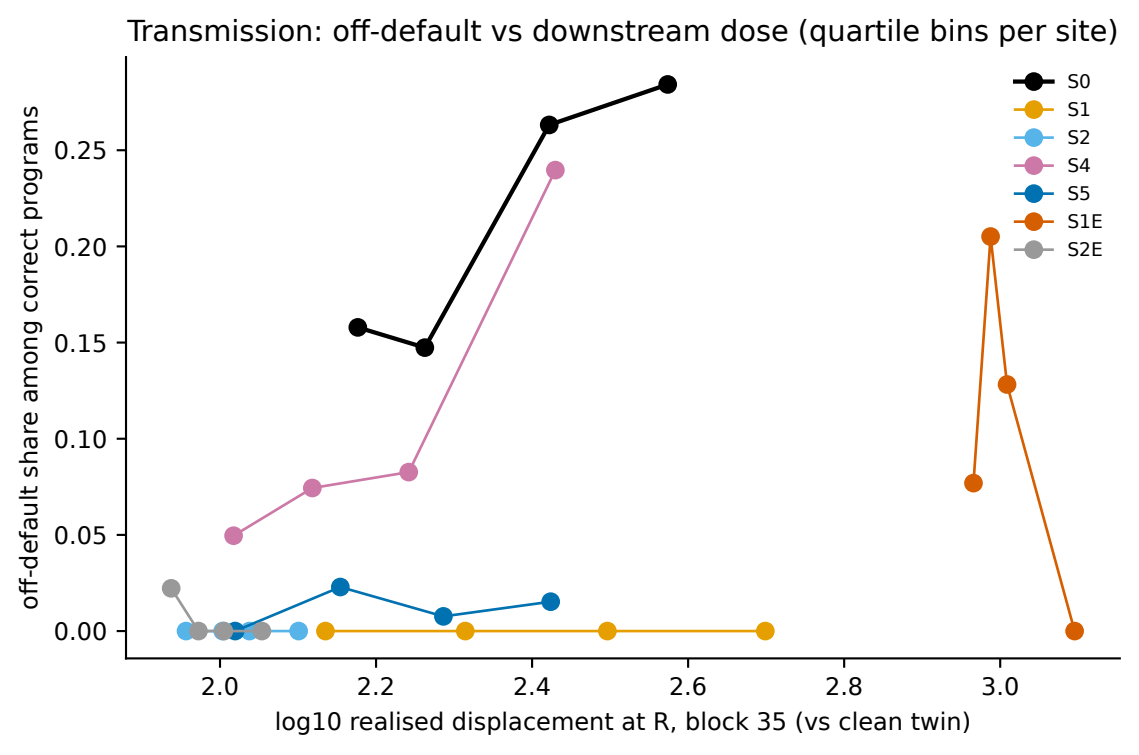
Transmission: off-default vs downstream dose (quartile bins per site)
off-default share among correct programs
0.00
0.05
0.10
0.15
0.20
0.25
2.0
2.2
2.4
2.6
2.8
3.0
log10 realised displacement at R, block 35 (vs clean twin)
S0
S1
S2
S4
S5
S1E
S2E