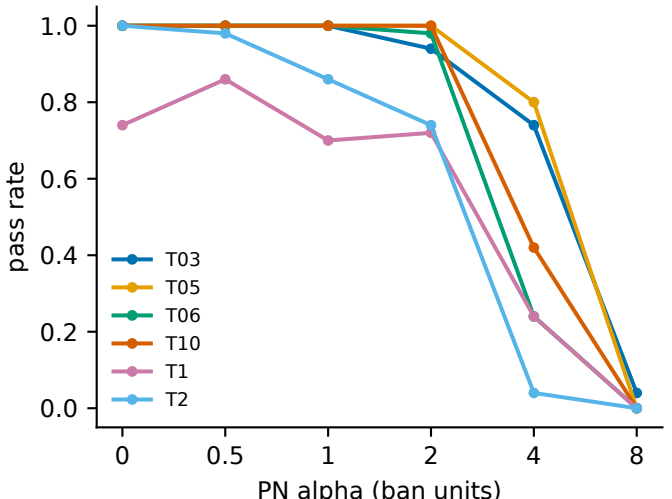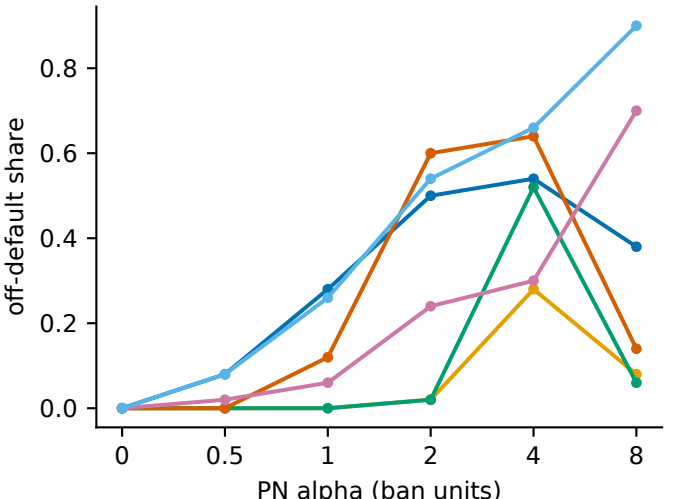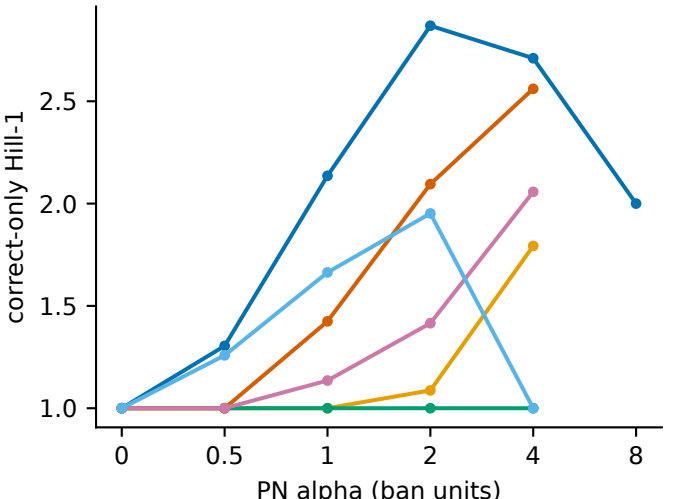Fig. 3 Dose-response of fresh per-sample plan noise (alpha 0 = TWIN)