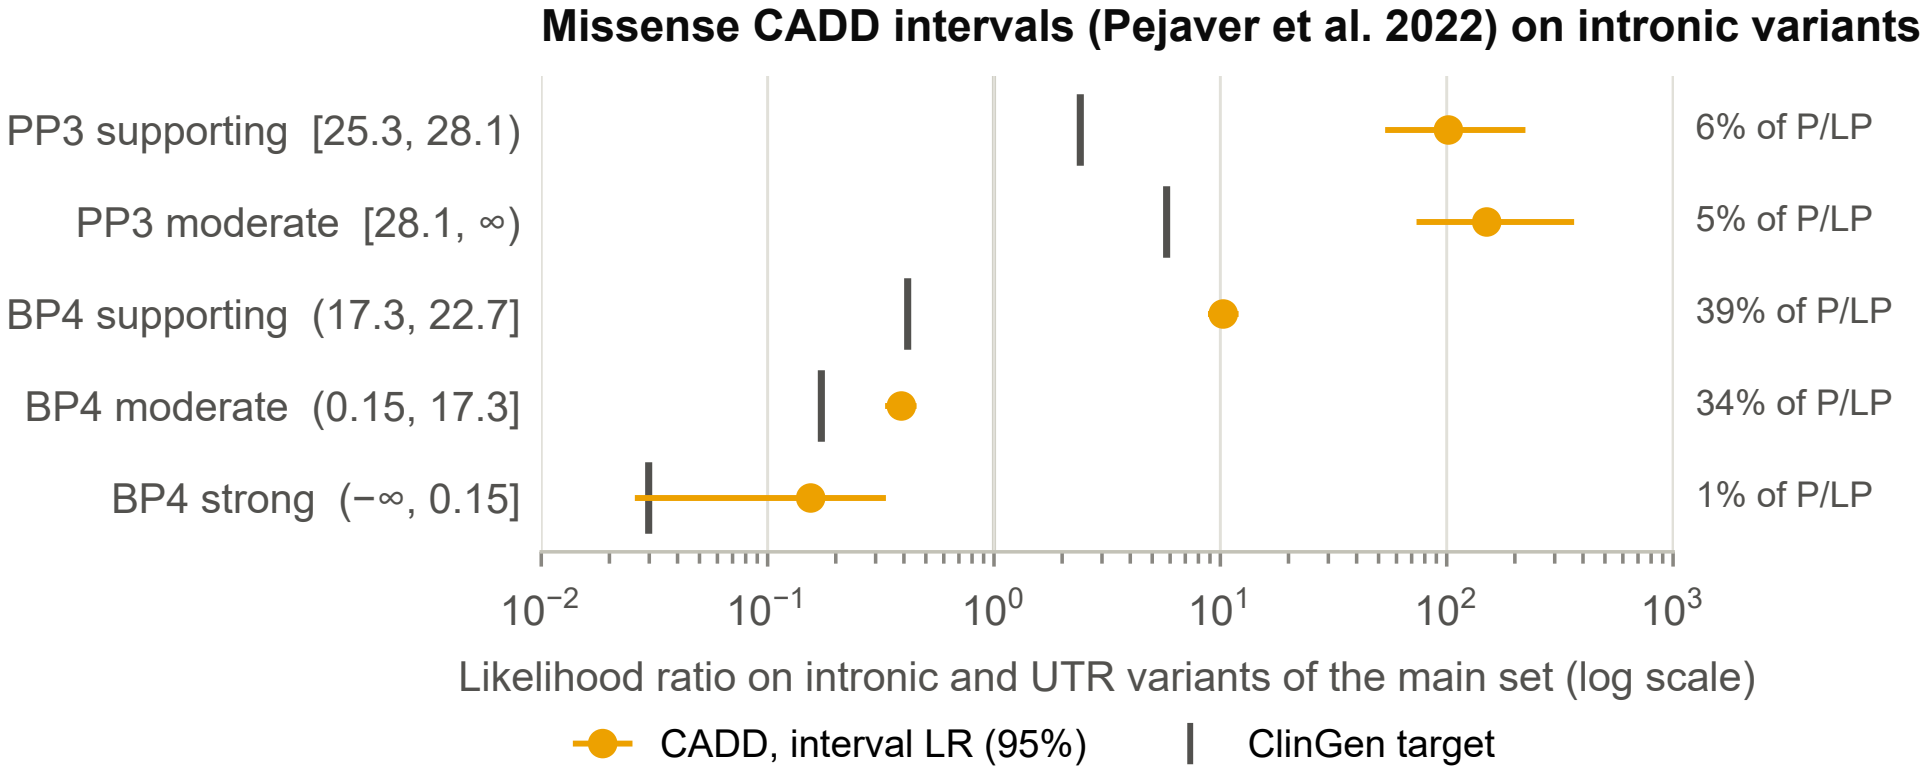

Missense CADD intervals (Pejaver et al. 2022) on intronic variants
PP3 supporting [25.3, 28.1)
PP3 moderate [28.1, ∞)
BP4 supporting (17.3, 22.7]
BP4 moderate (0.15, 17.3]
BP4 strong (−∞, 0.15]
6% of P/LP
5% of P/LP
39% of P/LP
34% of P/LP
1% of P/LP
10^−2
10^−1
10^0
10^1
10^2
10^3
Likelihood ratio on intronic and UTR variants of the main set (log scale)
CADD, interval LR (95%)
ClinGen target