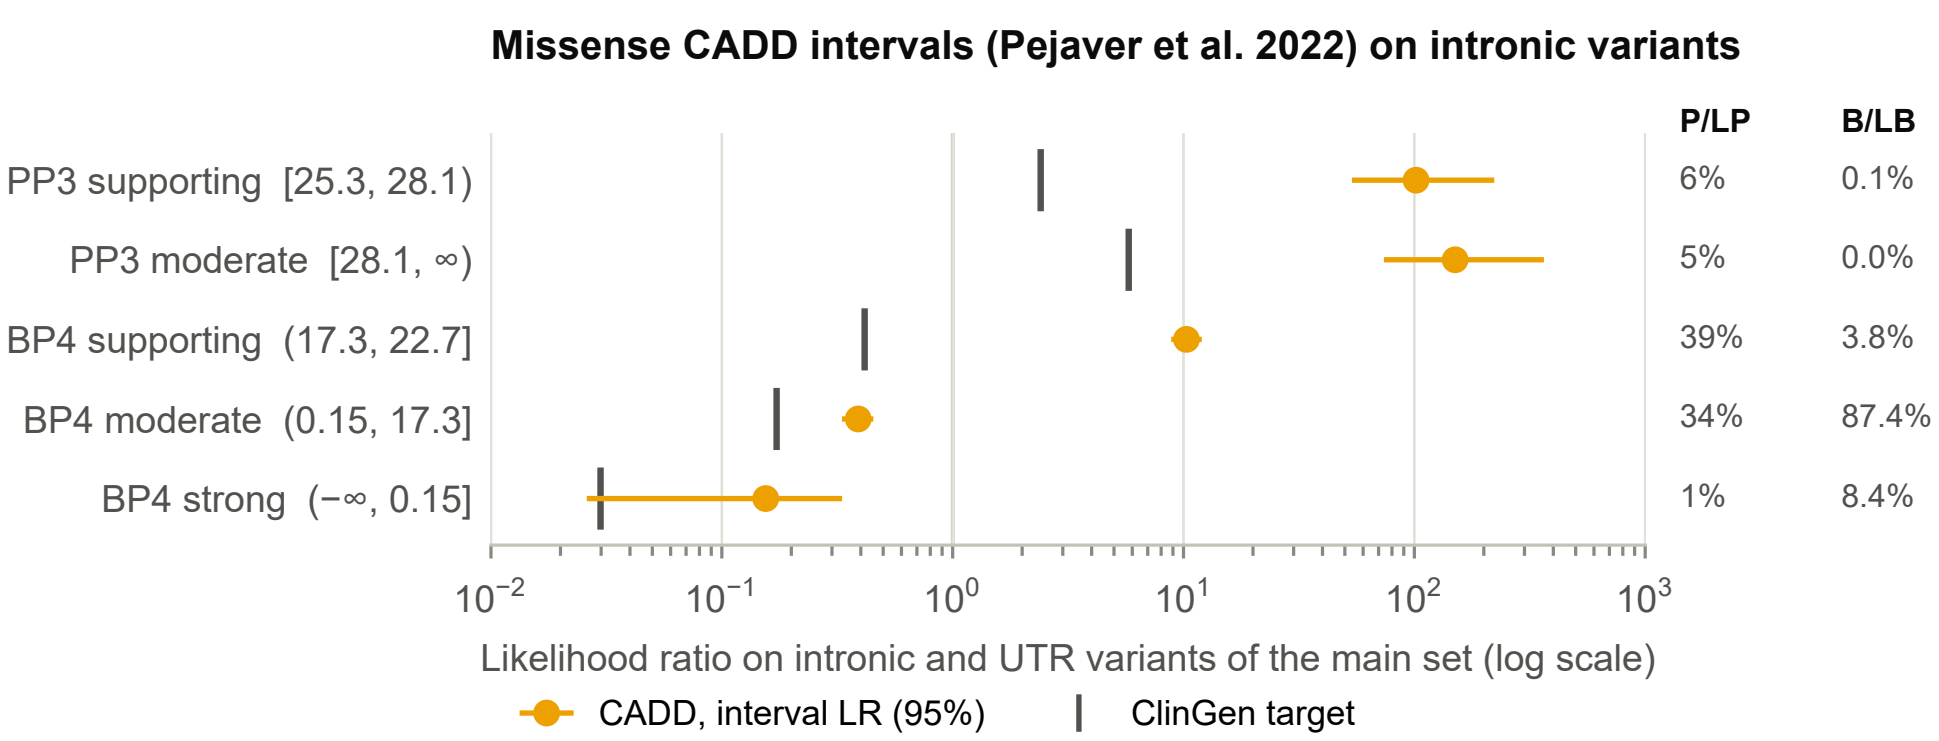

Missense CADD intervals (Pejaver et al. 2022) on intronic variants
P/LP
B/LB
PP3 supporting [25.3, 28.1)
6%
0.1%
PP3 moderate [28.1, ∞)
5%
0.0%
BP4 supporting (17.3, 22.7]
39%
3.8%
BP4 moderate (0.15, 17.3]
34%
87.4%
BP4 strong (−∞, 0.15]
1%
8.4%
10−2
10−1
100
101
102
103
Likelihood ratio on intronic and UTR variants of the main set (log scale)
CADD, interval LR (95%)
ClinGen target