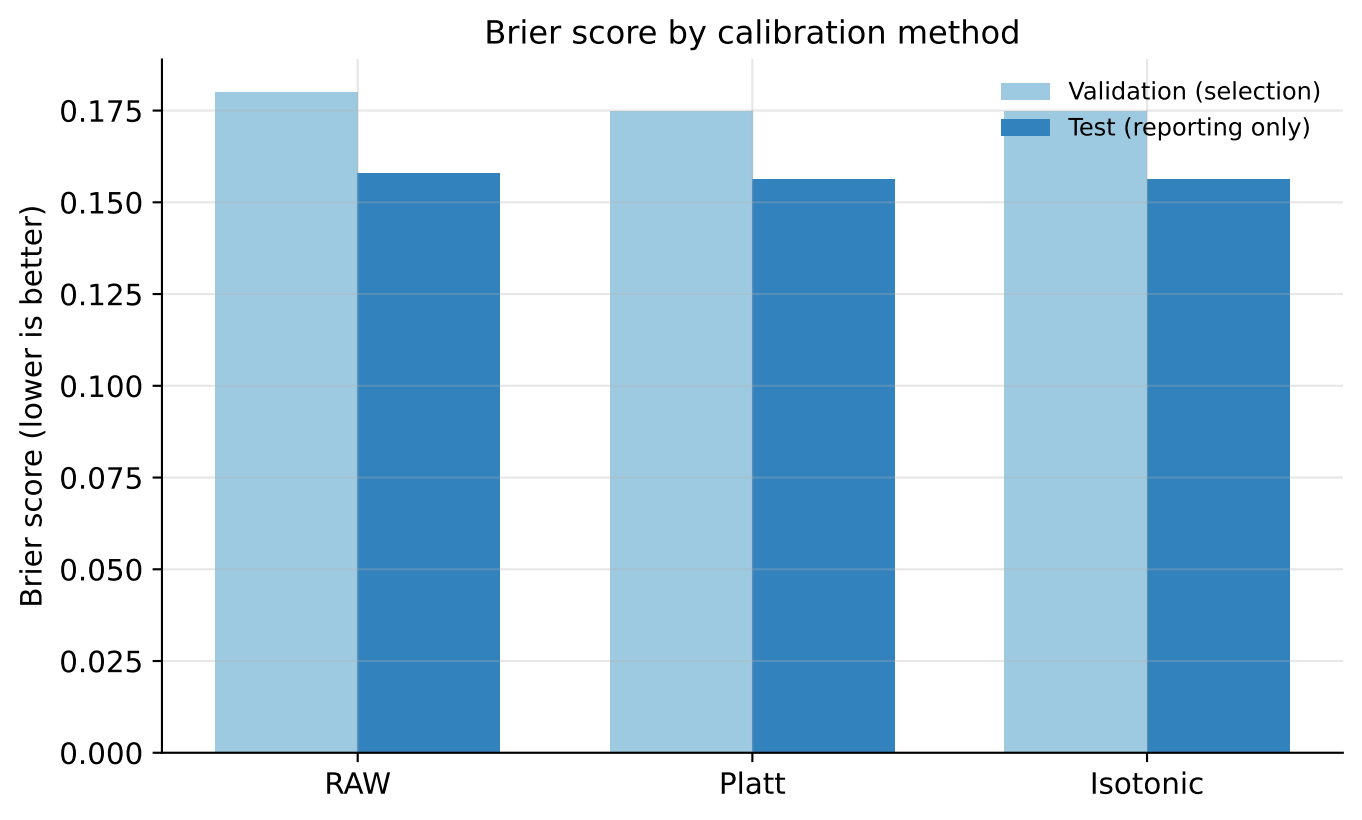
Brier score by calibration method
Validation (selection)
Test (reporting only)
Brier score (lower is better)
0.175
0.150
0.125
0.100
0.075
0.050
0.025
0.000
RAW
Platt
Isotonic