

PROVIDE FM 200 COVERAGE FOR THIS AREA AND PRESSURE RELIEF DAMPERS

MAIN HEADER SHOULD BE CHANGE INTO 100MM. CONTRACTOR TO BE COORDINATE AS PER SITE CONDITION

- REMARKS:
1. ALL DIMENSIONS SHOWN ARE IN MILLIMETER UNLESS OTHERWISE SPECIFIED.
 2. THE CONTRACTOR SHALL VERIFY ALL THE ACTUAL DIMENSIONS ON SITE PRIOR TO CONSTRUCTION OR INSTALLATION OF MATERIALS.
 3. THE CONTRACTOR SHALL NOTIFY DESIGNER IMMEDIATELY FOR ANY DISCREPANCIES FOUND IN THE DRAWINGS.

FIRE PROTECTION LEGEND:	
Symbol	Description
	SELF EXTINGUISHING CYLINDER
	UPRIGHT TYPE SPRINKLER, K-6.8 (RFP) QUICK RESPONSE
	PROPOSED SPRINKLER PIPE
	EXISTING SPRINKLER PIPE
	5kg ABC EXTINGUISHER - RECESSED CABINET
	5kg CO2 FIRE EXTINGUISHER - WALL MOUNTED
	EXISTING ZONE CONTROL VALVE

TO	ISSUED FOR TENDER	GM	MM	10.10.2023
REV	REVISION DESCRIPTION	DWN	CHKD	DATE
DRAWING STATUS				
ISSUED FOR TENDER				



PROJECT TITLE

ENBD - ELECTRA BRANCH

LOCATION

ELECTRA STREET, ABU DHABI, UAE

DRAWING TITLE


GROUND FLOOR
FIRE PROTECTION LAYOUT




contact: +971 4 450 8546 www.broadwayinteriors.com
P.O. Box 31644 1512 Grosvenor Business Tower Burj Khalifa Heights, Dubai, U.A.E.

THIS DRAWING REMAINS THE PROPERTY OF BROADWAY INTERIORS LLC, U.A.E. THIS SHOULD NOT BE COPIED, REPRODUCED, OR DISCLOSED TO ANY PARTY WITHOUT THE WRITTEN CONSENT OF BROADWAY INTERIORS LLC, U.A.E.

DRAWN BY	CHECKED BY	DWG. SCALE	DWG. SIZE
GM	MM	1:100	A3
DRAWING NUMBER		ISSUED DATE	
PU23188-M-FP-GF-100		03 OCT 2023	

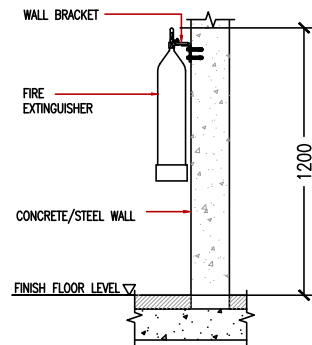


TYPICAL WALL MOUNTING
DETAIL OF EXTINGUISHER

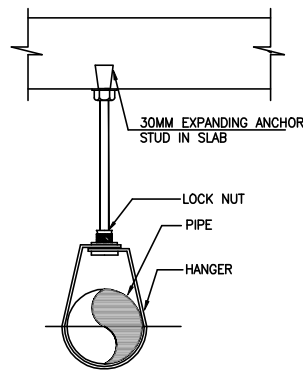

TYPICAL BRANCH PIPE SUPPORT

PIPE SIZE (INCHES)	(mm)	ROD mm
1	(25)	(10)
1 1/4	(32)	(10)
1 1/2	(40)	(10)
2	(50)	(10)
2 1/2	(65)	(10)
3	(80)	(10)
4	(100)	(10)
6	(150)	(12)

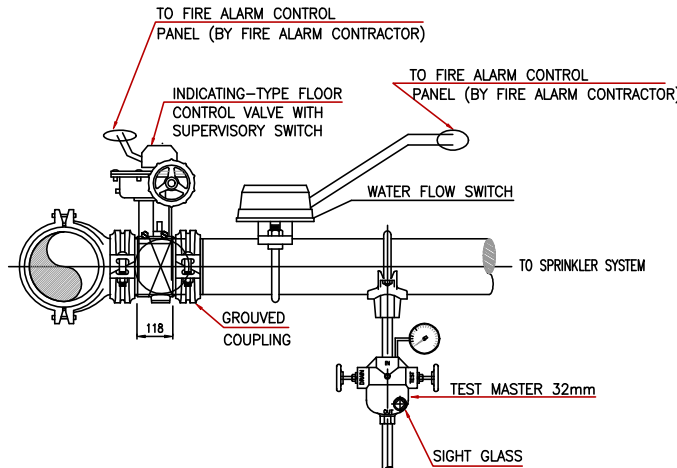

DETAIL OF ZONE CONTROL VALVE