



Terminal block 1

From wall outlet

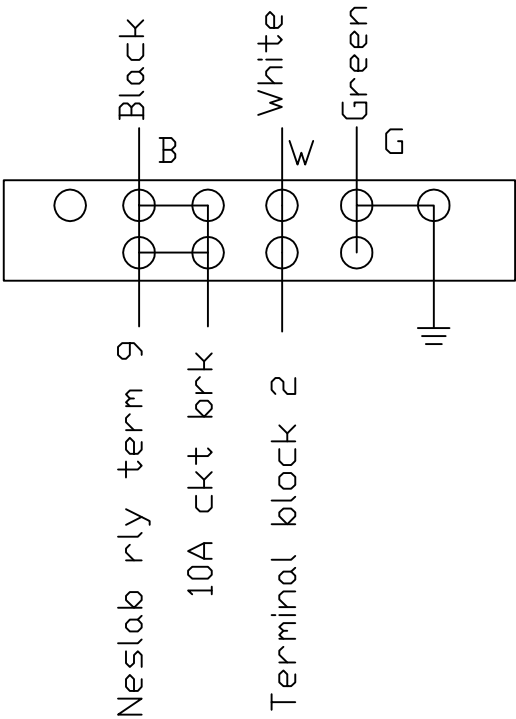

This side is always live and is the terminal block at the rear of the controller.

Terminal blocks for Microcontrolled system

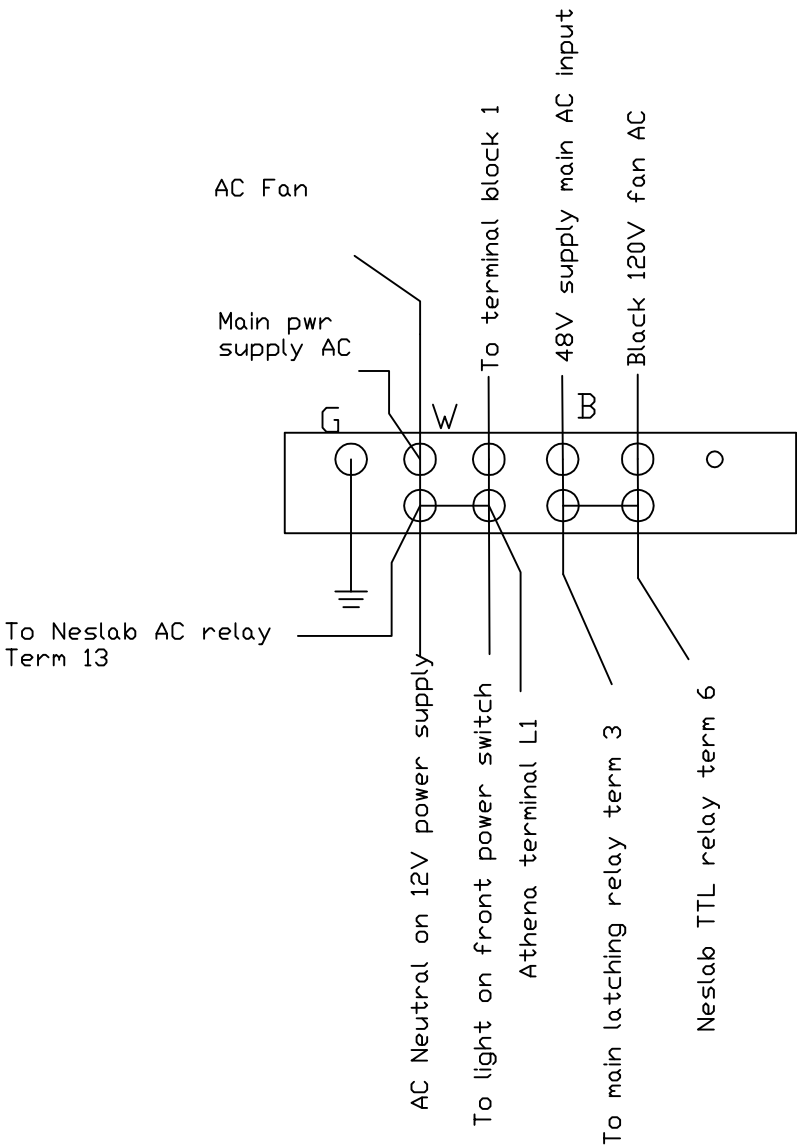

This side is enabled by the latching relay and depending on relay state may not be energized

Terminal block 2