


UNISTRUT OR OTHER  
SUITABLE BRACING A/R



3 POLE DISTRIBUTION BLOCK TO BE  
MOUNTED TO BOTTOM OF  
WIRE TROUGH PER ENCLOSURE.  
LABEL LOCATION WHERE BLOCK IS  
MOUNTED ON OUTSIDE OF COVER.  
AUTOMATION DIRECT PART #HPB309-3  
& HPB309-1 WITH PBC33

A	RTE	INITIAL RELEASE	2/17/11
REV	BY	DESCRIPTION	DATE
REVISIONS			
DRAWN BY:	RTE	SHEET: 2 OF 6	TITLE
CHECKED BY:		DATE: 2/17/11	AP1 - 3RD FLOOR DRYER LAB - WILT CONTROL CABINET
CAD FILE NAME:			REV:
WILT CONTROL CABINET.DWG			A

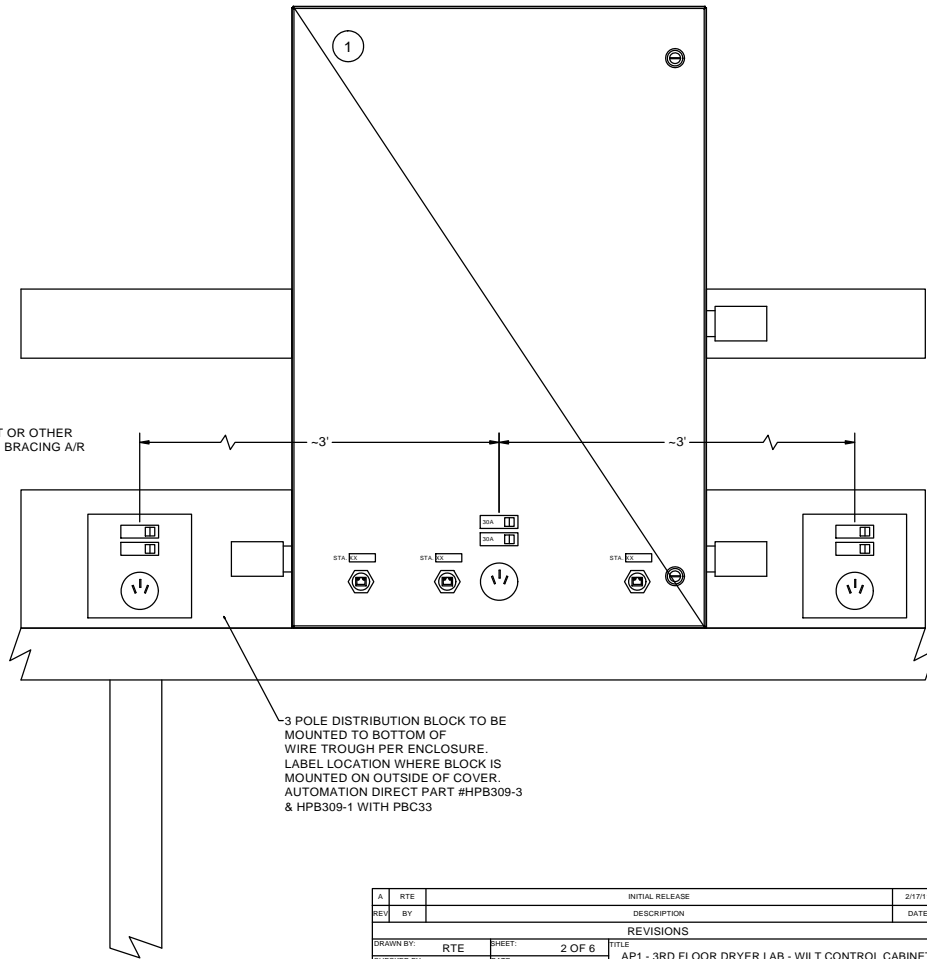