


CP2: D* interval honestly balloons
(qualitative; no GT in vivo)



CP2: D* band widths (synthetic stand-in (NOT in vivo))
monitor: FIRES (AUC 0.84)

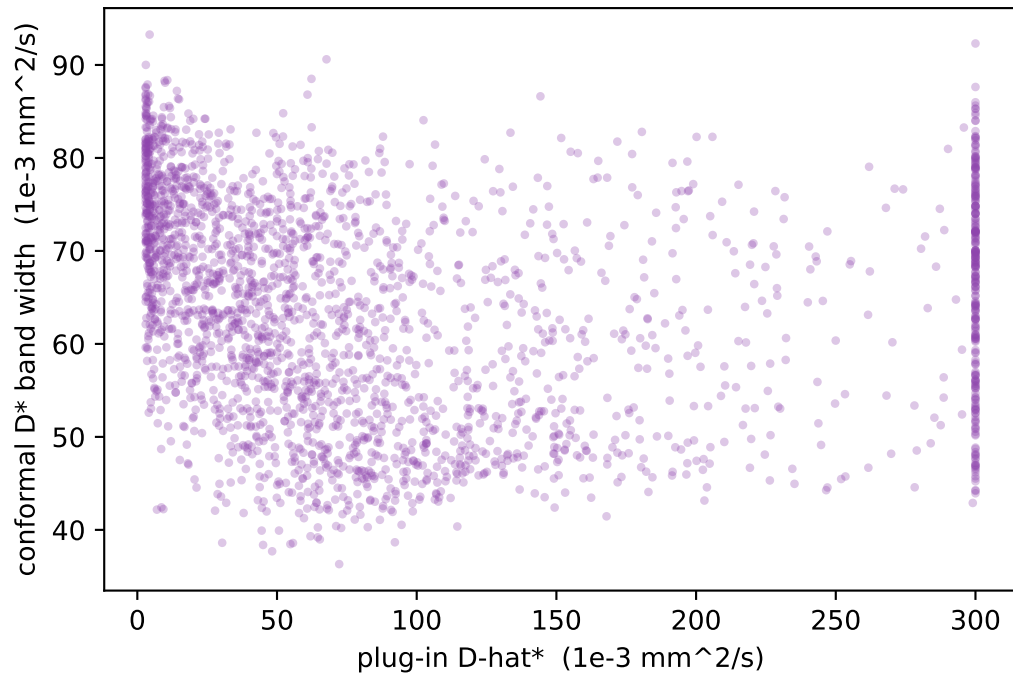