


Gauge in-vivo, qualitative, NO coverage claim (real DWI; $b=\{0,100,600,800\}$ s/mm²)

REAL in-vivo: D* band vs plug-in D-hat*
(qualitative; no coverage claim in vivo)



REAL in-vivo D* band widths (ACRIN-6698)
as-deployed monitor: FIRES (AUC 0.97)

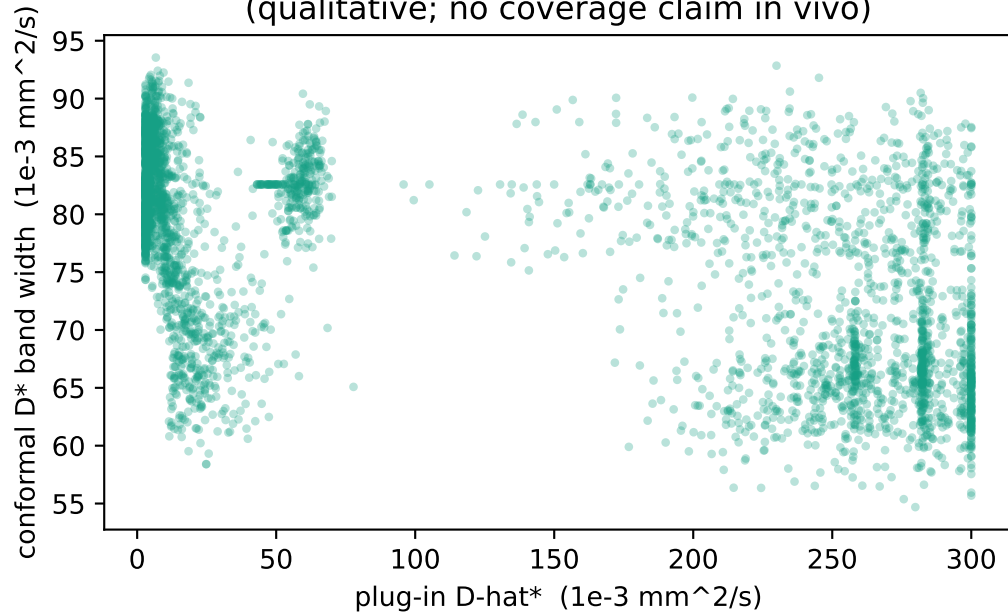