

One pump, one latent space

Label-informed encoders · trained separately where supervision is sufficient · colors = cluster


PUMP-01 · Label-informed AE
validation 0.233 / test 39.8

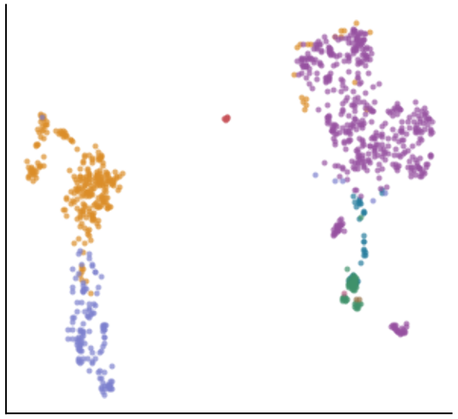

PUMP-02 · Label-informed AE
validation 6.24 / test 1.62

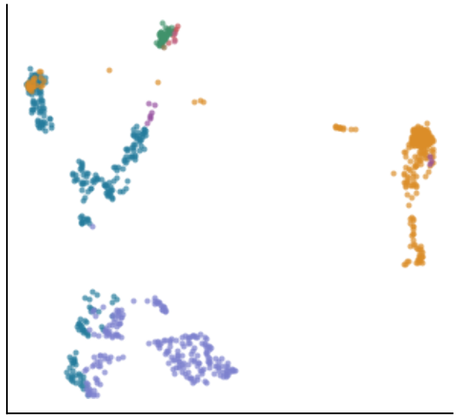

PUMP-03 · Label-informed AE
validation 0.0488 / test 0.0563

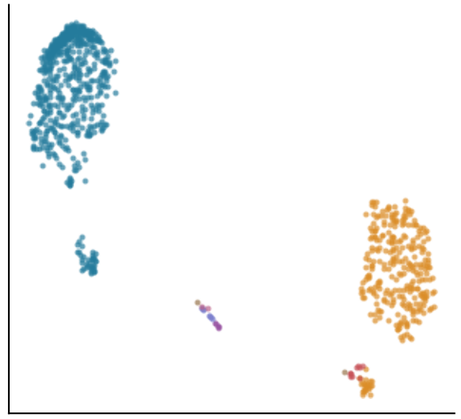


PUMP-04 · Label-informed AE
validation 2.86 / test 2.72




PUMP-05
Label-informed AE unavailable
Fewer than two unambiguous training states

PUMP-06 · Label-informed AE
validation 89.9 / test 1.47

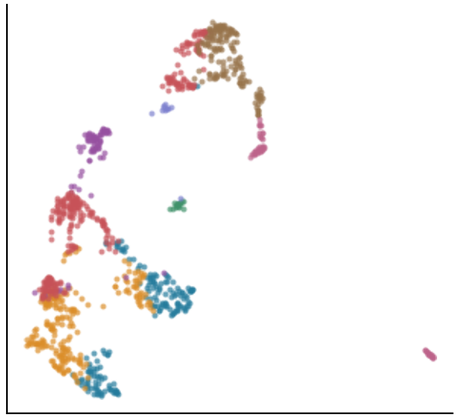

PUMP-07
Label-informed AE unavailable
Fewer than two unambiguous training states

PUMP-08 · Label-informed AE
validation 67.4 / test 286

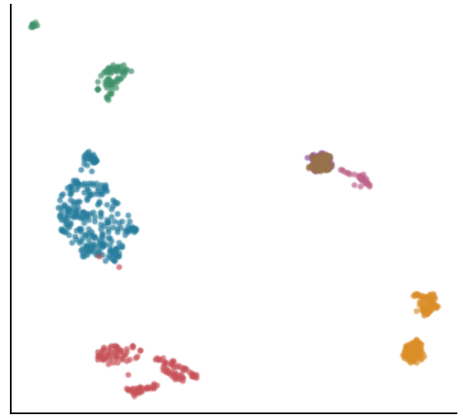

PUMP-09 · Label-informed AE
validation 18.2 / test 48.1



PUMP-10
Label-informed AE unavailable
No public event labels for this pump

PUMP-11
Label-informed AE unavailable
No public event labels for this pump

PUMP-12
Label-informed AE unavailable
No public event labels for this pump

0 1 2 3 4 5 6 7

UMAP fitted to training minutes; held-out minutes transformed. Axes and cluster numbers are local to each pump. Clusters are not fault labels.