




Email : balajifiresafety6@gmail.com

Contact: 9326318479

Fire Equipment Installation | Fire Extinguisher Supply, Refilling, and Servicing | Fire Hydrant System Installation | Sprinkler System Installation | Fire Alarm System Installation | Fire System Annual Maintenance | Contracts and Supply

Sub: - Fire Sprinkler piping formula as per fire norms

S.No	Size of pipes	No of light danger sprinkler	No of medium danger sprinkler
1.	Gi pipe 25mm	2	2
2.	Gi pipe 32mm	3	3
3.	Gi pipe 40mm	5	5
4.	Gi pipe 50mm	10	10
5.	Gi pipe 65mm	30	20
6.	Gi pipe 80mm	60	40
7.	Gi pipe 90mm	100	65
8.	Gi pipe 100mm	125	100
9.	Gi pipe 125mm	it is unnecessary. (over engineering)	160
10.	Gi pipe 150mm	it is unnecessary. (over engineering)	275
11.	Gi pipe 200mm	it is unnecessary. (over engineering)	there is protection area limitation

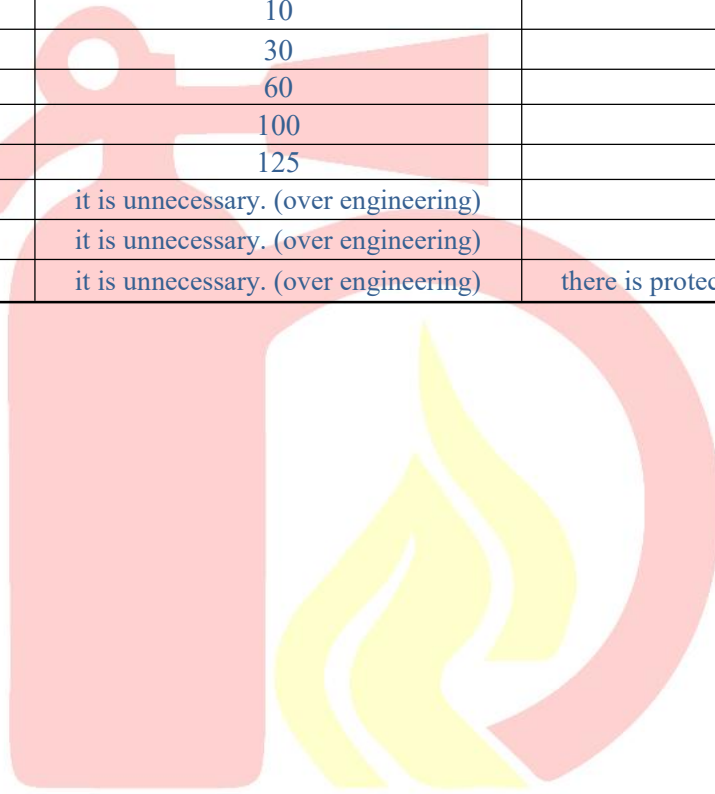

Address:- A/03 Mangalmurti appartment near Matoshri school Ajadegaon Kalyan Thane 421201