AK1 native−ligand interaction fingerprint comparison

Recurrent ISO contacts were compared with the crystallographic AP5 contact environment.

A

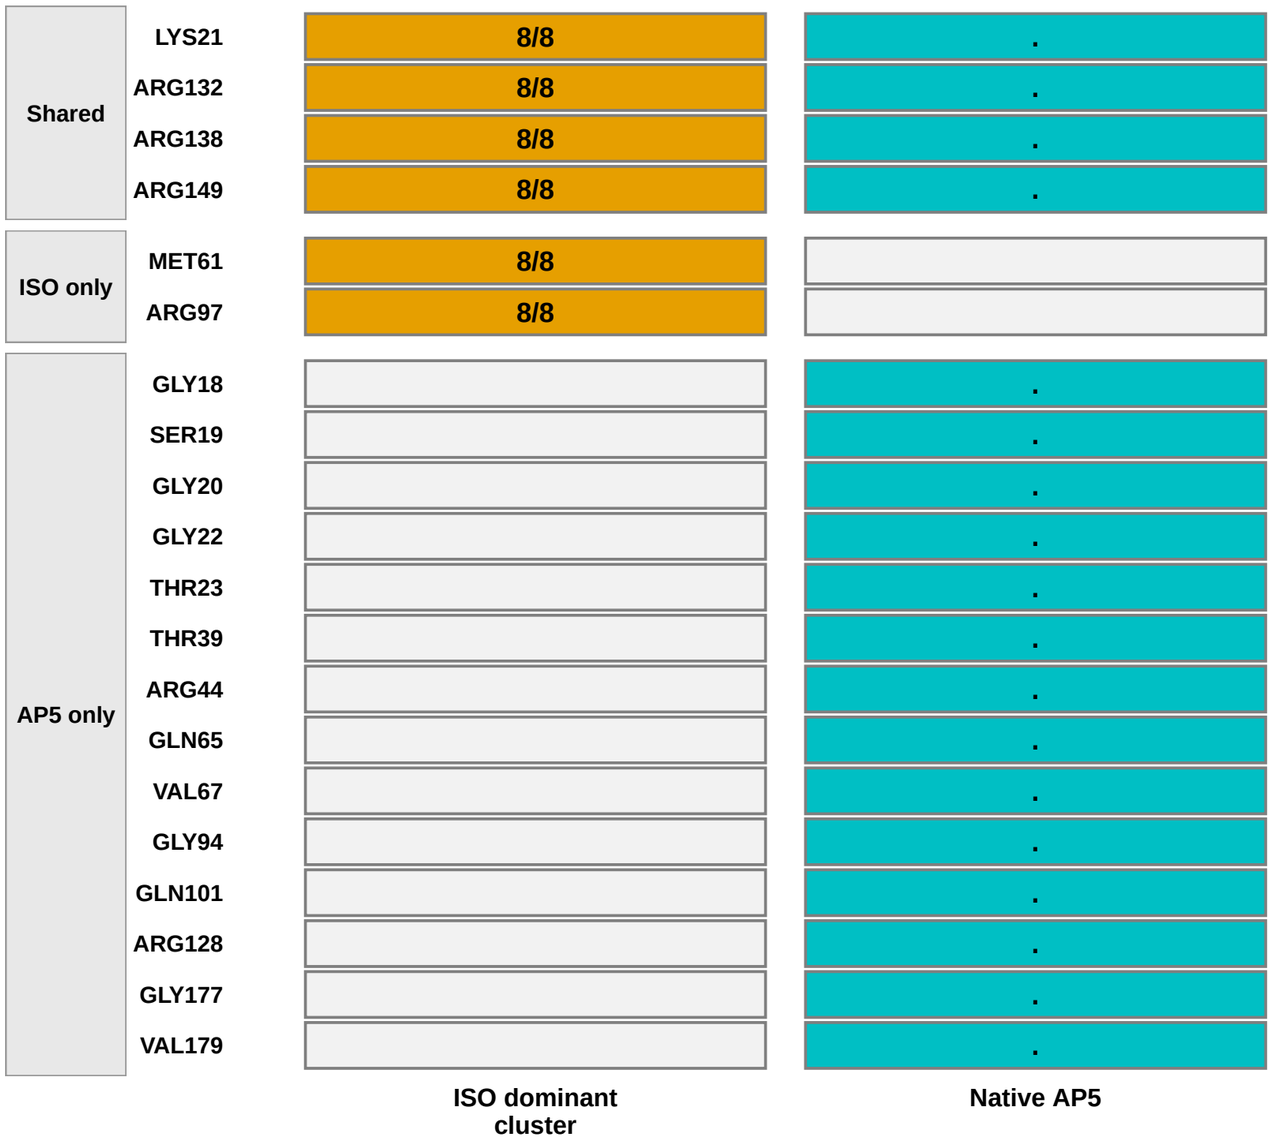
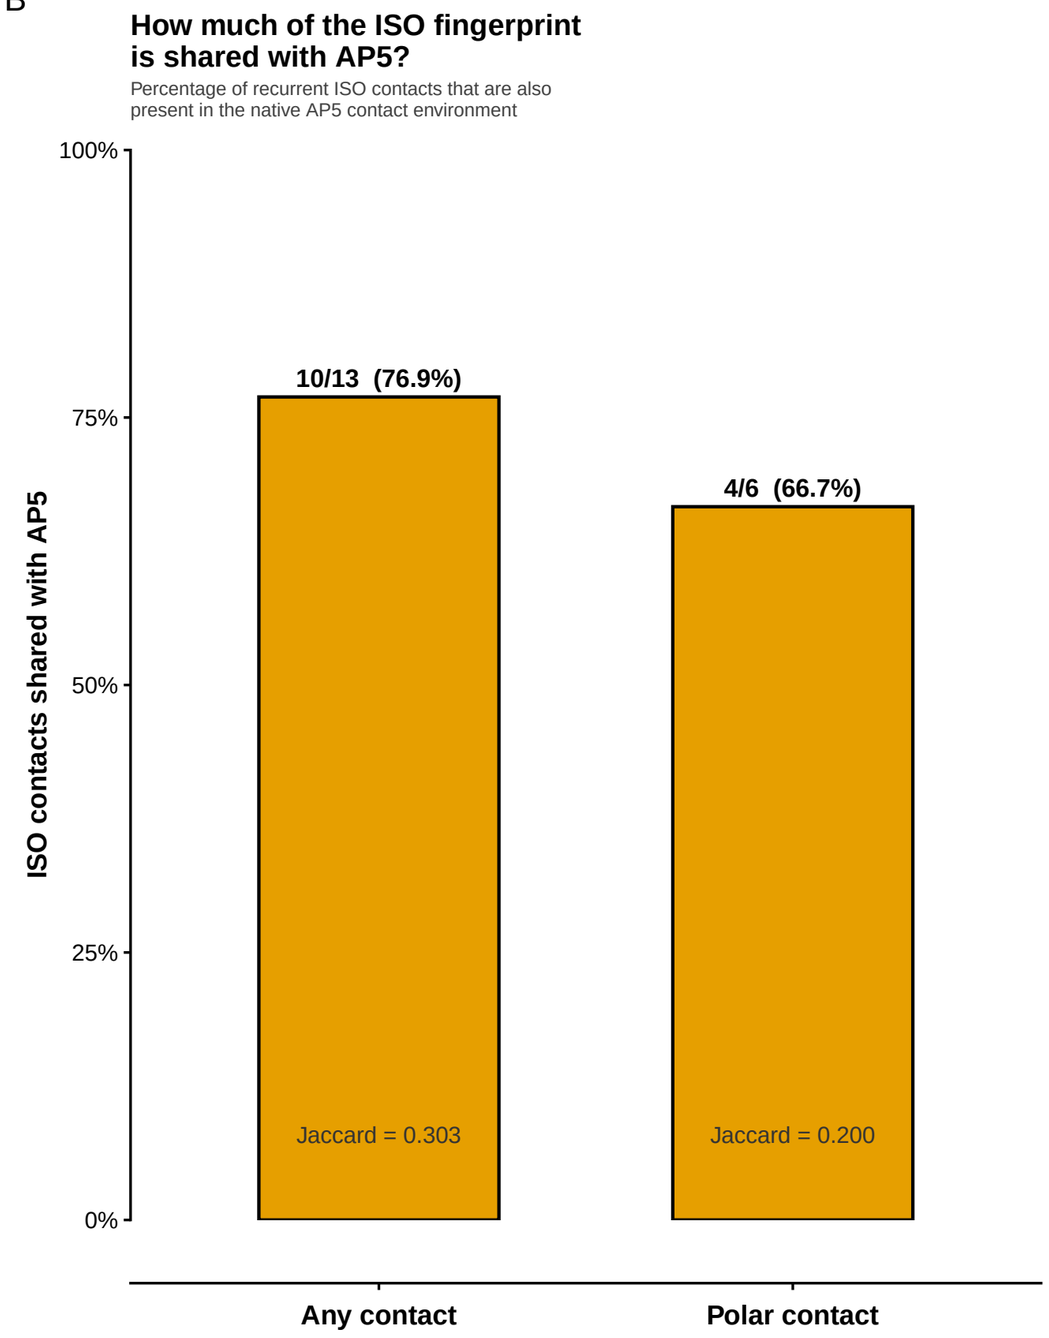
B