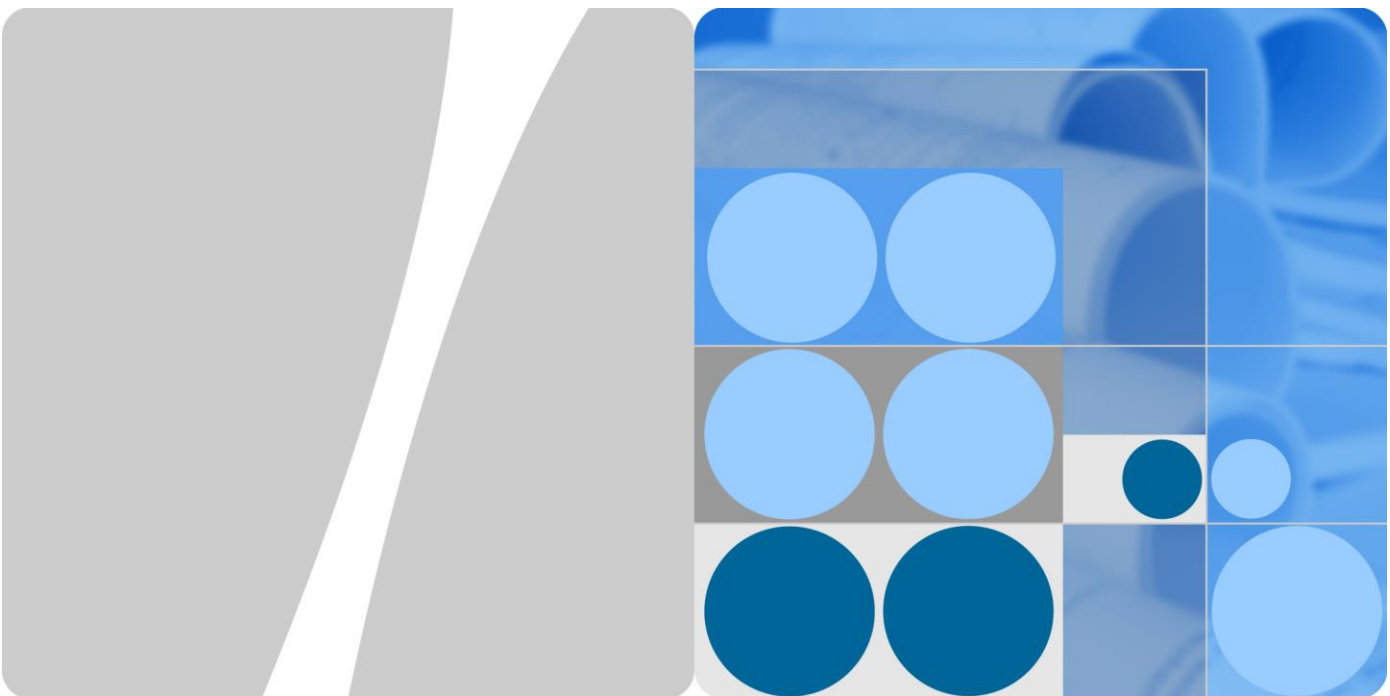




SUN2000 (8KTL-28KTL)

User Manual

Issue **11**
Date **2018-05-20**

HUAWEI TECHNOLOGIES CO., LTD.



Copyright © Huawei Technologies Co., Ltd. 2018. All rights reserved.

No part of this document may be reproduced or transmitted in any form or by any means without prior written consent of Huawei Technologies Co., Ltd.

Trademarks and Permissions



and other Huawei trademarks are trademarks of Huawei Technologies Co., Ltd.

All other trademarks and trade names mentioned in this document are the property of their respective holders.

Notice

The purchased products, services and features are stipulated by the contract made between Huawei and the customer. All or part of the products, services and features described in this document may not be within the purchase scope or the usage scope. Unless otherwise specified in the contract, all statements, information, and recommendations in this document are provided "AS IS" without warranties, guarantees or representations of any kind, either express or implied.

The information in this document is subject to change without notice. Every effort has been made in the preparation of this document to ensure accuracy of the contents, but all statements, information, and recommendations in this document do not constitute a warranty of any kind, express or implied.

Huawei Technologies Co., Ltd.

Address: Huawei Industrial Base
Bantian, Longgang
Shenzhen 518129
People's Republic of China

Website: <http://e.huawei.com>

About This Document

Purpose

This document describes the SUN2000 inverter in terms of its installation, electrical connections, commissioning, maintenance, and troubleshooting. Readers should be familiar with the SUN2000 features and functions and safety precautions provided in this document before installing and operating the SUN2000.

Store the physical documentation shipped with the product properly for future reference.

This document is subject to update and revision. The latest version can be downloaded from <http://e.huawei.com>.

Intended Audience

This document is intended for photovoltaic (PV) plant operators and qualified electrical technical personnel.

Symbol Conventions

The symbols that may be found in this document are defined as follows.

Symbol	Description
 DANGER	Indicates an imminently hazardous situation which, if not avoided, will result in death or serious injury.
 WARNING	Indicates a potentially hazardous situation which, if not avoided, could result in death or serious injury.
 CAUTION	Indicates a potentially hazardous situation which, if not avoided, may result in minor or moderate injury.
 NOTICE	Indicates a potentially hazardous situation which, if not avoided, could result in equipment damage, data loss, performance deterioration, or unanticipated results. NOTICE is used to address practices not related to personal injury.

Symbol	Description
 NOTE	Calls attention to important information, best practices and tips. NOTE is used to address information not related to personal injury, equipment damage, and environment deterioration.

Change History

Changes between document issues are cumulative. The latest document issue contains all the changes made in earlier issues.

Issue 11 (2018-05-20)

Updated [5.3 Connecting DC Input Power Cables](#).

Updated [8.3 Troubleshooting](#).

Issue 10 (2017-07-30)

Updated certain content of [5.4.1 Communications Ports](#).

Updated [10 Technical Specifications](#).

Issue 09 (2017-02-21)

Updated certain content of [4.3 Determining the Installation Position](#).

Updated certain content of [8.2 Routine Maintenance](#).

Issue 08 (2015-12-08)

Deleted descriptions about the SUN2000-24.5KTL.

Updated descriptions in [5.2 Connecting AC Output Power Cables](#).

Updated descriptions in [7.2.1 Viewing System Operating Information](#).

Added the **On-grid recovery time** parameter to [7.2.9 Setting Protection Parameters](#).

Added parameters **RCD enhancing** and **K-factor** to [7.2.10 Setting Feature Parameters](#).

Added [7.2.16 Resetting Alarms](#).

Added [7.2.17 Resetting the System](#).

Updated [B Power Grid Codes](#).

Issue 07 (2014-07-30)

Added [4.4 Support-mounting the SUN2000](#).

Supplemented AC power cable specifications and models.

Modified the start time of the warranty period.

Issue 06 (2014-06-05)

Added descriptions about the SUN2000-24.5KTL.

Added more precautions for **Installation** and **Maintenance and Replacement** in [1 Safety Precautions](#).

Added [3 SUN2000 Storage](#).

Added more maintenance items to [8.2 Routine Maintenance](#).

Added [B Power Grid Codes](#).

Issue 05 (2014-03-25)

Added cable types and precautions for cable connections in [5.3 Connecting DC Input Power Cables](#).

Modified the output power of the inverter at different temperatures in **General Data** in [10 Technical Specifications](#).

Issue 04 (2013-11-25)

Added description about the SUN2000-23KTL.

Issue 03 (2013-10-11)

Added descriptions about the SUN2000-28KTL.

Issue 02 (2013-06-08)

This issue is the second official release.

Issue 01 (2013-04-26)

This issue is the first official release.

Contents

About This Document	ii
1 Safety Precautions	1
2 Overview	4
2.1 Introduction	4
2.2 Appearance	6
2.3 Label Conventions	8
2.4 Monitoring Panel	10
2.5 Working Principles	13
3 SUN2000 Storage	17
4 Installation	18
4.1 Checking Before Installation	18
4.2 Tools	20
4.3 Determining the Installation Position	23
4.4 Support-mounting the SUN2000	27
4.5 Wall-mounting the SUN2000	32
5 Electrical Connections	41
5.1 Connecting PGND Cables	41
5.2 Connecting AC Output Power Cables	44
5.3 Connecting DC Input Power Cables	51
5.4 Connecting Communications Cables	58
5.4.1 Communications Ports	58
5.4.2 Connecting RS485 Communications Cables	60
6 System Operation	64
6.1 Checking Before Power-On	64
6.2 Powering On the SUN2000	64
6.3 Setting Initialization Parameters	65
7 Man-Machine Interaction	68
7.1 Monitoring Menu Hierarchy	68
7.2 Monitoring Operations	71
7.2.1 Viewing System Operating Information	71

7.2.2 Viewing Alarm Records	76
7.2.3 Setting System Time	79
7.2.4 Setting the System Language	81
7.2.5 Setting the Contrast	83
7.2.6 Setting the Currency and Currency Factor	85
7.2.7 Changing a User Password	87
7.2.8 Setting Communications Parameters	89
7.2.9 Setting Protection Parameters	91
7.2.10 Setting Feature Parameters	93
7.2.11 Setting Isolation Parameters	95
7.2.12 Manually Starting and Shutting down the SUN2000	97
7.2.13 Restoring Factory Settings	99
7.2.14 Enabling USB Guide Functions	101
7.2.15 Cleaning the User Data	104
7.2.16 Resetting Alarms	106
7.2.17 Resetting the System	107
7.2.18 Viewing the System Version	109
8 Maintenance	111
8.1 Powering Off the SUN2000	111
8.2 Routine Maintenance	112
8.3 Troubleshooting	113
9 SUN2000 Handling	121
9.1 SUN2000 Removal	121
9.2 SUN2000 Packing	121
9.3 Disposing the SUN2000	121
10 Technical Specifications	122
A Acronyms and Abbreviations	130
B Power Grid Codes	132

1 Safety Precautions

Strictly follow all the safety precautions in this document to prevent personal injury or death.

Personnel Requirements

- Only qualified and trained electrical technicians are allowed to operate the SUN2000.
- Operators should understand the components and functioning of a grid-tied PV power system, and they should be familiar with relevant local standards.

Label Protection

- Do not tamper with any warning signs on the SUN2000 enclosure because these signs contain important information about safe operation.
- Do not remove or damage the nameplate on the SUN2000 enclosure because it contains important product information.

Installation



DANGER

Ensure that DC and AC power supplies are disconnected before operations.



NOTICE

Read this document before installation. Huawei shall not be liable for any consequence caused by violation of the regulations specified in this document.

- Shield the PV modules with opaque cloth before connecting cables to the SUN2000.
- Ensure that the SUN2000 is not connected to a power supply and is not powered on before starting installation.
- Ensure that there are no objects within 200 mm of both sides of the SUN2000, and no objects within 500 mm, 600 mm, and 1000 mm of the top, bottom, and front, respectively. This is to allow sufficient space for installation and heat dissipation.

- Install the SUN2000 in an environment with good ventilation to ensure efficient and long-term system performance.
- Ensure that the SUN2000 heat sinks are free from blockage.
- Do not touch any components except the wiring terminals at the bottom inside the enclosure.

Electrical Connection



DANGER

Before connecting cables to the SUN2000, ensure that the SUN2000 is securely positioned and not damaged in any way. Otherwise, electrical shock or fire may occur.

-
- Ensure that all electrical connections comply with local electrical standards.
 - Obtain approval from the local power supply department before using the SUN2000 to generate electricity in grid-tied mode.
 - Ensure that the cables to the solar power system are properly connected and insulated and meet specifications. Confirm that the insulation resistance between the ground and the main circuit formed by the PV module strings, the SUN2000, and protective devices is at least 1 megohm.

Operation



DANGER

High voltage may cause electrical shock or death during operation. Strictly comply with the safety precautions in this document and associated documents when operating the SUN2000.

-
- Do not disconnect the DC power supply during the SUN2000 operation.
 - Do not touch parts of the SUN2000 other than the liquid crystal display (LCD) and **DC SWITCH**. The SUN2000 enclosure and heat sinks are extremely hot when the SUN2000 is in operation and touching these parts can cause severe burns and personal injury.
 - Ensure that only qualified personnel are allowed to set initialization parameters during the first power-on of the SUN2000. Incorrect settings may affect the SUN2000 operation and cause the SUN2000 to conflict with local certifications.
 - Follow local laws and regulations when operating the device.

Maintenance and Replacement

- Before performing maintenance tasks, power off the SUN2000 by referring to [8.1 Powering Off the SUN2000](#). Then wait for at least 5 minutes before performing operations on the SUN2000.
- Place temporary warning signs or erect fences to prevent unauthorized access to the maintenance site.

- Rectify any faults that may compromise the SUN2000 security performance before restarting the SUN2000.
- A faulty SUN2000 requires overall maintenance. Contact the dealer if the SUN2000 is faulty.
- Maintain the SUN2000 with sufficient knowledge of this document and proper tools and testing equipment.
- Wear electrostatic discharge (ESD) gloves and comply with ESD protection regulations when maintaining the SUN2000.

2 Overview

This chapter introduces the SUN2000 and describes its functioning, appearance, label conventions, and monitoring panel.

2.1 Introduction

This section describes the functions, models, and application of the SUN2000.

Function

The SUN2000 is a three-phase grid-tied PV string inverter. It converts DC power generated by PV strings into AC power and then feeds the AC power into the power grid.

Models

Figure 2-1 shows how to read the SUN2000 model number, using SUN2000-17KTL as an example.

Figure 2-1 Model number description

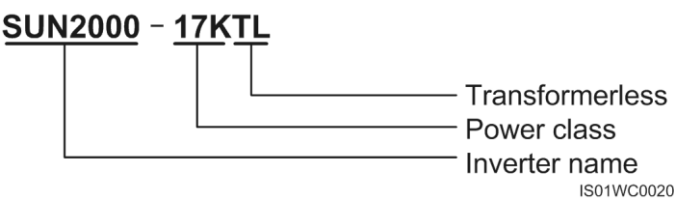


Table 2-1 lists all the models of the SUN2000 and their rated output power.

Table 2-1 SUN2000 models and rated output power

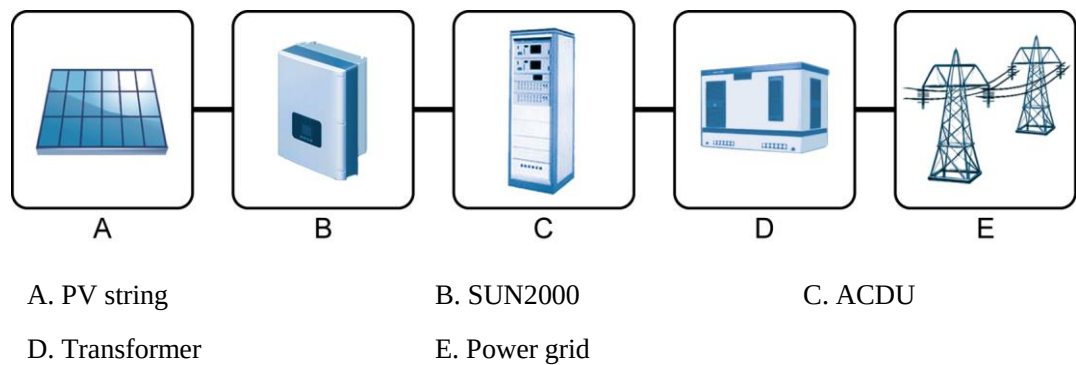
Model	Rated Output Power
SUN2000-8KTL	8 kW
SUN2000-10KTL	10 kW

Model	Rated Output Power
SUN2000-12KTL	12 kW
SUN2000-15KTL	15 kW
SUN2000-17KTL	17 kW
SUN2000-20KTL	20 kW
SUN2000-23KTL	23 kW
SUN2000-28KTL	27.5 kW

Network Application

The SUN2000 applies to grid-tied PV power systems for commercial rooftops and large power stations. A typical grid-tied PV power system consists of PV strings, grid-tied inverters, and AC distribution units (ACDUs), as shown in [Figure 2-2](#).

Figure 2-2 SUN2000 network application



NOTE

A model in the range from SUN2000-8KTL to SUN2000-23KTL can connect to the low-voltage power grid directly without connecting to a transformer.

Power Grid Modes for the SUN2000

All SUN2000 models except the SUN2000-28KTL support the power grid modes TN-S, TN-C, TN-C-S, and TT, as shown in [Figure 2-3](#). The SUN2000-28KTL supports the IT mode, as shown in [Figure 2-4](#).

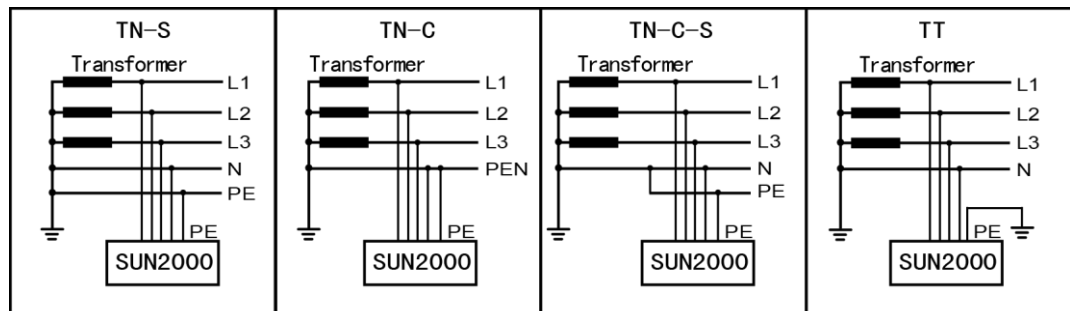


NOTICE

- The valid neutral-ground voltage for the TT grid mode must be less than 30 V.
- The SUN2000-28KTL applies to medium-voltage and low-voltage power grids. If the output voltage of the SUN2000 (three-phase, with a PE cable, 480 V) does not match the power grid voltage, connect a transformer to adapt to the power grid voltage.

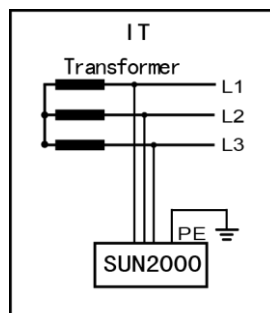
For example, if the SUN2000 is connected to a low-voltage power grid (three-phase, with an N cable and a PE cable, 400 V), a transformer is required to convert the 480 V voltage to the 400 V voltage.

Figure 2-3 Power grid modes supported by all SUN2000 models except the SUN2000-28KTL



IS01SC0004

Figure 2-4 Power grid mode supported by the SUN2000-28KTL



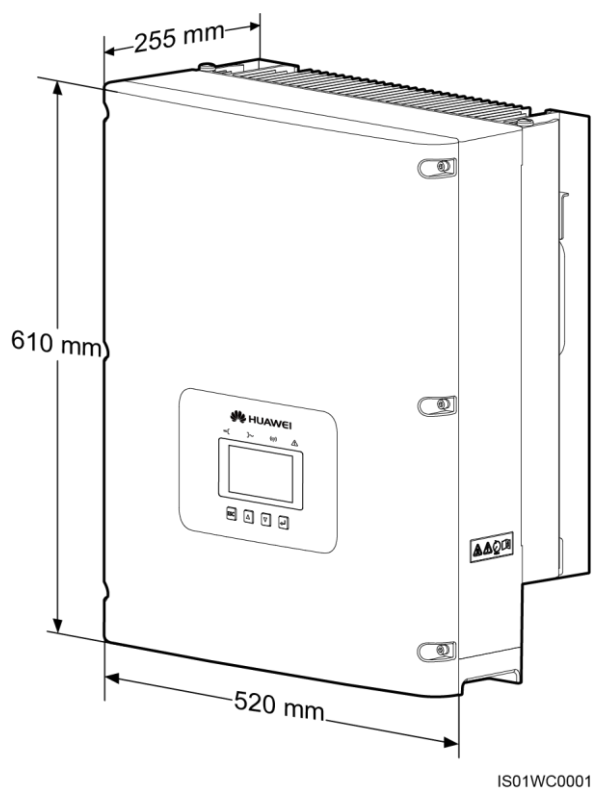
IS01SC0005

2.2 Appearance

This section describes the appearance and specifications of the SUN2000.

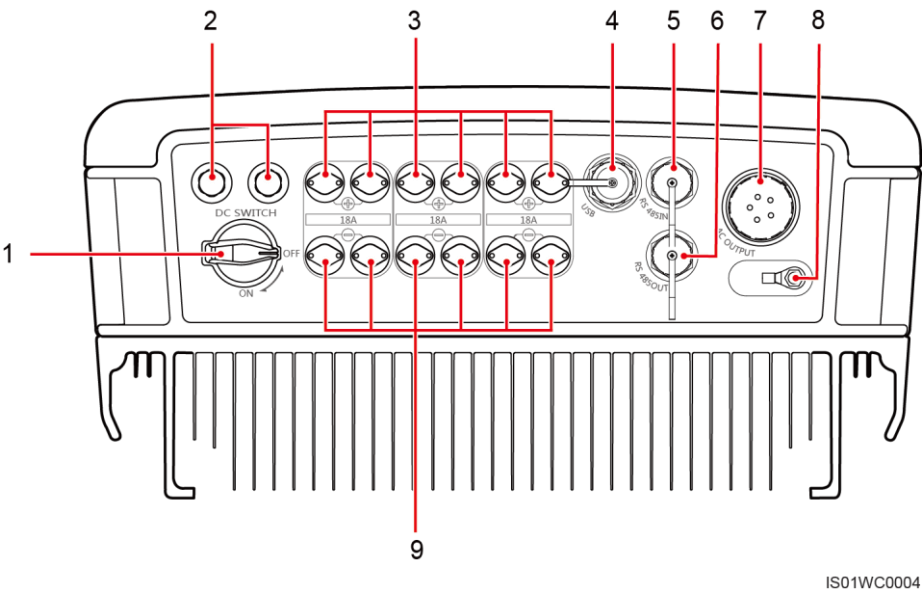
External Dimensions

Figure 2-5 Appearance



Bottom View

Figure 2-6 Ports



- | | | |
|------------------------|-----------------------------------|-----------------------------------|
| (1) DC switch | (2) Ventilation valves | (3) DC input terminals (positive) |
| (4) USB port | (5) RS485 IN port | (6) RS485 OUT port |
| (7) AC output terminal | (8) Protective earthing (PE) bolt | (9) DC input terminals (negative) |

2.3 Label Conventions


This section describes the symbols on the SUN2000 and the nameplate.

Symbols

Table 2-2 describes all symbols on the SUN2000.

Table 2-2 Symbols

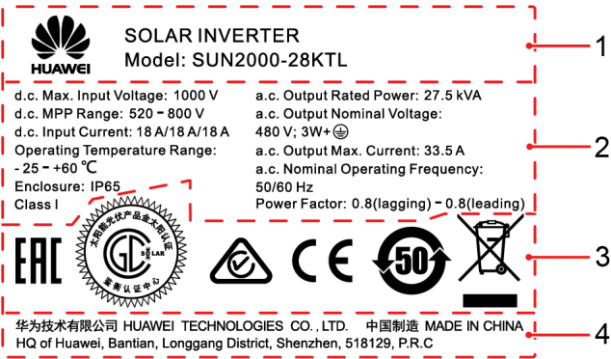
Symbol	Label	Meaning
	Danger high voltage	The SUN2000 operates at high voltage. All operations on the SUN2000 may only be carried out by a trained electrician.

Symbol	Label	Meaning
	Delay discharge	Any residual voltage in the SUN2000 takes 5 minutes to fully discharge.
	Burn warning	The SUN2000 must not be touched when in operation because its enclosure and heat sinks are extremely hot.
	Refer to documentation	Remind operators to refer to the documentation shipped with the SUN2000.
	Grounding	The SUN2000 must be connected to a ground bar for grounding purposes.
	Operation warning	The DC input connector must not be removed when the SUN2000 is in operation.

Nameplate

Figure 2-7 shows the SUN2000 nameplate, which contains the model information, technical specifications, and compliance symbols.

Figure 2-7 Nameplate



- (1) Trademark, product name, and model number
- (2) Technical specifications
- (3) Compliance symbols
- (4) Company name and country of manufacture



NOTE

The nameplate figure is for reference only. The actual nameplate prevails.

Table 2-3 describes the compliance symbols.

Table 2-3 Compliance symbols on the nameplate

Symbol	Name	Meaning
	CGC-Solar certification mark	The SUN2000 complies with CGC-Solar certification standards. Note: The SUN2000-8KTL, SUN2000-10KTL, and SUN2000-12KTL do not feature.
	CE certification mark	The SUN2000 complies with CE certification standards.
	Environmentally friendly use period (EFUP)	The SUN2000 is environmentally friendly for at least 50 years.
	EU WEEE mark	The SUN2000 must not be disposed of as domestic waste.

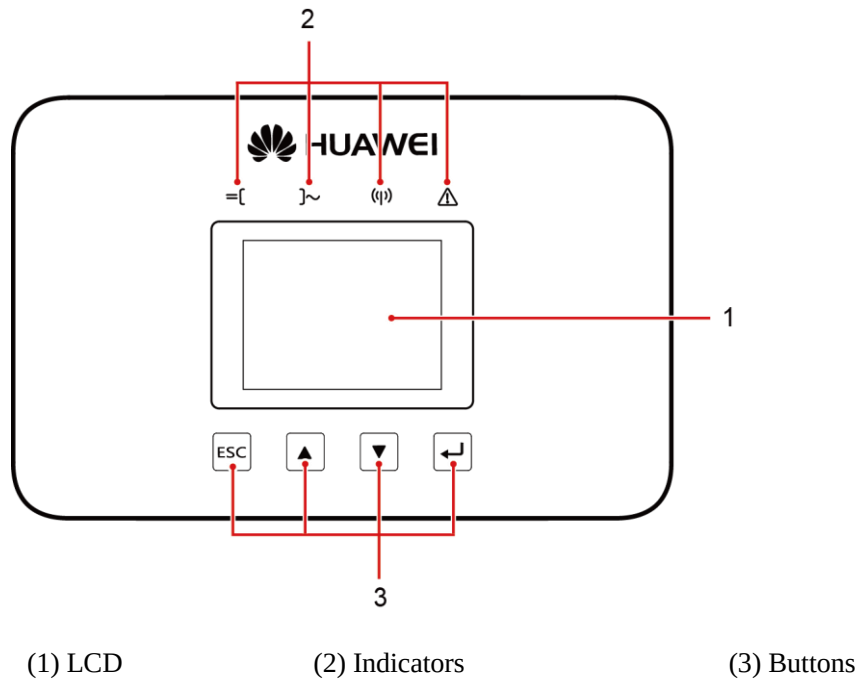
2.4 Monitoring Panel

This section describes the monitoring panel, including the LCD, LED indicators, buttons, and the default screen displayed on the LCD.

Appearance

The monitoring panel has an LCD, four indicators, and four buttons, as shown in Figure 2-8.

Figure 2-8 Monitoring panel



NOTE

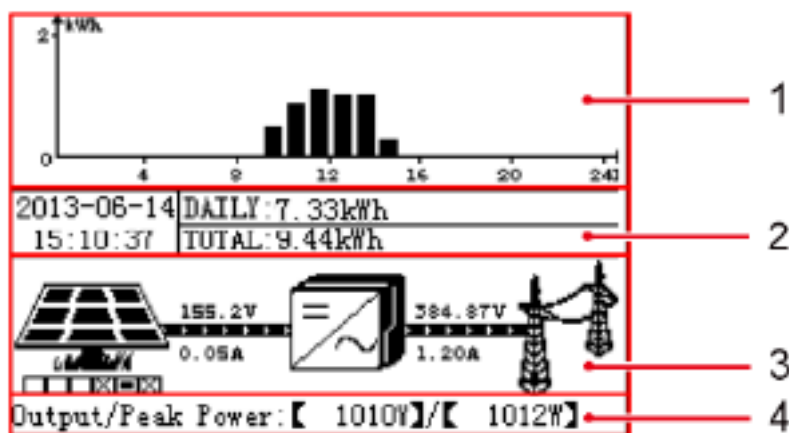
The LCD displays SUN2000 operating data such as input power, output power, energy yield, and alarms. The indicators show the SUN2000 operating status.

LCD

The LCD displays the SUN2000 data in graphics and text, including the operating information, alarm information, system parameters, and user parameters.

If no button is pressed within 90s on a non-default screen, the LCD automatically displays the default screen, which is shown in [Figure 2-9](#).

Figure 2-9 Default page



(1) Energy yield histogram	The energy yield for each hour of the current day.
(2) Energy yield data	• The current date and time. • The total energy yield for the current day from 00:00 to the current time. • The total energy yield from the initial startup to the current time.
(3) Power flow diagram	• The number of PV string inputs. This is represented by the row of boxes under the PV module icon. – A box with a cross indicates a PV string that is not connected or has low power. – A box marked white or black indicates a PV string that is working normally. • The power flow from the PV strings to the SUN2000 and the voltage and current of each input. • The power flow from the SUN2000 to the power grid and the voltage and current of each output. – All models except the SUN2000-28KTL display the effective phase voltage and current of the SUN2000 three-phase output. – The SUN2000-28KTL displays the effective line voltage and current. NOTE The system displays the voltage and current from the PV string corresponding to the box marked black and switches between the connected PV strings every 10 seconds. Manual switching can be performed by pressing ▲ and ▼.
(4) Output/Peak power	The output power and peak power of the SUN2000.

Indicators

Table 2-4 describes the four indicators on the SUN2000 monitoring panel.

Table 2-4 Indicator description

Indicator	State	Meaning
PV connection indicator 	Steady green	The SUN2000 is properly connected to at least one PV string.
	Off	The SUN2000 is disconnected from all PV strings.
Grid-tie indicator 	Steady green	The SUN2000 is properly connected to the power grid.
	Off	The SUN2000 is disconnected from the power grid.

Indicator	State	Meaning
Communications indicator 	Blinking green fast (on for 0.5s and then off for 0.5s for three times at an interval of 10s)	The SUN2000 is communicating properly.
	Off	No communication is in progress or the communication is abnormal.
Alarm indicator 	Steady red	The SUN2000 generates a major alarm. For details, see 7.2.2 Viewing Alarm Records .
	Blinking red at short intervals (on for 0.5s and then off for 0.5s)	The SUN2000 generates a minor alarm. For details, see 7.2.2 Viewing Alarm Records .
	Blinking red at long intervals (on for 1s and then off for 4s)	The SUN2000 has generated a warning. For details, see 7.2.2 Viewing Alarm Records .

Buttons

[Table 2-5](#) describes the four buttons on the SUN2000 monitoring panel.

Table 2-5 Button description

Button	Name
ESC	Escape
	Up
	Down
	Confirm



NOTE

The backlight lasts for 60s after any button is pressed.

2.5 Working Principles

This section describes the circuit diagrams and working modes of the SUN2000.

Conceptual Diagrams

- The SUN2000-15KTL, SUN2000-17KTL, SUN2000-20KTL, SUN2000-23KTL, and SUN2000-28KTL receive inputs from six PV strings. The inputs are then grouped into

three maximum power point tracking (MPPT) routes inside the SUN2000 to track the maximum power point of the PV strings.

- The SUN2000-8KTL, SUN2000-10KTL, and SUN2000-12KTL receive inputs from four PV strings. The inputs are then grouped into two MPPT routes inside the SUN2000 to track the maximum power point of the PV strings.

The DC power is then converted into three-phase AC power through a converter circuit. There is surge protection for both DC and AC sides. Figure 2-10, Figure 2-11, and Figure 2-12 show the circuit diagrams for the different models.

Figure 2-10 Conceptual diagram for the SUN2000-8KTL, SUN2000-10KTL, and SUN2000-12KTL

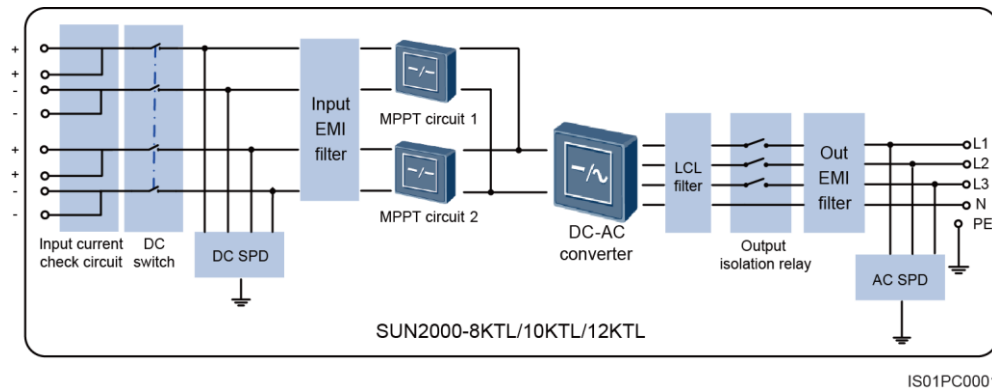


Figure 2-11 Conceptual diagram for the SUN2000-15KTL, SUN2000-17KTL, SUN2000-20KTL, and SUN2000-23KTL

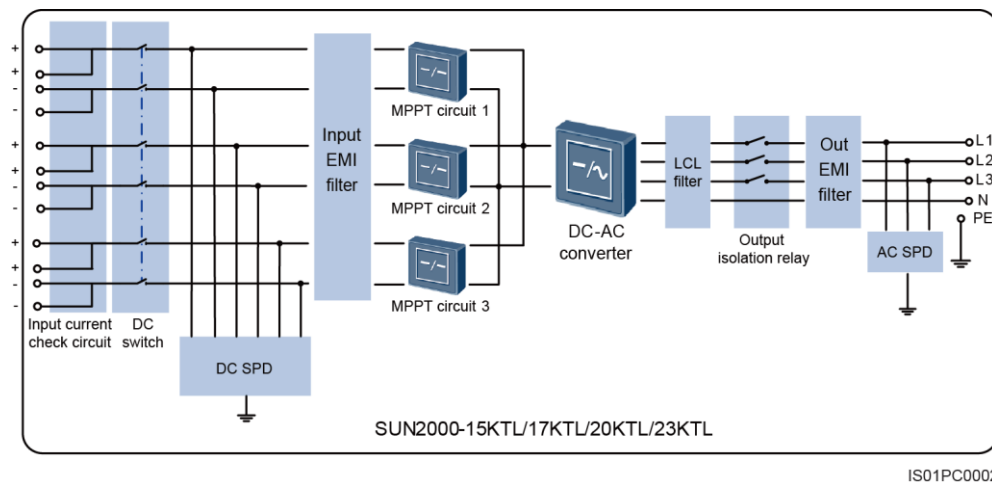
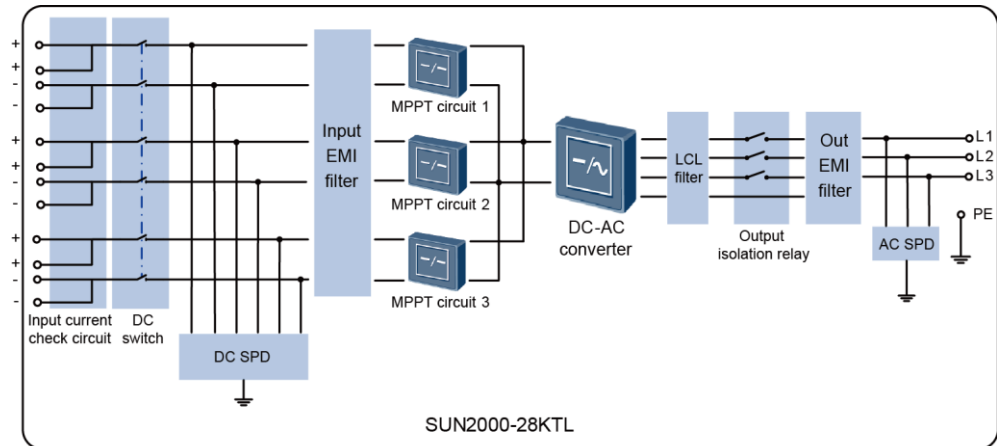


Figure 2-12 Circuit diagram for the SUN2000-28KTL



IS01PC0010

Each component of the SUN2000 works as follows:

- The input current check circuit determines the operating status of each PV string and generates an alarm prompting for repair if a PV string is not working properly.
- The DC switch can be used to disconnect internal circuits from the DC input of the SUN2000 to facilitate manual operations during maintenance.
- The class II DC surge protective device (SPD) provides a discharge loop for DC overvoltage to protect SUN2000 internal circuits against the impact of power surges.
- The input and output electromagnetic interference (EMI) filters remove EMI from the SUN2000 to meet electromagnetic compatibility requirements.
- The MPPT circuits measure the voltage and current of the PV strings in real time and track the maximum power point to ensure maximum output power of the system.
- The DC-AC converter circuit converts DC power into AC power which is then fed to the power grid with equivalent output frequency and voltage.
- The LCL filter removes high-frequency components from the output current of the SUN2000 to ensure that the output current meets power grid requirements.
- The output isolation relay isolates the AC output of the SUN2000 from the power grid if either of them is faulty.
- The class II AC SPD provides a discharge loop for AC overvoltage to protect the SUN2000 internal circuits against the impact of power surges.

Working Modes

Figure 2-13 shows the changes in conditions that cause the SUN2000 to switch between working modes.

Figure 2-13 Working modes

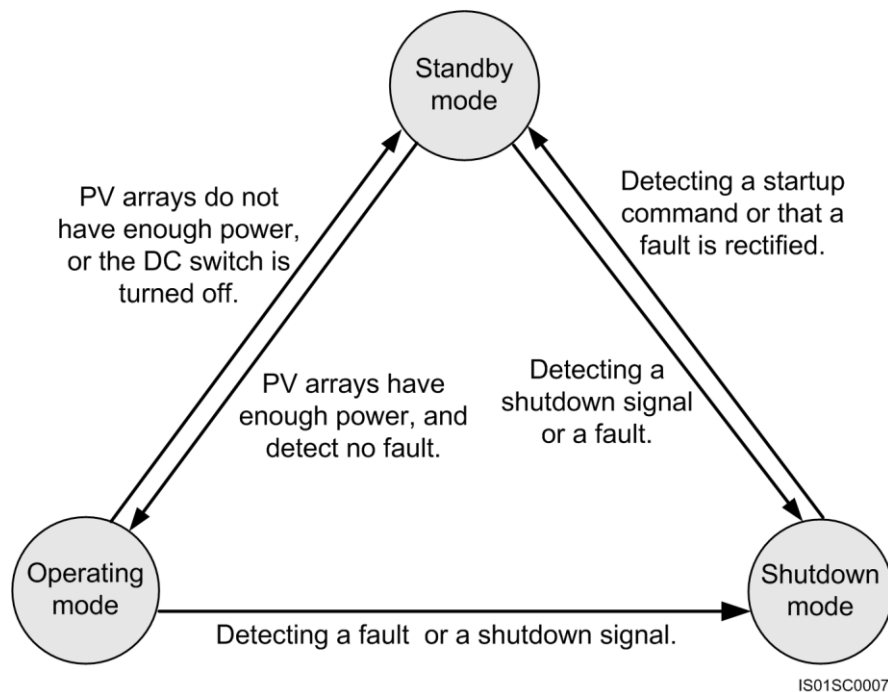


Table 2-6 describes the working modes shown in Figure 2-13.

Table 2-6 Working mode description

Working Mode	Description
Standby	The SUN2000 enters standby mode when the external environment does not meet the SUN2000 operation requirements. In this mode, the SUN2000 continuously performs a self-check and enters operating mode once operation requirements are met. The SUN2000 switches to shutdown mode when it detects a shutdown command or a fault.
Operating	In this mode: - The SUN2000 converts DC power from PV strings into AC power and feeds the power to the power grid. - The SUN2000 always tracks the maximum power point to maximize the PV string output. - The SUN2000 enters the shutdown mode after detecting a fault or a shutdown command, and enters the standby mode after detecting that the PV string output power does not meet the requirements for grid-tied electricity generation.
Shutdown	The SUN2000 switches from standby or operating mode to shutdown mode when it detects a fault or a shutdown command. The SUN2000 switches to standby mode when it receives a startup command or when it detects that a fault is rectified.

3 SUN2000 Storage

This chapter describes SUN2000 storage requirements.

The following storage instructions apply if the SUN2000 will not be deployed immediately:

- Do not unpack the SUN2000.
- Store the SUN2000 at a temperature range of -40°C to +70°C and with the relative humidity of 5% to 95%.
- The SUN2000 should be stored in a clean and dry place and be protected from dust and water vapor corrosion.
- Do not stack more than four SUN2000s.
- Conduct periodic inspection during storage. Replace the packing materials immediately if any rodent bites are found.
- Ensure that qualified personnel inspect and test the SUN2000 before use if it has been stored for a long time.

4 Installation

Context



DANGER

- Do not install the SUN2000 on flammable building materials.
- Do not store the SUN2000 in areas with flammable or explosive materials.



CAUTION

Do not install the SUN2000 in places prone to body contact because the SUN2000 shelf and heat sinks become hot during the SUN2000 operation.

4.1 Checking Before Installation

Before unpacking, check that the outer packing is intact. After unpacking, check that the product and accessories are intact and complete.

Checking Outer Packing Materials

Before unpacking the SUN2000, examine the outer packing for damage such as holes and cracks. If any such damage is found, do not unpack the SUN2000 and contact the dealer immediately.



NOTE

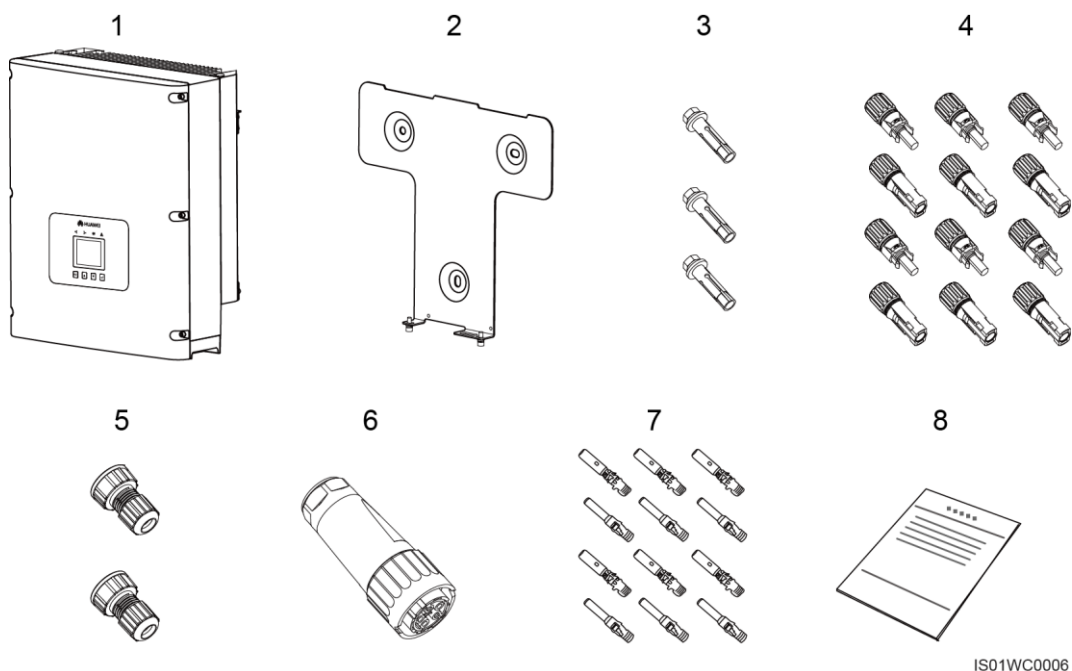
Remove the outer packing only 24 hours before installation.

Checking the Product and Accessories

After unpacking the SUN2000, check the product and accessories. If any damage is found or any component is missing, contact the dealer.

Figure 4-1 shows the product and accessories included in the delivery.

Figure 4-1 Product and accessories








No.	Name	Quantity	Description
1	SUN2000	1	N/A
2	Rear panel	1	N/A
3	Expansion bolt	3	Secures the rear panel to a wall.
4	DC input connector	8/12	Connects to a DC input power cable. - SUN2000-8KTL/10KTL/12KTL: 8 (4 positive connectors and 4 negative connectors) - SUN2000-15KTL/17KTL/20KTL/23KTL/28KTL: 12 (6 positive connectors and 6 negative connectors)
5	Waterproof RJ45 connector	2	Connects to a communications cable.
6	AC output connector	1	Connects to an AC output power cable.
7	Metal terminal	8/12	Secures a connector to a DC input power cable. - SUN2000-8KTL/10KTL/12KTL: 8 (4 positive metal terminals and 4 negative metal terminals) - SUN2000-15KTL/17KTL/23KTL/28KTL: 12 (6 positive metal terminals and 6 negative metal terminals)




No.	Name	Quantity	Description
			NOTICE Positive and negative metal terminals are packed with positive and negative connectors respectively. After unpacking, keep the positive and negative ones separate to avoid confusion.
8	Documentation	1	N/A



4.2 Tools

Prepare the tools required for installation and cable connections.

Tool	Model	Function
Hammer drill 	With a drill bit of $\Phi 14$ mm	Drills holes.
Adjustable wrench 	With an open end ≥ 32 mm	Tightens expansion bolts.
Torque screwdriver 	- Hexagon socket head: 5 mm - Flat head: M6	- Hexagon socket head: Secures screws to mechanical parts. - Flat head: Removes plastic screws from lifting holes.
Flat-head screwdriver 	3 x 100 - Head width: 3-3.5 mm - Pole length (excluding the handle): at least 100 mm - Large handle	- Tightens or loosens screws when installing AC power cables. - Removes AC connectors from the SUN2000.

Tool	Model	Function
Socket wrench 	With an open end of 10 mm	Tightens ground bolts.
Diagonal pliers 	N/A	Cut cable ties.
Wire stripper 	Applies to cables with cross-sectional areas of 4 mm ² , 6 mm ² , and 10 mm ²	Peels off cable jackets.
Rubber mallet 	N/A	Hammers expansion bolts into holes.
Guarded blade utility knife 	N/A	Removes packaging.
Cable cutter 	Applies to cables with cross-sectional areas of 4 mm ² , 6 mm ² , and 10 mm ²	Cuts power cables.

Tool	Model	Function
Crimping tools 	Model: H4TC0001 or H4TC0002 Manufacturer: Amphenol	Crimps metal contacts when preparing DC input power cables. NOTE - H4TC0001 (Amphenol) is used to crimp metal cold forming contacts. - H4TC0002 (Amphenol) is used to crimp metal stamping forming contacts.
RJ45 crimping tool 	N/A	Prepares RJ45 connectors for communications cables.
Removal tool 	H4TW0001 Manufacturer: Amphenol	Removes DC connectors from the SUN2000.
Vacuum cleaner 	N/A	Cleans up dust after drilling holes.
Multimeter 	N/A	Measures voltage.
Marker 	Diameter: maximum 10 mm	Marks signs.

Tool	Model	Function
Measuring tape 	N/A	Measures distances.
Level 	N/A	Checks the levelness of the rear panel.
ESD gloves 	N/A	Protect operators when drilling holes.
Safety goggles 	N/A	Protect operators when drilling holes.
Anti-dust respirator 	N/A	Protects operators from dust inhalation when drilling holes.

4.3 Determining the Installation Position

The requirements described in this section apply to both wall mounting and support mounting. This section uses wall-mounting the SUN2000 as an example.

Comply with the following requirements when determining an appropriate position to install the SUN2000:



DANGER

- Do not install the SUN2000 on flammable building materials.
 - Do not install the SUN2000 in an area that stores flammable or explosive materials.
-

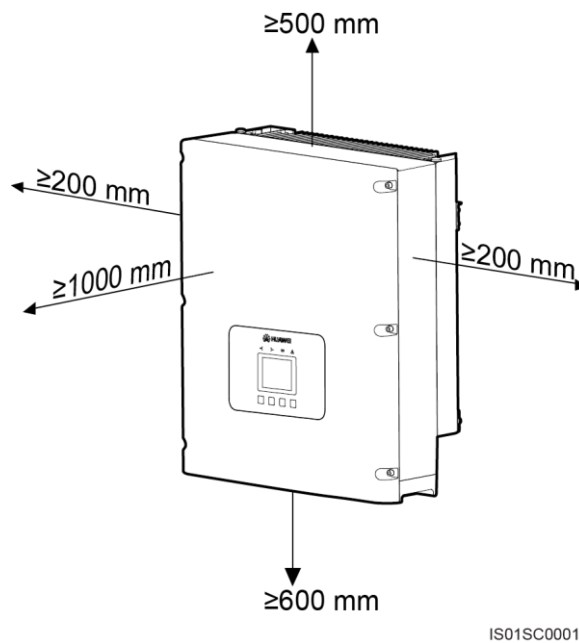


CAUTION

Do not install the SUN2000 in a place where personnel are likely to come into contact with its enclosure and heat sinks. These parts are extremely hot during operation.

- The SUN2000 is protected to IP65 and can be installed indoors or outdoors.
- The installation method and position must be appropriate for the weight and dimensions of the SUN2000. For details, see [10 Technical Specifications](#).
- The wall must be solid enough to support the weight of the SUN2000.
- The cable connection area must face downwards.
- Install the SUN2000 either vertically or with a backward lean of a maximum of 15 degrees.
- The SUN2000 must be installed at an appropriate height for ease of observation and operation of the monitoring panel.
- The SUN2000 must be installed in a well ventilated environment to ensure good heat dissipation. When installed under direct sunlight, performance de-rate may be initiated due to additional temperature rise.
- Do not install the SUN2000 on a wall made of gypsum boards or similar materials with weak sound insulation, to avoid noise disturbance in a residential area.
- Ensure that there are no objects within 200 mm of both sides of the SUN2000, and no objects within 500 mm, 600 mm, and 1000 mm of the top, bottom, and front, respectively (as shown in [Figure 4-2](#)). This is to ensure optimal heat dissipation and sufficient space for installation.

Figure 4-2 Minimum installation clearance



NOTICE

The minimum installation clearance shown in [Figure 4-2](#) must be provided in any installation scenario, including wall-mounted and support-mounted scenarios.

- Multiple SUN2000s must be installed in a line if sufficient space is available. Otherwise, they must be installed in checkerboard mode as shown in [Figure 4-3](#). The stacked installation mode shown in [Figure 4-4](#) is not recommended. The clearance between SUN2000s must meet requirements shown in the following figures.

Figure 4-3 Checkerboard installation mode (recommended)

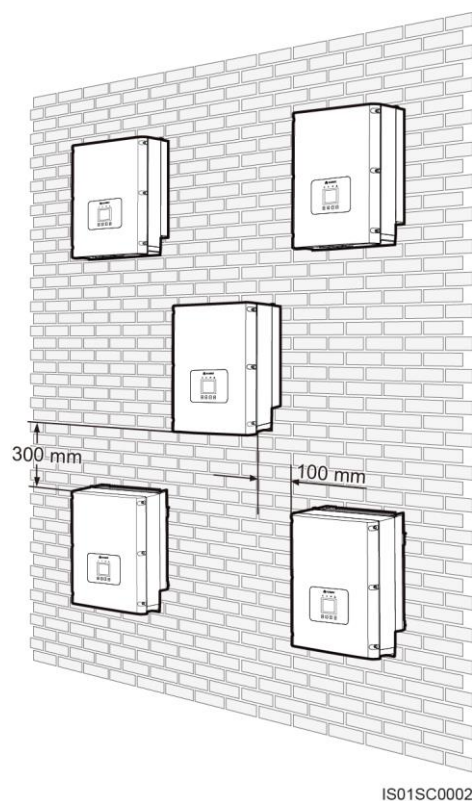
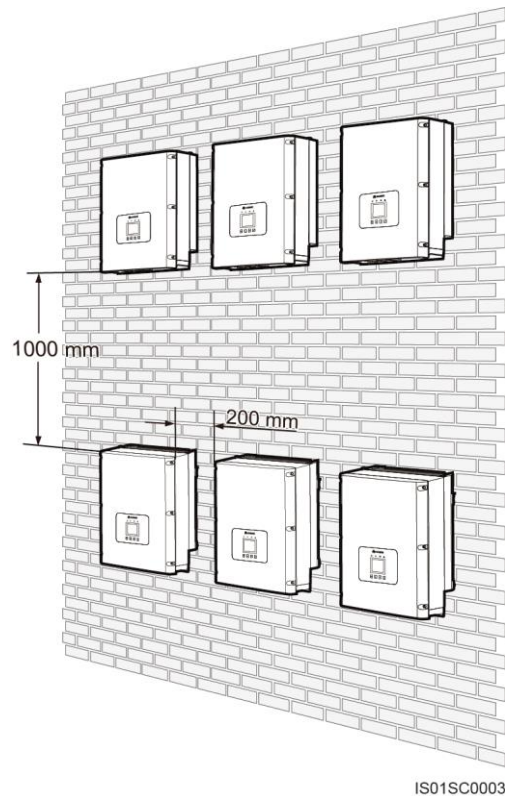


Figure 4-4 Stacked installation mode (not recommended)



NOTICE

The clearance between multiple SUN2000s must be increased to ensure proper heat dissipation when they are installed in a hot area.

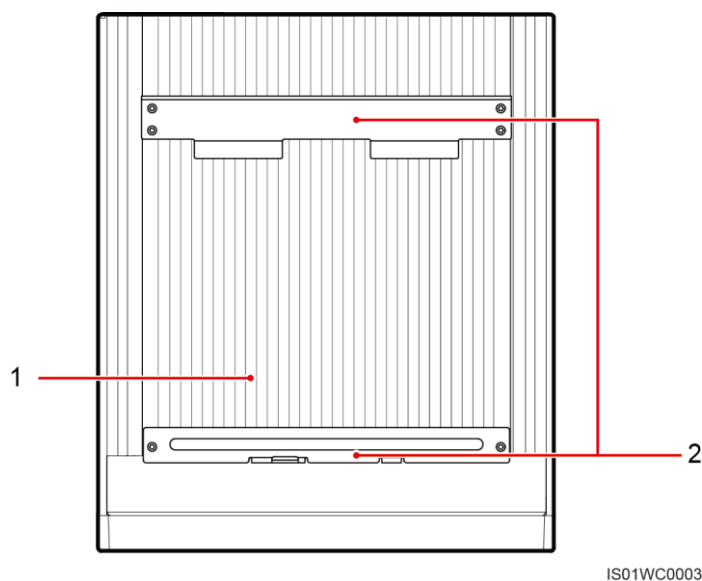
4.4 Support-mounting the SUN2000

When installing the SUN2000, the accompanying rear panel must first be secured to a support. The SUN2000 is then secured to the rear panel using hexagon screws.

Context

[Figure 4-5](#) shows the SUN2000 from the back.

Figure 4-5 SUN2000 rear view

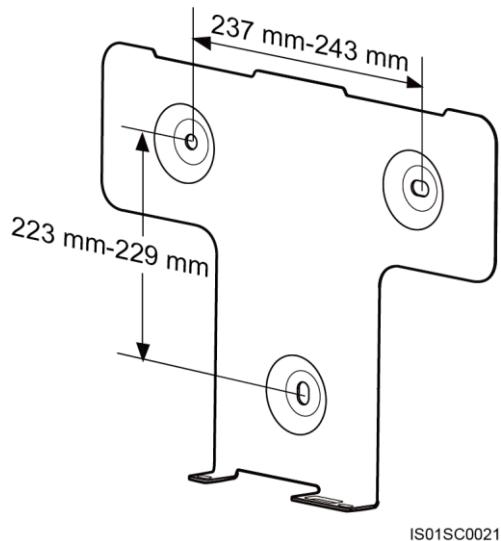


(1) Heat sink

(2) Mounting bracket

[Figure 4-6](#) shows the dimensions of holes in the rear panel of the SUN2000.

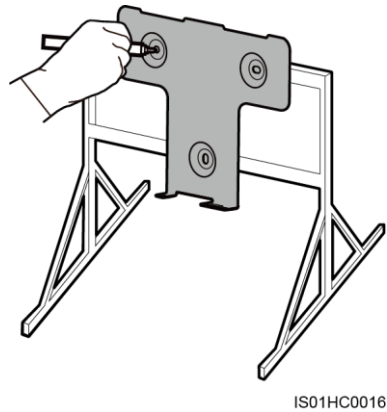
Figure 4-6 Dimensions of holes in the SUN2000 rear panel



Procedure

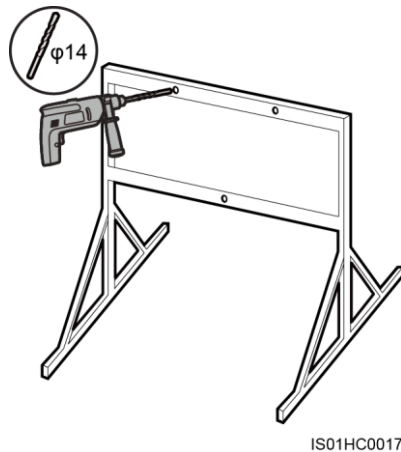
- Step 1** Determine the positions for drilling holes using the rear panel in the packing case, and mark the hole positions using a marker, as shown in [Figure 4-7](#).

Figure 4-7 Determining hole positions



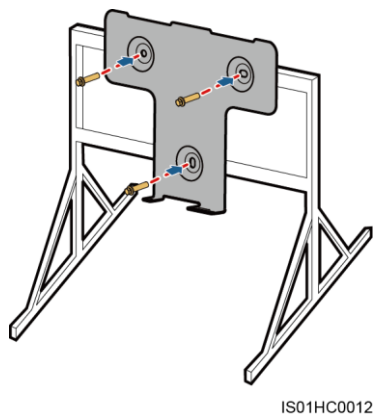
Step 2 Drill holes using a hammer drill, as shown in [Figure 4-8](#).

Figure 4-8 Drilling holes



Step 3 Align the rear panel with hole positions, insert M10x60 bolts into the holes, and tighten the bolts to a torque of 30 N·m using a torque wrench, as shown in [Figure 4-9](#).

Figure 4-9 Securing a rear panel



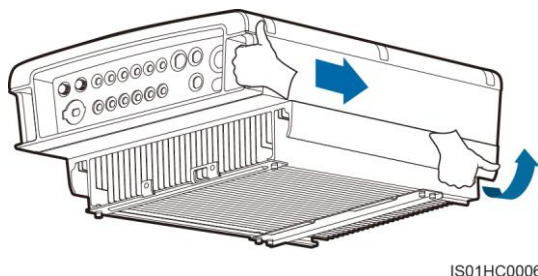
Step 4 Hold the handle at the bottom of the SUN2000 with one hand and hold the end of the other handle near the SUN2000 top with the other end, and then stand the SUN2000, as shown in [Figure 4-10](#). Two persons are required to install the SUN2000.



CAUTION

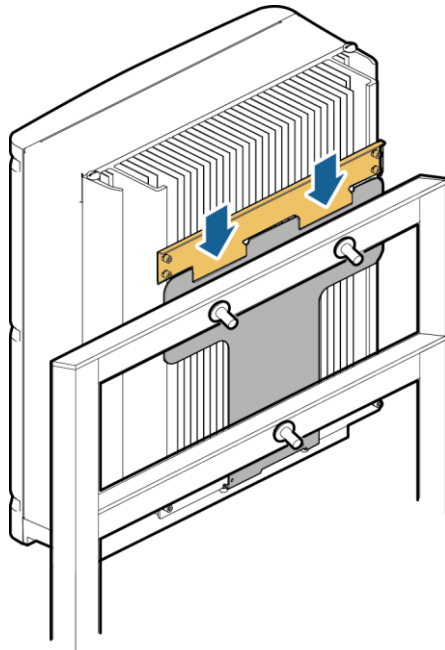
To prevent personal injury caused by a falling SUN2000, keep balance when lifting the SUN2000 because the SUN2000 has a heavy top.

Figure 4-10 Lifting a SUN2000



Step 5 Mount the SUN2000, keeping the mounting brackets in alignment with the rear panel, as shown in [Figure 4-11](#).

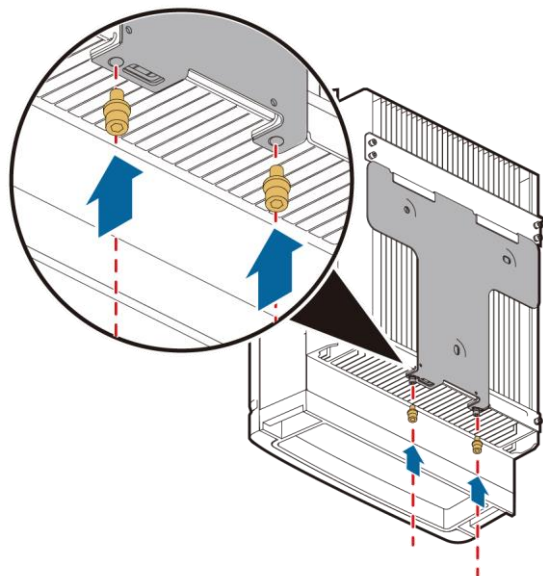
Figure 4-11 Mounting a SUN2000 on a rear panel



IS01HC0013

Step 6 Tighten the two hexagon screws at the bottom of the SUN2000 to a torque of 5 N·m, as shown in [Figure 4-12](#).

Figure 4-12 Tightening hexagon screws

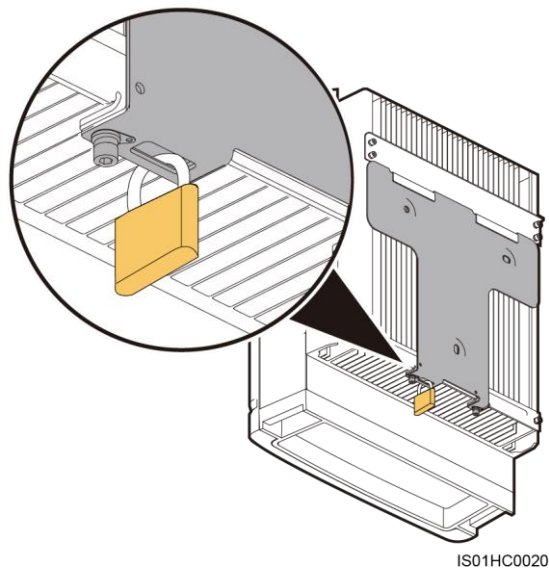


IS01HC0019

Step 7 (Optional) Install an antitheft lock, as shown in [Figure 4-13](#).

The function of an antitheft lock is to secure the SUN2000 to the rear panel and protect it from stealing.

Figure 4-13 Installing an antitheft lock



----End

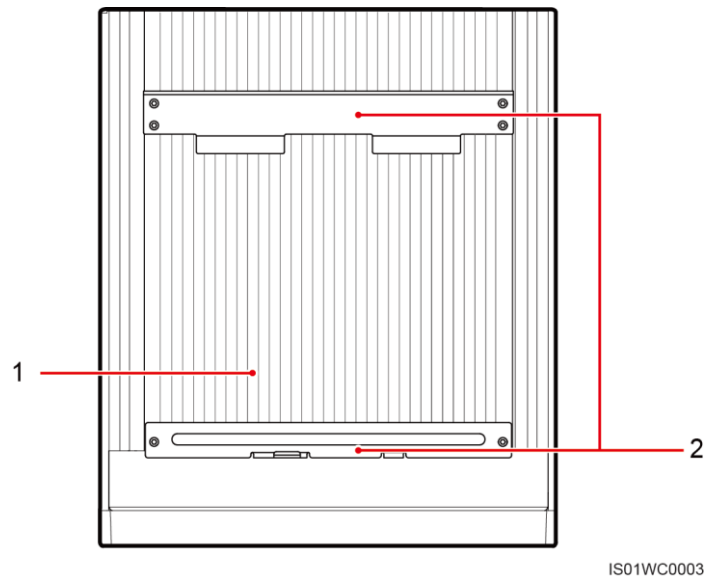
4.5 Wall-mounting the SUN2000

When installing the SUN2000, the accompanying rear panel must first be secured to a wall. The SUN2000 is then secured to the rear panel using hexagon screws.

Context

[Figure 4-14](#) shows the SUN2000 from the back.

Figure 4-14 SUN2000 rear view

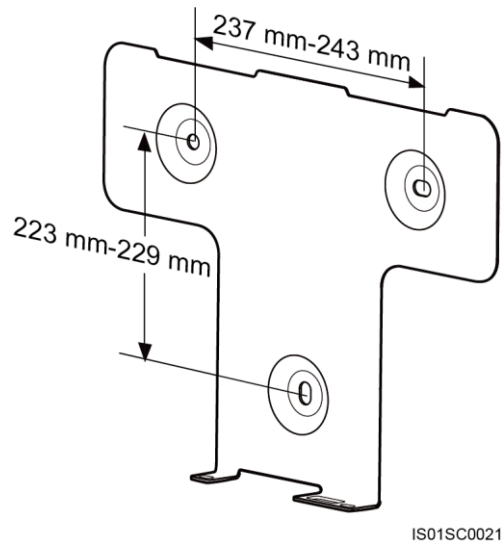


(1) Heat sink

(2) Mounting bracket

Figure 4-15 shows the dimensions of holes in the rear panel of the SUN2000.

Figure 4-15 Dimensions of holes in the SUN2000 rear panel



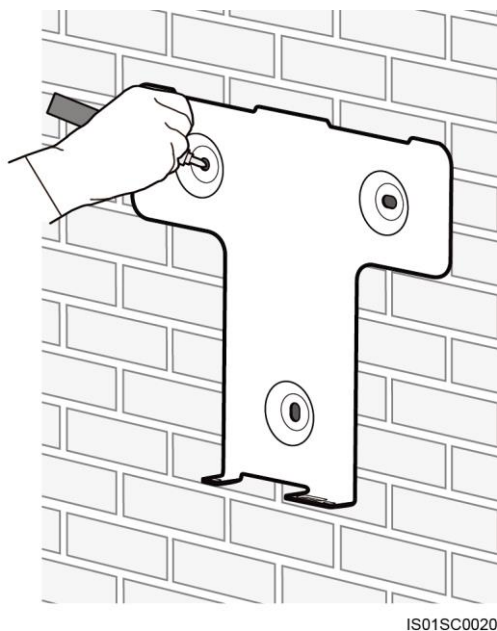
 NOTE

- If the installation location is near the ground, connect the PGND cable to the ground before installing the SUN2000. For details, refer to [5.1 Connecting PGND Cables](#).
- It is recommended that the SUN2000 be installed at eye level to facilitate operation and maintenance.

Procedure

- Step 1** Locate the positions for drilling holes using the rear panel provided with the SUN2000 in the packing case, and mark the positions using a marker, as shown in [Figure 4-16](#).

Figure 4-16 Locating and marking the hole positions

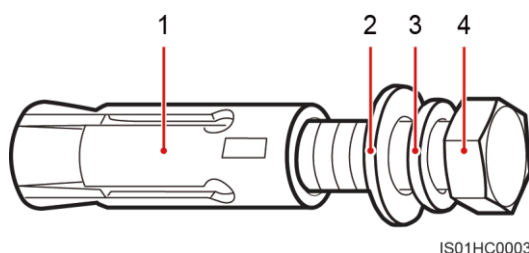


IS01SC0020

- Step 2** Drill holes using a hammer drill and install expansion bolts, as shown in [Figure 4-18](#).

An expansion bolt is composed of four parts, as shown in [Figure 4-17](#).

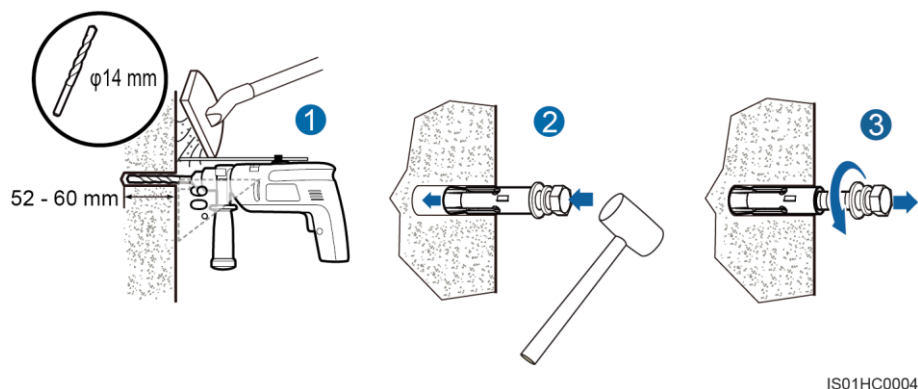
Figure 4-17 Expansion bolt composition



IS01HC0003

- (1) Expansion sleeve (2) Flat washer (3) Spring washer (4) M10x60 bolt

Figure 4-18 Drilling a hole and installing an expansion bolt



1. Drill a hole at the marked position to a depth of 52-60 mm using a hammer drill with a $\Phi 14$ mm bit.



CAUTION

- Wear safety goggles to prevent dust in the eyes when drilling holes. Wear an anti-dust respirator to prevent dust inhalation when drilling holes.
- Vacuum any dust in or around the holes using a vacuum cleaner and measure the distance between holes. If the holes are inaccurately positioned, drill new holes.

2. Partially tighten an expansion bolt, vertically insert it into the hole, and drive the expansion bolt completely into the hole using a rubber mallet.
3. Remove the M10x60 bolt, spring washer, and flat washer by rotating them counterclockwise.

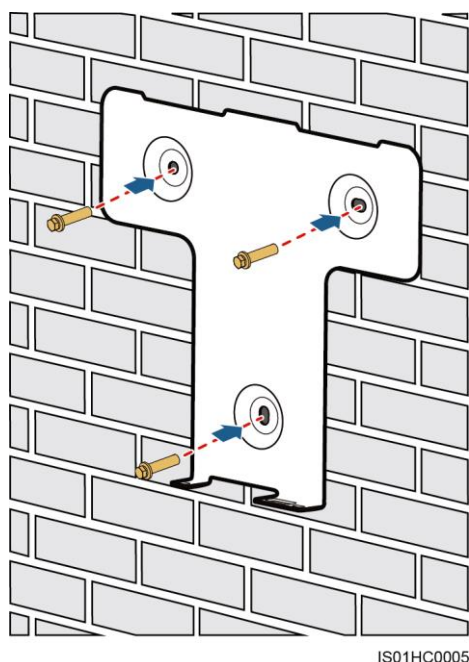


NOTICE

Ensure that the top surface of the expansion sleeve is level with the surface of the concrete wall after removing the bolt, spring washer, and flat washer. Otherwise, the rear panel will not be securely installed on the wall.

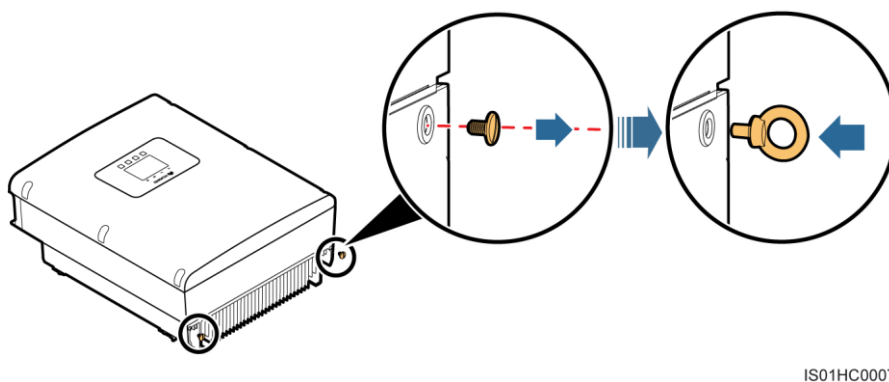
- Step 3** Align the rear panel with the holes, insert expansion bolts into the holes through the rear panel, and tighten the expansion bolts to a torque of 30 N·m using a torque wrench with a 17 mm open end, as shown in [Figure 4-19](#).

Figure 4-19 Securing a rear panel



- Step 4** If the rear panel has been installed low enough for the SUN2000 to be mounted, go to [Step 9](#) after performing [Step 7](#).
- Step 5** If the rear panel has been installed too high for the SUN2000 to be mounted, perform [Step 6](#) to [Step 10](#).
- Step 6** Remove the two rubber screws from the top of the SUN2000 using a flat-head screwdriver and install two M10 lifting eyes, as shown in [Figure 4-20](#).

Figure 4-20 Installing lifting eyes



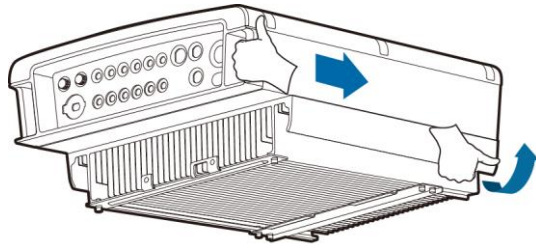
- Step 7** Ensure that two people lift the SUN2000 and turn it upright. Lift the SUN2000 by grasping the handle at the bottom of the SUN2000 with one hand and the handle at the top with the other, as shown in [Figure 4-21](#).



CAUTION

To prevent personal injury, maintain balance when lifting the SUN2000 because it is top-heavy.

Figure 4-21 Lifting the SUN2000



IS01HC0006

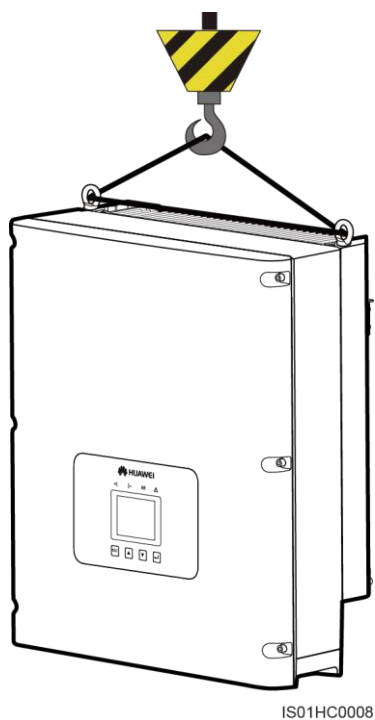
- Step 8** Run a rope that is sufficiently weight-bearing for the SUN2000 through the lifting eyes and hoist the SUN2000, as shown in [Figure 4-22](#).



NOTICE

When hoisting the SUN2000, maintain balance to protect the SUN2000 from knocking into the wall or other objects.

Figure 4-22 Hoisting the SUN2000



Step 9 Mount the SUN2000, keeping the mounting brackets in alignment with the rear panel, as shown in [Figure 4-23](#) and [Figure 4-24](#).

Figure 4-23 Mounting the SUN2000 on the rear panel (front view)

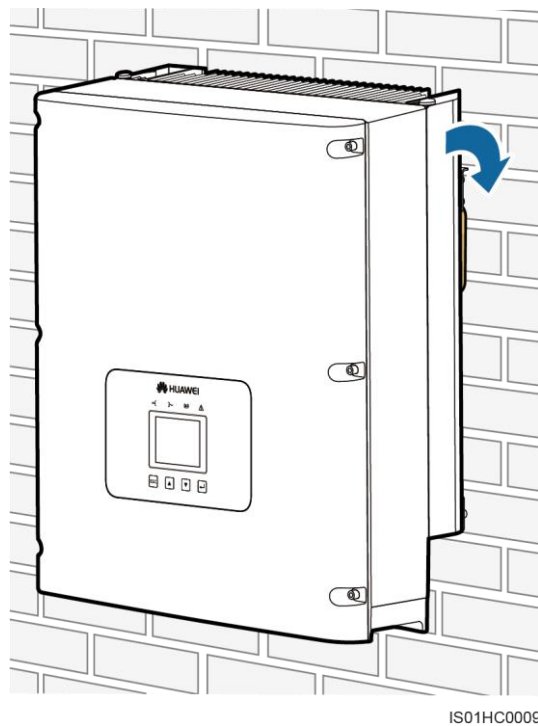
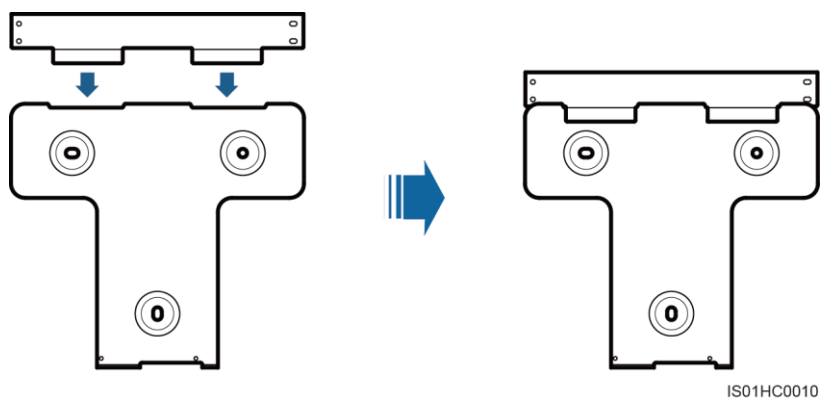
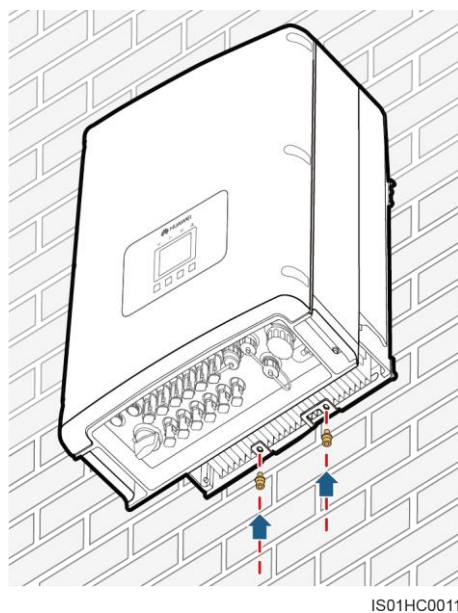


Figure 4-24 Mounting the SUN2000 on the rear panel (rear view)



Step 10 Tighten the two hexagon screws at the bottom of the SUN2000 to a torque of 5 N·m, as shown in [Figure 4-25](#).

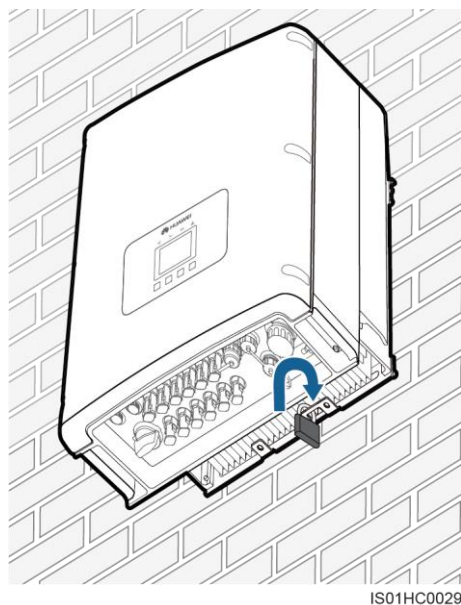
Figure 4-25 Tightening hexagon screws



Step 11 (Optional) Install an antitheft lock, as shown in [Figure 4-26](#).

The antitheft lock secures the SUN2000 to the rear panel to prevent theft.

Figure 4-26 Installing an antitheft lock



----End

5 Electrical Connections

This topic describes the SUN2000 electrical connections. Read this part carefully before protection ground (PGND) cables, DC input power cables, AC output power cables, and communications cables for the SUN2000.

Context



DANGER

Before performing any electrical connection, ensure that the DC SWITCH is OFF. Otherwise, the high voltage can result in fatal injury.



NOTICE

The cable colors shown in electrical connection schematic drawings are only for reference. Select cables according to local cable specifications (Yellow-green wires are only used for grounding).

5.1 Connecting PGND Cables

Connect the SUN2000 to a ground bar using a PGND cable for grounding purposes.

Prerequisites

A PGND cable should be available. The PGND cable is recommended to be an outdoor copper-core cable with a cross-sectional area of 6 mm² or 10 AWG.

Context

Good grounding for the SUN2000 helps resist the impact of surge voltage and improve EMI performance. Connect the PGND cable before connecting the AC power cables, DC power cables, and communications cables.

It is recommended that the ground cable be connected to a nearby ground position. For a system with multiple inverters connected in parallel, connect the ground points of all inverters to ensure equipotential connections.

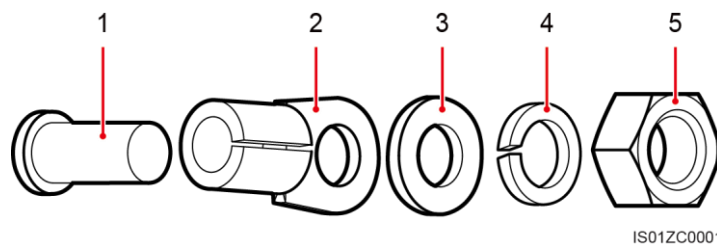


NOTE

If the installation location is near the ground, connect the PGND cable to the ground before installing the SUN2000.

A ground terminal has five parts, as shown in [Figure 5-1](#).

Figure 5-1 Ground terminal composition

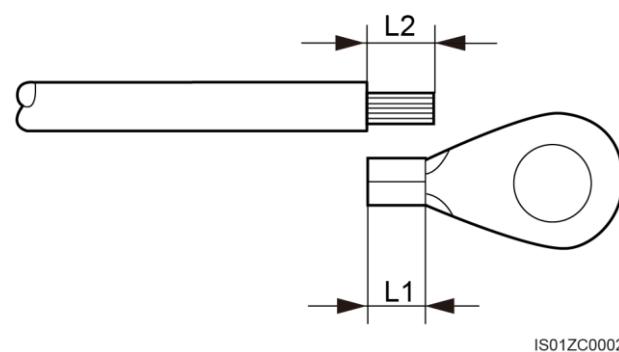


(1) M6 welded stud (2) OT terminal (3) Flat washer (4) Spring washer (5) Nut

Procedure

- Step 1** Remove an appropriate length of the insulation layer from the PGND cable using a wire stripper, as shown in [Figure 5-2](#).

Figure 5-2 Stripped length

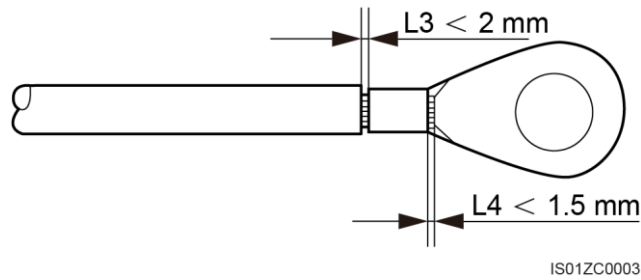


Note: L2 is 2 mm to 3 mm longer than L1.

- Step 2** Insert the exposed core wires into the conductor crimp area of the OT terminal and crimp them using a crimping tool, as shown in [Figure 5-3](#).

Recommended OT terminal: OT-6 mm² or 10 AWG-M6.

Figure 5-3 Position of the crimp area

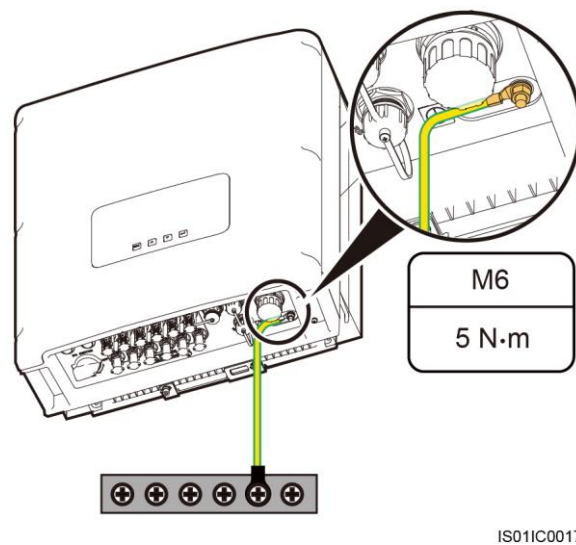


Note 1: L3 is the distance between the cable insulation layer and the conductor crimp area of the OT terminal. L4 is the length of the cable conductors protruding out of the crimp area.

Note 2: The crimping must result in full containment of the cable conductors and complete contact between the cable conductors and the terminal.

- Step 3** Install the crimped OT terminal, a flat washer, and a spring washer on the M6 welded stud in sequence, and tighten the nut to a torque of 5 N·m using a socket wrench, as shown in [Figure 5-4](#).

Figure 5-4 Connecting the PGND cable to the SUN2000



NOTE

To prevent corrosion, apply silica gel to the ground terminal after connecting the PGND cable.

----End

Follow-up Procedure

To disconnect the PGND cable, remove the nut from the M6 welded stud using an adjustable wrench, and then remove the spring washer, flat washer, and crimped OT terminal.

5.2 Connecting AC Output Power Cables

Connect the SUN2000 to the AC power distribution frame (PDF) or power grid using AC output power cables. Ensure that the cable connections meet the requirements of the local power grid operator.

Prerequisites

A three-phase AC switch needs to be configured outside the AC side of the SUN2000. To ensure that the SUN2000 can safely disconnect from the power grid under abnormal conditions, select an appropriate overcurrent protection device according to local power distribution regulations.



WARNING

- Do not install a single circuit breaker for several SUN2000s.
 - Do not connect loads between the SUN2000 and circuit breaker.
-

Context

Flexible cables are recommended for ease of installation. The outer diameter of the cable conductor should be less than or equal to 4.2 mm. [Table 5-1](#) lists the specifications.



NOTE

If the PID module is used in a PV array containing the SUN2000, verify that the working voltage of AC cables to the ground is no less than 600 V AC, and that the voltage between AC cables is no less than 1000 V AC.

Table 5-1 Recommended AC output power cable specifications

Inverter Model	Cable Type		Cross-sectional Area (mm ²)		Cable Outer Diameter (mm)	
	Range	Recommended Value	Range	Recommended Value	Range	Recommended Value
SUN2000-8KTL	4-core outdoor cable (3+N) 5-core outdoor cable (3+N+PE)	4-core outdoor cable (3+N)	4-10 (or 12 AWG-8 AWG)	4 (or 12 AWG)	11-20 NOTE - For a cable with an outer diameter of 11 mm to 13 mm, add cable clamps. - For a cable with an outer diameter of 16 mm to 20 mm, strip a seal ring from inside the cable gland. - For an armored cable with an outer diameter exceeding 20 mm, strip the jacket and armored layer and waterproof and ultraviolet-proof the cable.	15
SUN2000-10KTL						
SUN2000-12KTL						
SUN2000-15KTL			6-10 (or 10 AWG-8 AWG)	6 (or 10 AWG)		
SUN2000-17KTL						
SUN2000-20KTL						
SUN2000-23KTL						
SUN2000-28KTL	3-core outdoor cable 4-core outdoor cable (3+PE)	3-core outdoor cable				

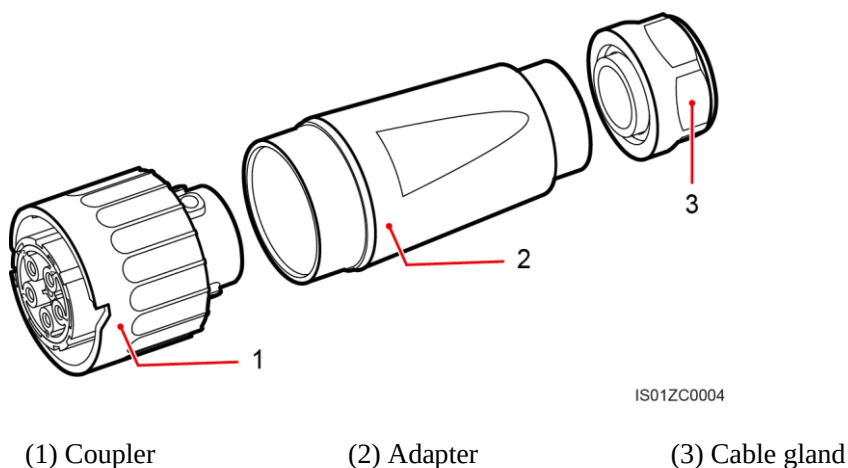


NOTICE

- If the PGND cable has already been installed according to [5.1 Connecting PGND Cables](#), there is no need to connect the PE wire of the AC output power cable.
- If a cable with a cross-sectional area of 4 mm² to 10 mm² is used, crimp a tubular cord end terminal at the cable end before installing the cable.

An AC output connector has three parts: coupler, adapter, and cable gland, as shown in [Figure 5-5](#).

Figure 5-5 AC output connector



Procedure

- Step 1** Remove the cable gland and adapter from the AC output connector.
- Step 2** Remove an appropriate length of the jacket and insulation layer of the core wires from the AC output cable using a wire stripper, as shown in [Figure 5-6](#).

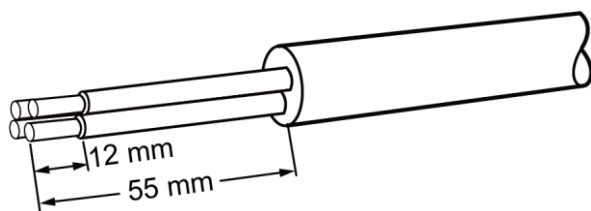


NOTICE

The core wires (L1, L2, L3, and N) of the AC power cable must be correctly identified to prevent incorrect cable connections which can cause device damage or startup failure. (No neutral cable connections are involved for the SUN2000-28KTL.)

1. Strip the jacket of the AC output cable by 55 mm.
2. Strip the insulation layer of each core wire by 12 mm.

Figure 5-6 Stripped length



NOTE

The preceding figure shows the stripped length only for all SUN2000 models except the SUN2000-28KTL. For the SUN2000-28KTL, align the neutral cable with the protective jacket and cut off the neutral cable.



CAUTION

When cutting off the cable, take protective measures to prevent personal injury.

- Step 3** Insert the core wires (L1, L2, L3, and N) of the AC output cable into the cable gland and the adapter, as shown in [Figure 5-8](#).



NOTE

If the outer diameter of the cable is greater than 16 mm, remove a seal ring from the interior of the cable gland (as shown in [Figure 5-7](#)) before inserting the power cable into the cable gland and the adapter.

Figure 5-7 Stripping a seal ring

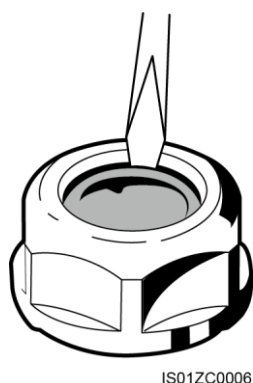
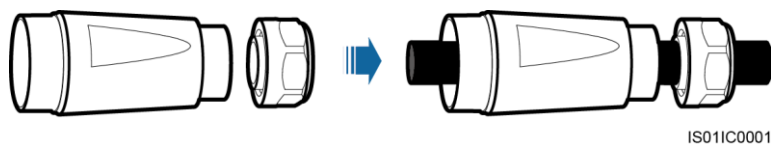
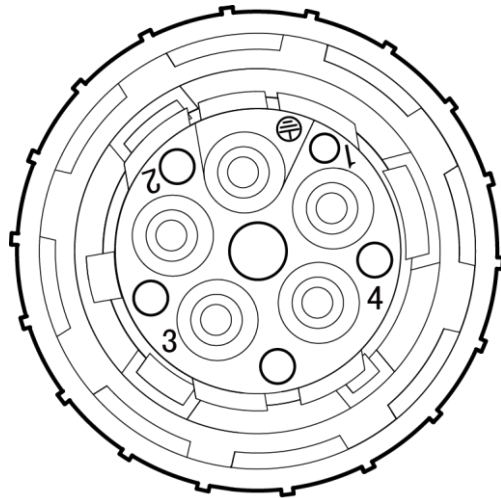


Figure 5-8 Installing a cable gland and adapter



- Step 4** Loosen the screws of the coupler holes using a torque screwdriver. Insert the core wires into the corresponding holes as shown in [Figure 5-9](#). Tighten the screws to a torque of 0.7 N·m, as shown in [Figure 5-10](#).

Figure 5-9 Coupler

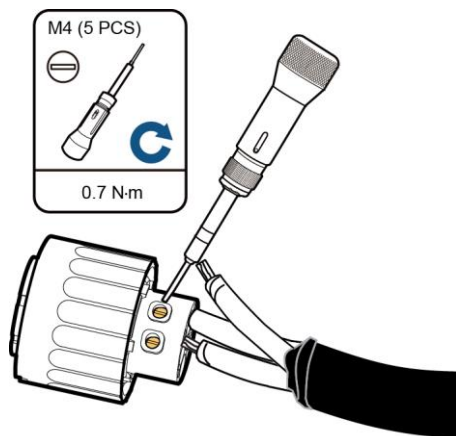


IS011C0002

- Connect L1 to hole number 1.
- Connect L2 to hole number 2.
- Connect L3 to hole number 3.
- Connect N to hole number 4.

For the SUN2000-28KTL, do not connect the neutral wire to hole number 4.

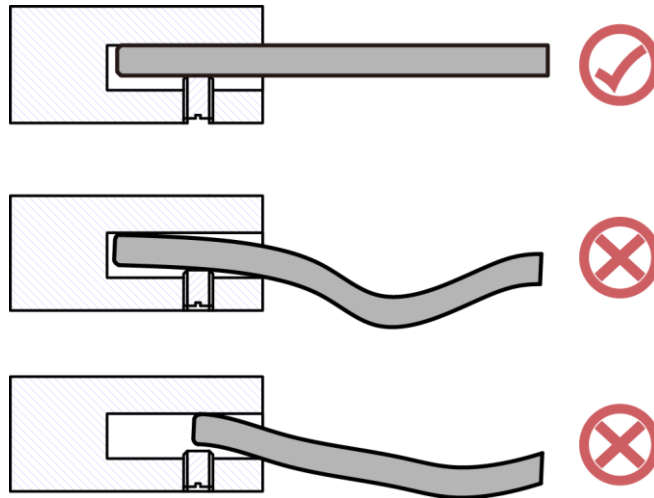
Figure 5-10 Connecting an AC output cable to the coupler



IS011C0003

Step 5 Check that all core wires are properly connected, as shown in [Figure 5-11](#).

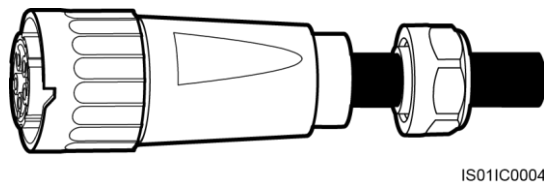
Figure 5-11 Checking the cable connections



Step 6 Secure the adapter to the coupler, as shown in [Figure 5-12](#).

Tighten the adapter to a torque of 1-2 N·m.

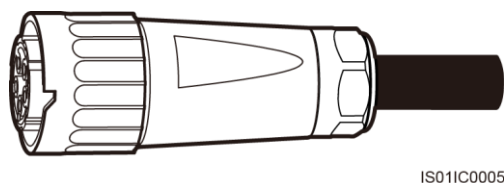
Figure 5-12 Securing the adapter



Step 7 Secure the cable gland to the adapter, as shown in [Figure 5-13](#).

Tighten the cable gland to a torque of 5 N·m using a tool.

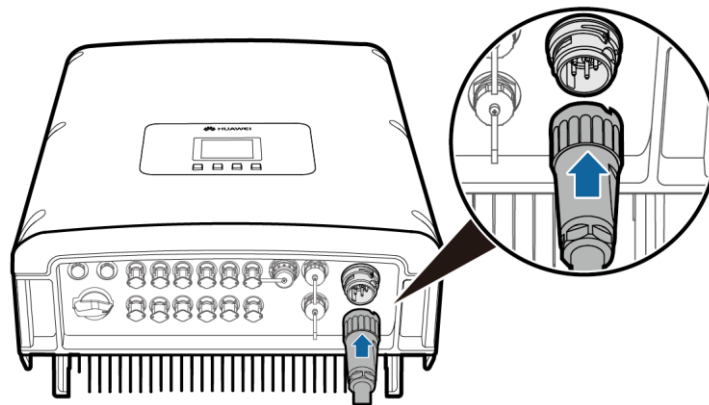
Figure 5-13 Securing the cable gland



Step 8 Connect the AC output connector to the bayonet coupling of the AC output wiring terminal on the SUN2000 and rotate it clockwise until a "click" sound is heard, as shown in [Figure 5-14](#).

Because there is insufficient space on the right of the AC terminal, tighten the terminal with the left hand.

Figure 5-14 Connecting an AC output connector



IS011C0006



NOTE

The AC output connector is securely connected to the AC output wiring terminal after the bayonet coupling snaps into place.



NOTICE

Reserve a margin of more than 0.5 meter for the cable at the AC output power cable connector to reduce the cable terminal disconnection due to external force.

----End

Follow-up Procedure

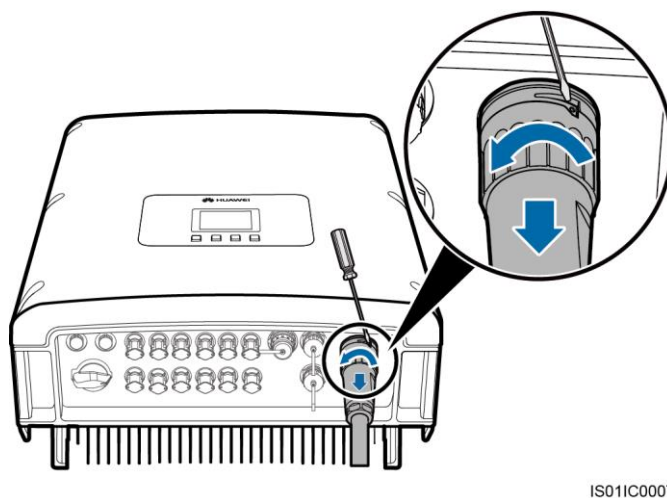
To remove the AC output connector from the SUN2000, press down the locking plate on the AC output wiring terminal using a flat-head screwdriver as shown in [Figure 5-15](#). Rotate the AC output connector counterclockwise.



WARNING

Before removing the AC output connector, switch off the circuit breaker between the SUN2000 and the power grid.

Figure 5-15 Removing an AC output connector



5.3 Connecting DC Input Power Cables

Connect the SUN2000 to PV strings using DC input power cables.

Prerequisites



DANGER

- PV modules generate electric energy when exposed to sunlight and can create an electrical shock hazard. Therefore, when connecting DC input power cables, shield the PV modules with opaque cloth.
- Before connecting DC input cables, ensure that the voltage on the DC side is under the safety limit (60 V DC) and that the DC SWITCH on the SUN2000 is OFF. Otherwise, high voltage may result in fatal injury.



WARNING

Ensure that the following requirements are met to prevent fire accidents:

- PV modules connected in series in each PV string must be of the same specifications.
- The maximum open-circuit voltage of each PV string must be always lower than or equal to 1000 V DC.
- The maximum short-circuit current of each PV string must be always lower than or equal to 23 A.
- The positive and negative terminals of PV modules must be connected to the positive and negative DC input terminals of the SUN2000 respectively.



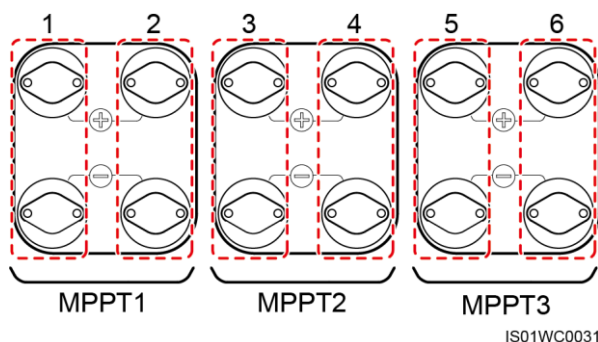
NOTICE

- If the SUN2000 is directly connected to the power grid and no three-phase four-wire isolation transformer is connected to the output side, ensure that the PV strings are not grounded.
- If the DC voltage is a stable non-zero value between the positive terminal of a PV string and the ground, the PV string has an insulation fault. Rectify the fault before connecting cables.
- During PV string and SUN2000 installation, the positive or negative terminals of PV strings may be grounded if power cables are not properly installed or routed. In this case, an AC or DC short circuit may occur and damage the SUN2000.
- If the PV strings need to be grounded, install a three-phase four-wire isolation transformer on the output side and set the parameter of **Isolation** to **Input Grounded, With TF** by following the instructions in [7.2.11 Setting Isolation Parameters](#). If no isolation transformer is connected, the SUN2000 will not operate properly.

Context

[Figure 5-16](#) shows the MPPT distribution of the SUN2000.

Figure 5-16 MPPT distribution



- The SUN2000-8KTL to SUN2000-12KTL provide two MPPT routes to track the maximum power point for PV strings. Therefore, two to four DC inputs should be evenly distributed on two terminal groups.
- The SUN2000-15KTL to SUN2000-28KTL provide three MPPT routes to track the maximum power point for PV strings. Therefore, two to six DC inputs should be evenly distributed on three terminal groups.

Table 5-2 describes the recommended DC input cable specifications.

Table 5-2 Recommended DC input cable specifications

Cable Type	Cross-sectional Area (mm²)		Cable Outer Diameter (mm)
	Range	Recommended Value	
Common PV cable	4-6	4	4.5-7.8

 NOTICE

Highly rigid cables, such as armored cables, are not recommended because bending may cause poor contact.

The positive and negative DC input connectors are used, as shown in Figure 5-17 and Figure 5-18.

Figure 5-17 Positive connector composition

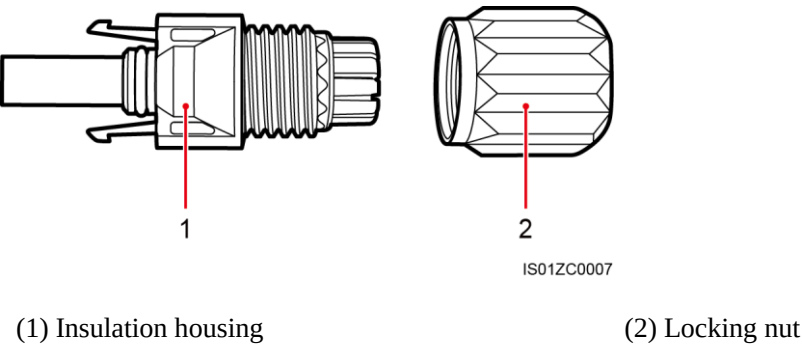
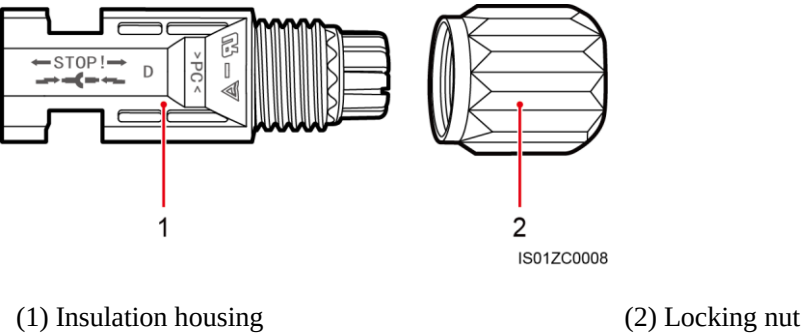


Figure 5-18 Negative connector composition





NOTICE

Positive and negative metal terminals are packed with positive and negative connectors respectively. After unpacking, keep the positive and negative ones separate to avoid confusion.

Procedure

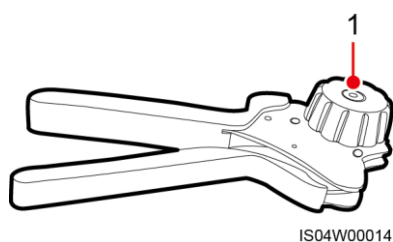
Step 1 Prepare positive and negative connectors.



NOTICE

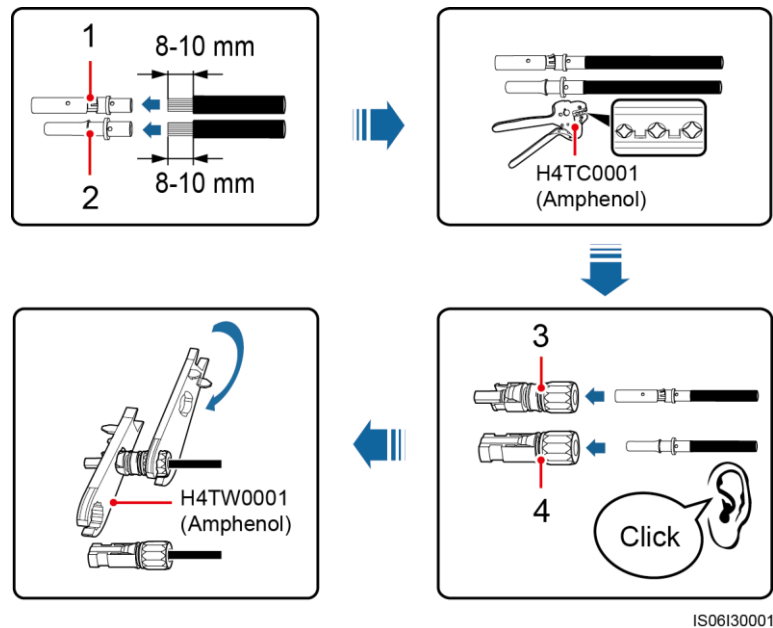
- Use the positive and negative metal contacts and DC connectors supplied with the SUN2000. Using other models of positive and negative metal contacts and DC connectors may result in serious consequences. The caused device damage is not covered under any warranty or service agreement.
 - The metal contacts supplied with the DC connectors are either cold forming contacts or stamping forming contacts. Choose the crimping tools that fit the metal contact types. Do not mix up the tools.
 - Crimp the metal cold forming contacts using crimping tool H4TC0001 (Amphenol).
 - Crimp the metal stamping forming contacts using crimping tool H4TC0002 (Amphenol, recommended), PV-CZM-22100 (Staubli), or PV-CZM-19100 (Staubli). When choosing PV-CZM-22100 or PV-CZM-19100, do not use the locator. Otherwise metal contacts would be damaged.
-

Figure 5-19 Crimping tool (H4TC0002)



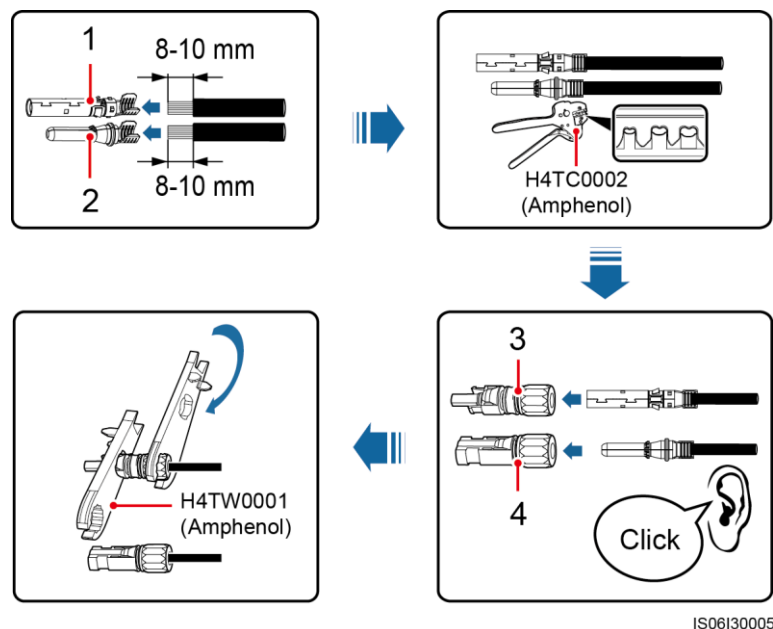
(1) Locator

Figure 5-20 Preparing positive and negative connectors (using metal cold forming contacts)



- (1) Positive metal contact (cold forming) (2) Negative metal contact (cold forming)
(3) Positive connector (4) Negative connector

Figure 5-21 Preparing positive and negative connectors (using metal stamping forming contacts)



- (1) Positive metal contact (stamping forming) (2) Negative metal contact (stamping forming)
(3) Positive connector (4) Negative connector

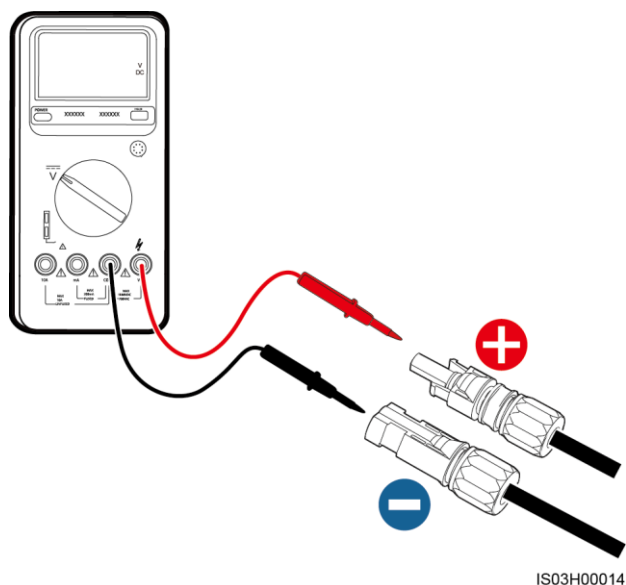


NOTICE

After the positive and negative metal contacts snap into place, pull the DC input power cables back to check that they are connected securely.

- Step 2** Pull out the blue dustproof plugs from the ends of the DC input connectors.
- Step 3** Ensure that the DC input voltage of each PV string does not exceed 1000 V DC using a multimeter and check that the polarities of the DC input power cables are correct.

Figure 5-22 Measuring the DC input voltage

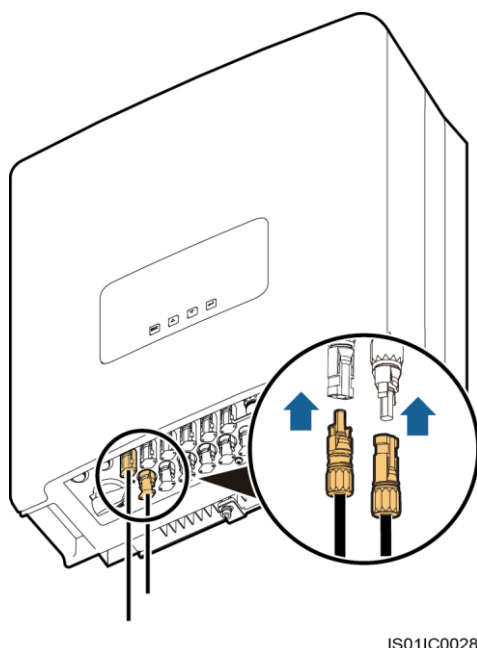


WARNING

Before performing [Step 4](#), ensure that the **DC SWITCH** is **OFF**.

- Step 4** Insert the positive and negative connectors into the corresponding DC input terminals of the SUN2000 until a "click" sound is heard, as shown in [Figure 5-23](#).

Figure 5-23 Positive and negative connectors



NOTICE

- After the positive and negative connectors are in position, the space between the DC terminals and connectors should be less than or equal to 0.8 mm.
- Reserve a margin of more than 0.5 meter for the cable at the DC input power cable connector to reduce the cable terminal disconnection due to external force.
- If the DC input power cables are reversely connected and the **DC SWITCH** is **ON**, do not turn off the **DC SWITCH** immediately. Otherwise, the inverter may be damaged and the damage is beyond the warranty scope. Wait until the PV string voltage reduces to the safety range (below 60 V DC). Then, turn off the **DC SWITCH**, remove the positive and negative connectors, and rectify the connection.

----End

Follow-up Procedure

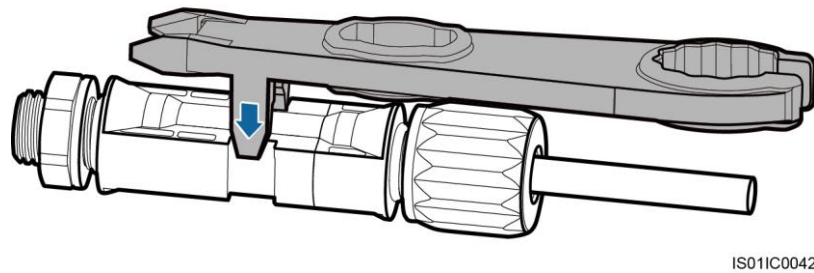
To remove the positive and negative connectors from the SUN2000, insert a removal wrench into the bayonet lock and apply an appropriate force, as shown in [Figure 5-24](#).



WARNING

Before removing the positive and negative connectors, ensure that the **DC SWITCH** is **OFF**.

Figure 5-24 Removing a DC input connector



5.4 Connecting Communications Cables

This section describes the functions of USB and RS485 ports and the method of connecting RS485 communications cables.

5.4.1 Communications Ports

This section describes the functions of the USB and RS485 ports.

Overview

The SUN2000 provides three communications ports: USB port, RS485 IN port, and RS485 OUT port, which are on the left, upper right, and lower right respectively. For details, see [Bottom View](#) in [2.2 Appearance](#).

USB Port

- The SUN2000 communicates with a USB flash drive through the USB port to upgrade firmware, download and load configurations, and download data.
- The SUN2000 can communicate with the SUN2000 app over a Bluetooth module or USB data cable connected to the USB port, so that you can view the operating information and set parameters over the app.

NOTE

- The SUN2000 app (Android) can communicate with the SUN2000 over a Bluetooth module or USB data cable, whereas the SUN2000 app (iOS) supports the communication with the SUN2000 only over a Bluetooth module. For details about version mappings and the operations on the SUN2000 app, see the *SUN2000 APP User Manual*.
- Use the USB port only during maintenance (such as power-on setting, upgrade, and data export). Ensure that the USB cover is tightened when the USB port is not in use.

RS485 Ports

The SUN2000 sends alarm information, operating status, and data such as energy yield to a PC that runs network management software such as the NetEco or a local data collection and display device such as the SmartLogger through an RS485 port.

RS485 communication is implemented by connecting the SUN2000 according to the following guidelines:

- If only one SUN2000 is used, connect a communications cable with waterproof RJ45 connectors to either of the two RS485 ports and block the other one with a waterproof cover.
- If multiple SUN2000s are used, connect all SUN2000s in daisy chain mode over the RS485 communications cable.
- Connect the SUN2000 to the SmartLogger to implement data collection and monitoring, or connect it to the PC over the SmartLogger to implement communication.

Figure 5-25 shows how one SUN2000 connects to the SmartLogger and the PC. Figure 5-26 shows how multiple SUN2000s connect to the SmartLogger and the PC.

Figure 5-25 Communication mode for a single SUN2000

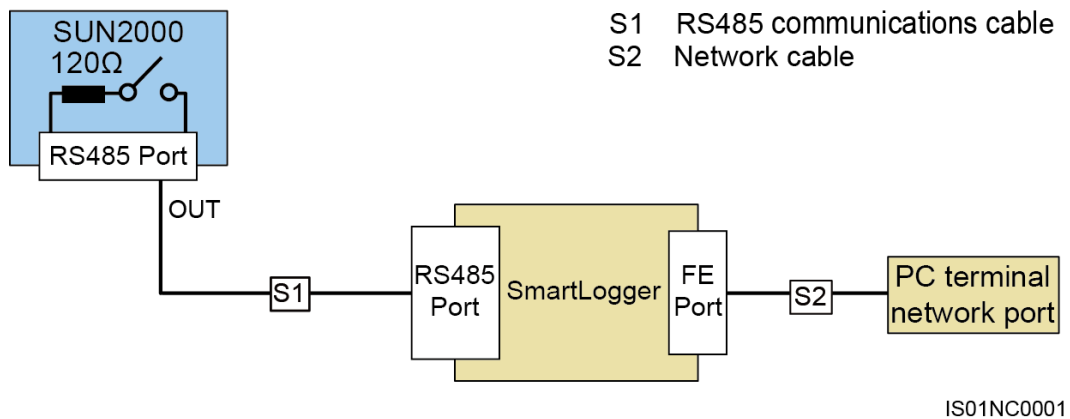
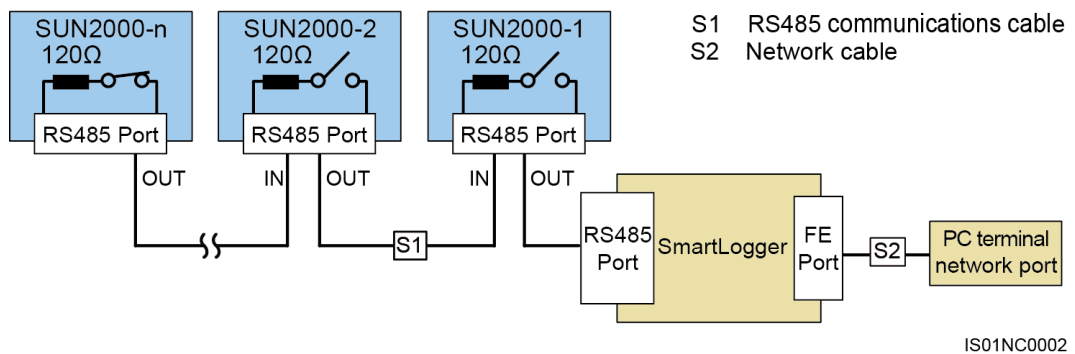


Figure 5-26 Communication mode for multiple SUN2000s



NOTE

- For the SUN2000 on the end of the chain, on the **Comm. Param.** screen of the LCD, set **Match Resistance** to **Connect** (**Disconnect** by default) to enable the build-out resistor (see [7.2.8 Setting Communications Parameters](#) for details).
- **Match Resistance** can also be set using the SUN2000 APP. For details, see the *SUN2000 APP User Manual*. If the SUN2000 APP needs to be used for setting, ensure that the SUN2000 firmware version is V100R001C81SPC101 or later.
- The communications cable should be shorter than 1000 m.
- If multiple SUN2000s need to communicate with one another and are connected to a PC over the SmartLogger, a maximum of three daisy chains can be configured to support up to 80 devices. It is recommended that the number of devices on each daisy chain be less than 30.

5.4.2 Connecting RS485 Communications Cables

Connect the SUN2000 to communications equipment (such as the data collector and PC) using RS485 communications cables.

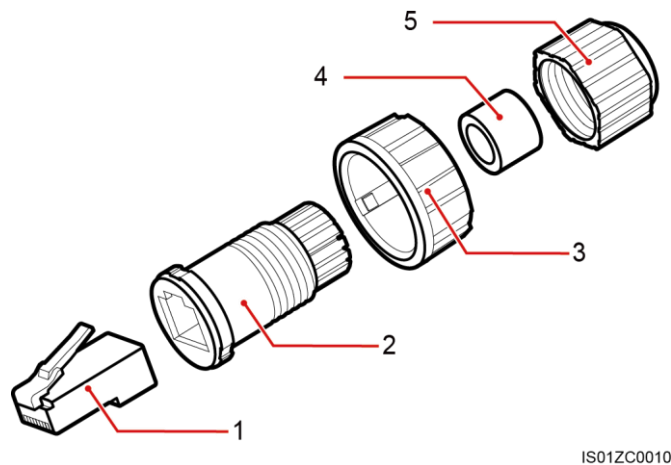
Context

A 24 AWG outdoor shielded network cable with the following specifications is recommended for use as an RS485 communications cable:

- With an internal resistance less than or equal to 1.5 ohms/10 m
- With an outer diameter of 4.5-7.5 mm (8 core wires, each with a diameter of 1.00-1.07 mm)

A waterproof RJ45 connector has five parts: shielded plug, plastic housing, coupling nut, seal ring, and sealing nut. See [Figure 5-27](#).

Figure 5-27 Waterproof RJ45 connector composition



(1) Shielded plug

(2) Plastic housing

(3) Coupling nut

(4) Seal ring

(5) Sealing nut



NOTICE

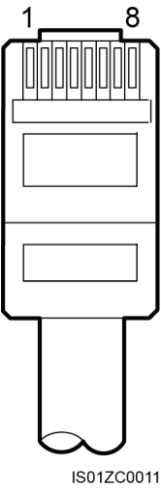
When routing communications cables, ensure that they are separated from power cables and away from interference sources to prevent communication interruptions.

Procedure

- Step 1** Remove an appropriate length of the insulation layer from the shielded network cable using a wire stripper.
- Step 2** Insert the shielded network cable through the sealing nut, seal ring, coupling nut, and plastic housing.

Step 3 Line up the exposed wires of the network cable in sequence and connect them to the corresponding pins on the plug, as shown in [Figure 5-29](#).

Figure 5-28 Connection sequence

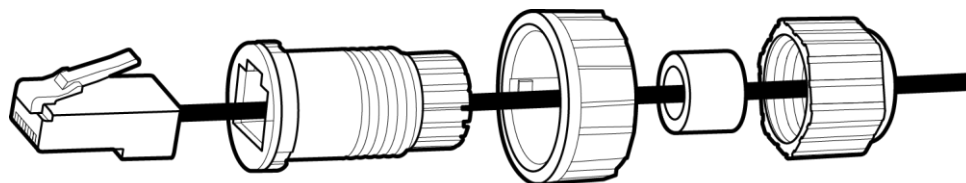


[Figure 5-28](#) shows the connector side that does not have a clip. [Table 5-3](#) lists the mapping between the pins and wires.

Table 5-3 Mapping between pins and wires

Pin No.	Color	Function
1	White-orange	RS485A, RS485 differential signal +
2	Orange	RS485B, RS485 differential signal -
3	White-green	PGND
4	Blue	RS485A, RS485 differential signal +
5	White-blue	RS485B, RS485 differential signal -
6	Green	PGND
7	White-brown	PGND
8	Brown	PGND

Figure 5-29 Connecting the plug

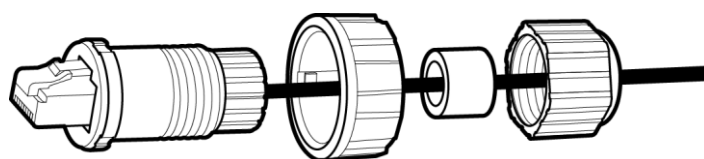


IS01IC0011

Step 4 Crimp the plug using a crimping tool.

Step 5 Secure the plastic housing to the plug, as shown in [Figure 5-30](#).

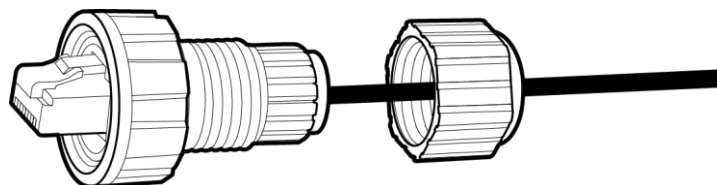
Figure 5-30 Connecting the plastic housing



IS01IC0012

Step 6 Insert the seal ring into the plastic housing and secure the coupling nut to the plastic housing, as shown in [Figure 5-31](#).

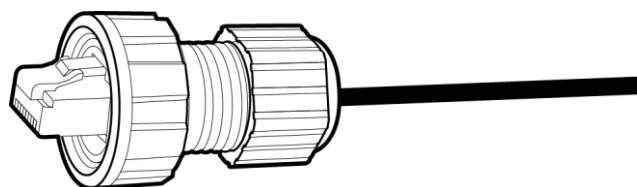
Figure 5-31 Connecting the seal ring and coupling nut



IS01IC0013

Step 7 Secure the sealing nut to the plastic housing, as shown in [Figure 5-32](#).

Figure 5-32 Connecting the sealing nut



IS01IC0014

Step 8 Insert the plug into the RS485 port on the SUN2000, and tighten the coupling nut.

----End

Follow-up Procedure

To remove the waterproof RJ45 connector from the SUN2000, remove the coupling nut, press the clip on the RJ45 connector, and pull out the RJ45 connector.

6 System Operation

This chapter describes the SUN2000 power-on and initialization process.

6.1 Checking Before Power-On

To ensure normal SUN2000 operation, check the SUN2000 before powering it on.

Before powering on the SUN2000, check that:

1. The SUN2000 is installed correctly and securely.
2. The PGND cable is securely connected.
3. All AC output power cables are securely connected.
4. All DC input power cables are securely connected.
5. Idle DC input terminals are protected with sealing caps.
6. Idle USB and RS485 ports are blocked with waterproof plugs.

6.2 Powering On the SUN2000

Power on the SUN2000 after electrical connections are completed.

Procedure

Step 1 Switch on the AC circuit breaker between the SUN2000 and the power grid.



NOTICE

If [Step 2](#) is performed before [Step 1](#), the SUN2000 reports a fault about abnormal shutdown on the LCD. Start the SUN2000 only after the fault is automatically rectified. This takes a default clearance time of 1 minute. The clearance time can be modified using LCD or the network management software running on a PC connected to the SUN2000.



NOTE

The monitoring panel is activated only after power is supplied to the DC or AC side.

- Step 2** Set the DC SWITCH at the bottom of the SUN2000 to **ON**.
- Step 3** (Optional) Measure the temperatures at the joints between the DC terminals and the connectors using a point thermometer.
- End

6.3 Setting Initialization Parameters

When starting the SUN2000 for the first time, set initialization parameters such as the system language, system time, and power grid code on the monitoring panel.

Context

If the SUN2000 is started for the first time, follow the instructions to set the initialization parameters. If the SUN2000 is not started for the first time, the startup detection screen is displayed.



NOTICE

Before setting initialization parameters, ensure that the power-on operation in [6.2 Powering On the SUN2000](#) has been completed.

Procedure

- The following table lists the procedure for setting initialization parameters. The parameter values in the figures are for reference only.

LCD Screen	Procedure
	1. Start with the initialization screen displayed while the system is loading. The default system language is English .
	2. Press Enter to enter the Wizard screen. To return to the default screen, press ESC . To reset initialization parameters, choose Settings > Wizard as Advanced User .

LCD Screen	Procedure
<pre> Initialization->Wizard Language English ✓ 中文 Deutsch Italiano Français Polski </pre>	3. Select a display language and press . The screens will be displayed in the selected language.
<pre> Initialization->Wizard Date&Time Date:2013-06-17 Time:09:42:17 </pre>	4. Set the date and time and press . - To select a parameter, press . To set the parameter value, press  or . - The date format is YYYY-MM-DD. YYYY, MM, and DD stand for year, month, and day respectively. The time format is hh-mm-ss. hh, mm, and ss stand for hour, minute, and second respectively.
<pre> Wizard->Grid Code Grid Code VDE-AR-N-4105 NB/T 32004 UTE C 15-712-1(A) UTE C 15-712-1(B) UTE C 15-712-1(C) VDE 0126-1-1-BU </pre>	5. Set the power grid code and press . To select a power grid code, click  or . NOTICE Incorrectly setting Grid Code will cause a SUN2000 startup failure. NOTE - For details about power grid codes, see B Power Grid Codes. Select an appropriate power grid code based on the requirements of the country or region. - When the sunlight is insufficient, the grid code cannot be successfully set. Wait until the sunlight becomes sufficient, log in to the system as Advanced User, and choose Settings > Wizard to set the grid code. - The SUN2000-28KTL applies only to the medium-voltage grid connection scenarios, and supports only the Chinese, German, and customized medium-voltage grid codes.
<pre> Initialization->Wizard Finished Language:English Time:2013-06-17 00:38:06 Grid Code:VDE-AR-N4105 ⏏:Confirm </pre>	6. On the Finished screen, press .



NOTICE

After the initialization parameters are set for multiple SUN2000s in the same network, set the address and baud rate for each SUN2000 based on the following rules:

- Every SUN2000 in the same daisy chain must have a unique address. If communication with the SmartLogger is required, every SUN2000 in the daisy chain must have a unique address within the address scope configured for the SmartLogger.
- All SUN2000s in the same daisy chain must have the same baud rate. If communication with the SmartLogger is required, all SUN2000s in the daisy chain must have the same baud rate configured for the SmartLogger.

----End

7 Man-Machine Interaction

Context

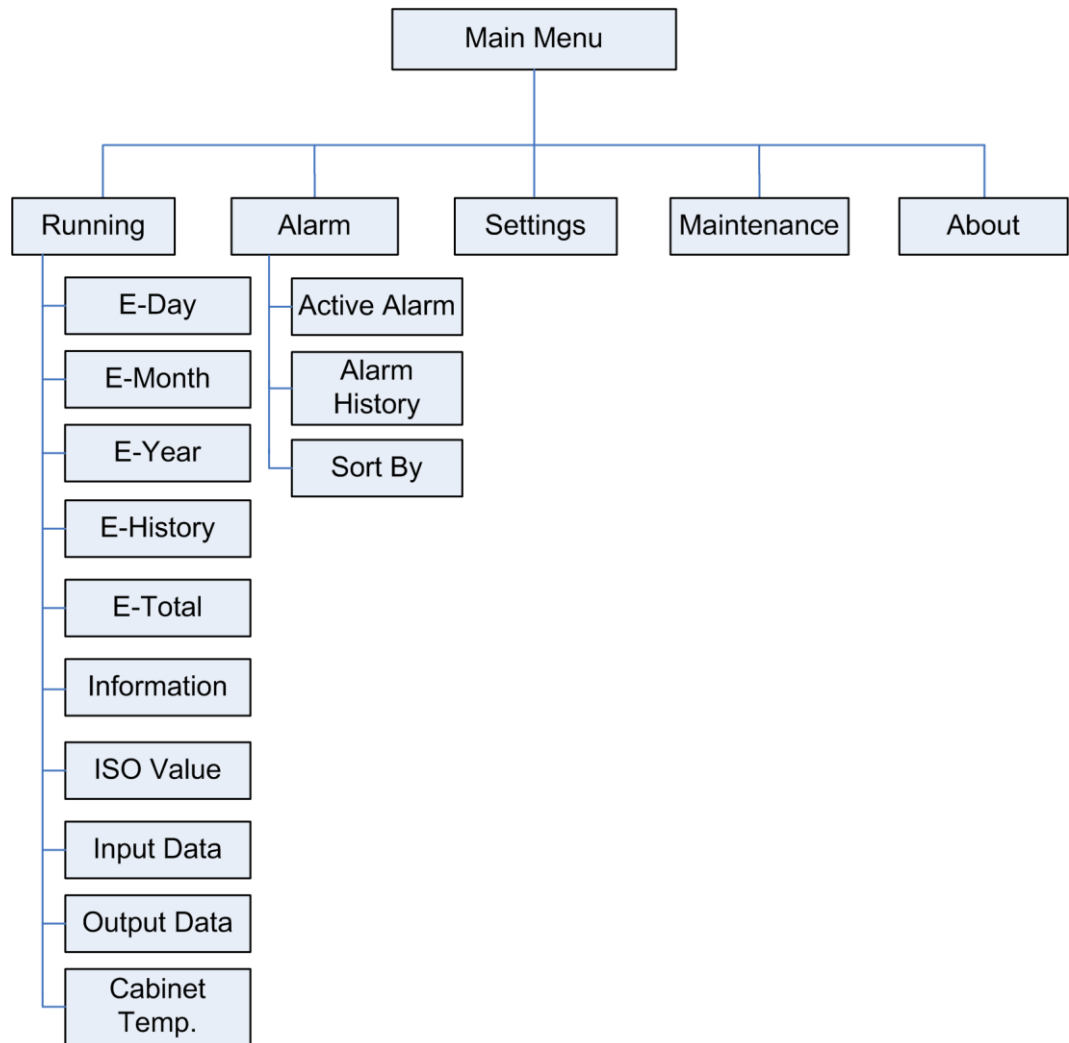
Users can interact with the SUN2000 using the LCD or SUN2000 APP. This topic uses operations on the LCD as an example. For details about operations on the SUN2000 APP, see the *SUN2000 APP User Manual*.

7.1 Monitoring Menu Hierarchy

This section describes the hierarchy of the monitoring menus on the LCD, which facilitates monitoring of the SUN2000.

[Figure 7-1](#) shows the hierarchy of the **Main Menu**.

Figure 7-1 Hierarchy of the Main Menu



IS01CC0001

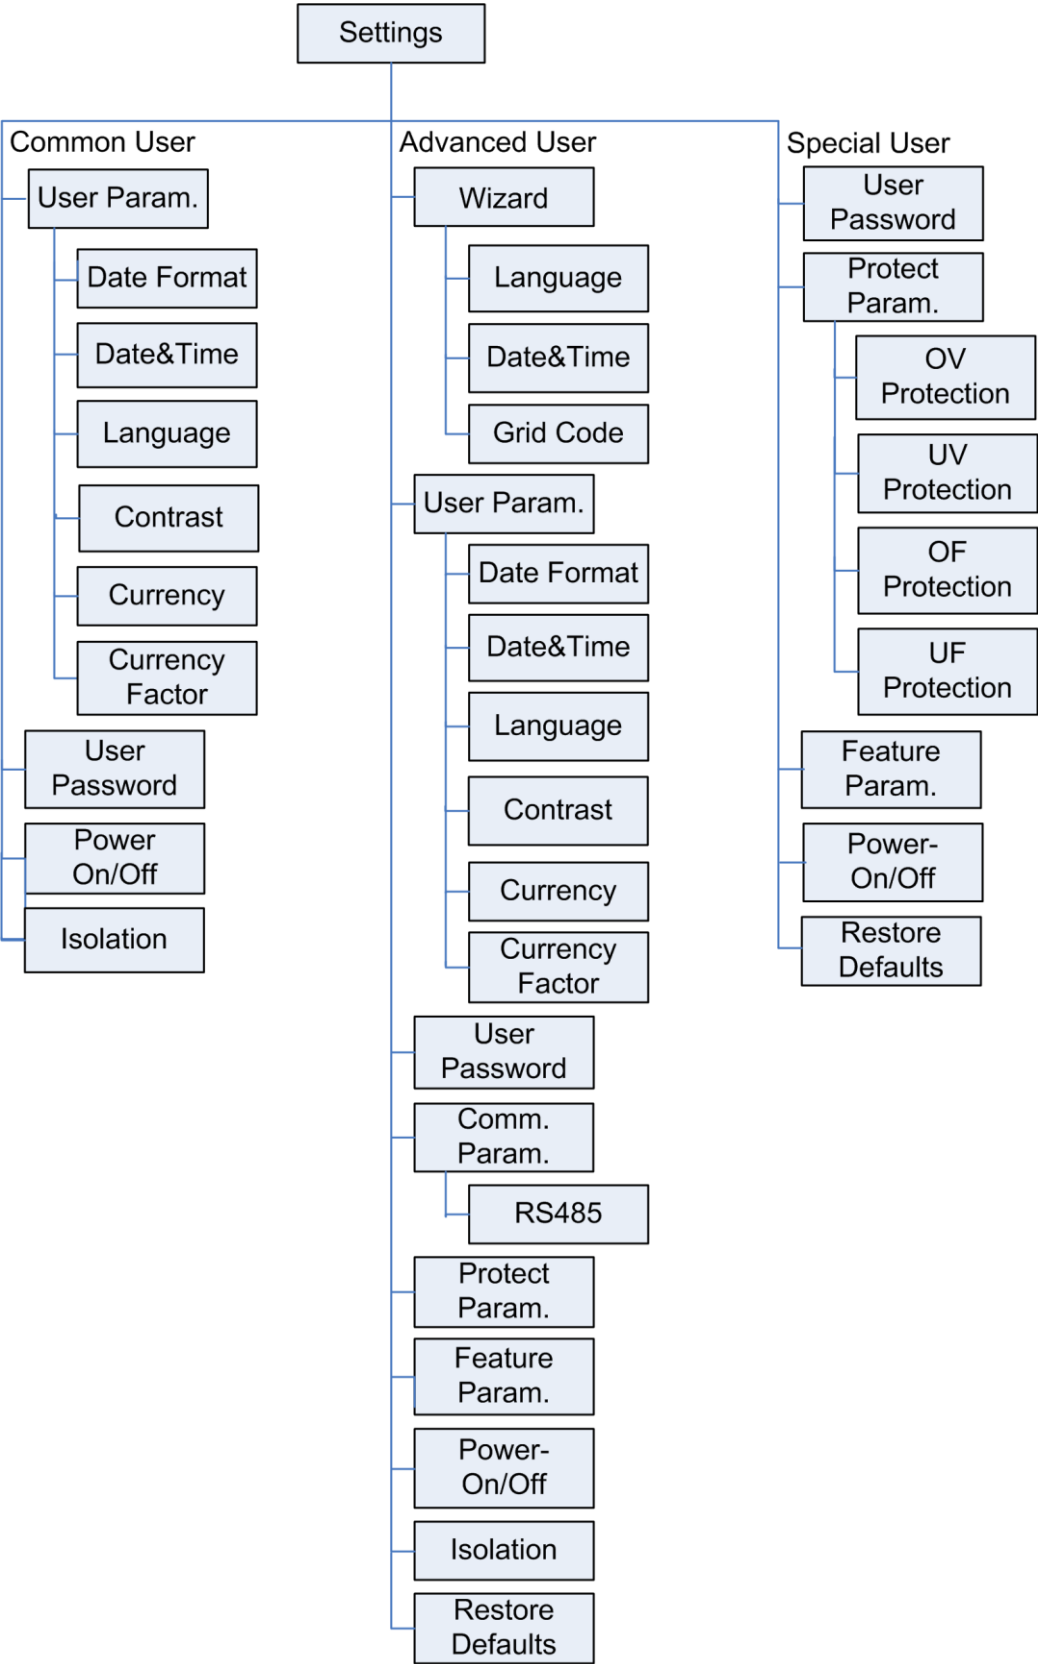
The parameters vary with user types. The three types of user are **Common User**, **Advanced User**, and **Special User**. [Figure 7-2](#) and [Figure 7-3](#) show the hierarchies under the **Settings** and **Maintenance** menus.



NOTICE

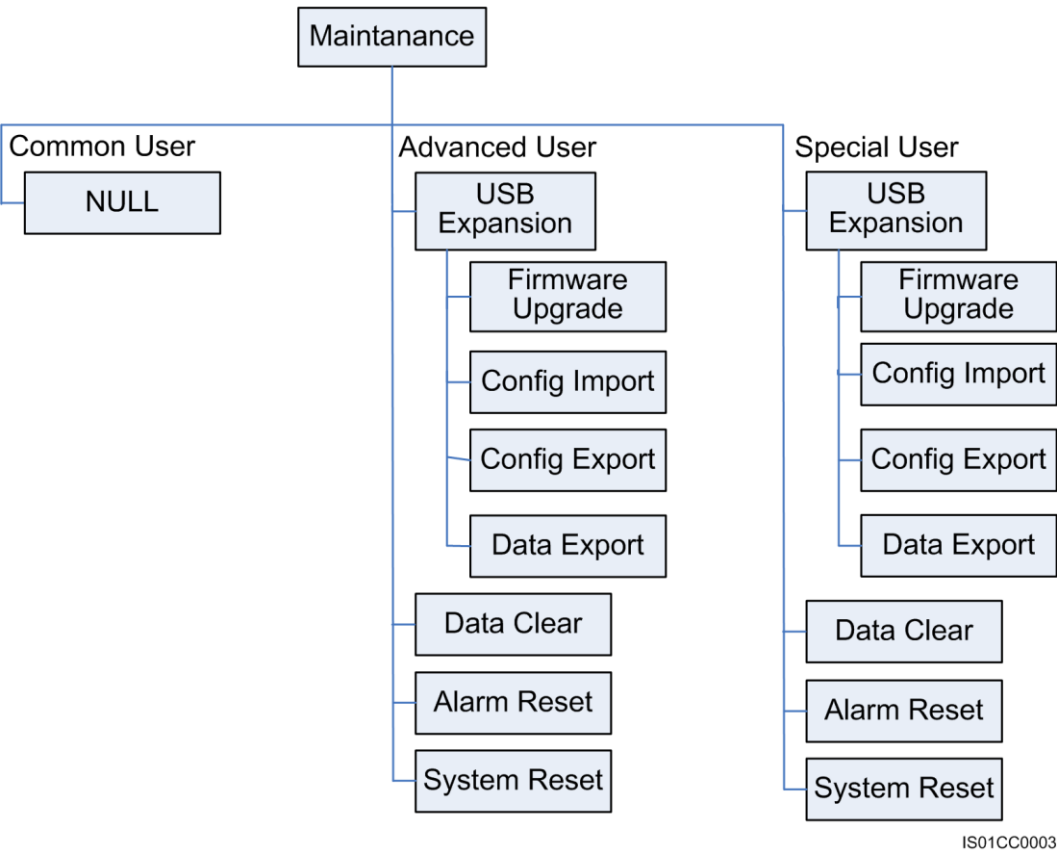
The initial password for **Common User**, **Advanced User**, and **Special User** is 000001. Use the initial password to log in to the SUN2000 for the first time and change the password immediately (see [7.2.7 Changing a User Password](#)) to ensure account safety.

Figure 7-2 Hierarchy of the Settings menu



IS01CC0002

Figure 7-3 Hierarchy of the Maintenance menu



 **NOTE**
Due to permission restrictions, the submenus under **Maintanance** will not appear when a user logs in as a **Common User**.

7.2 Monitoring Operations

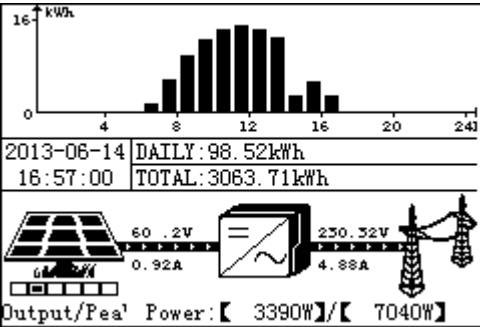
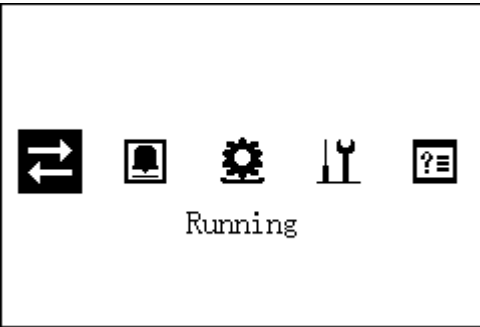
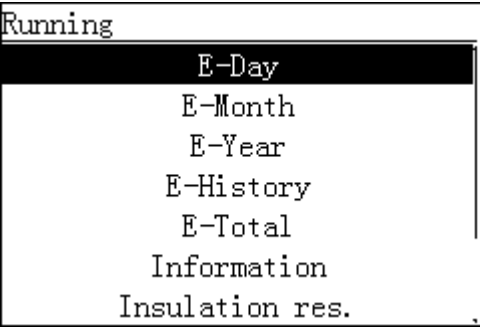
This section describes how to perform monitoring operations, such as viewing system operating information and setting user parameters, on the monitoring panel.

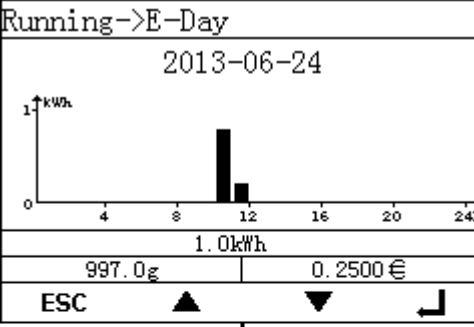
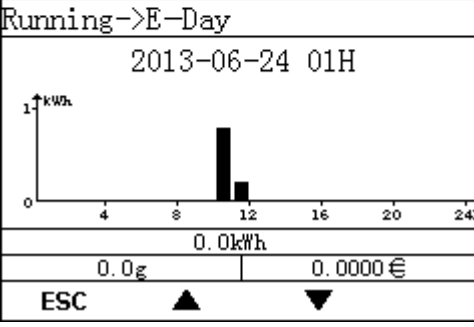
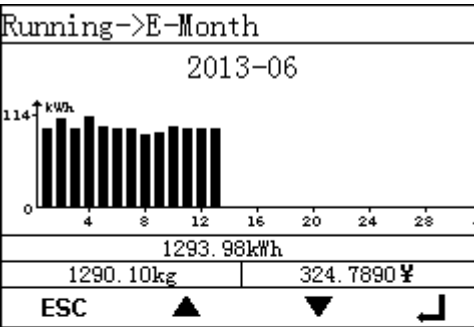
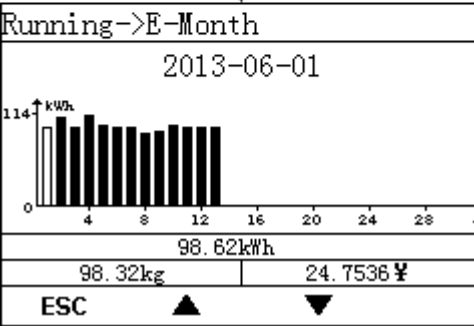
7.2.1 Viewing System Operating Information



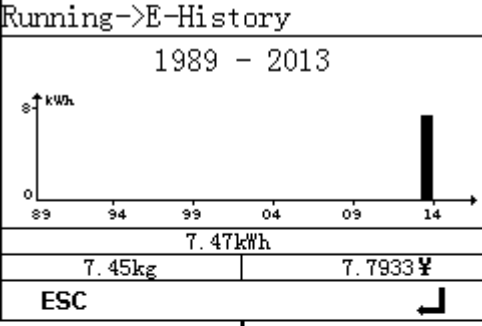

The SUN2000 operating information can be viewed on the monitoring panel. The operating information includes the daily, monthly, yearly, historical, and total energy yields, insulation resistance, input data, output data, and internal temperature.

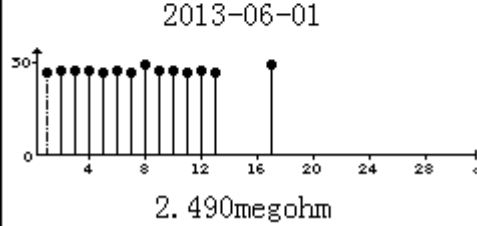
Procedure

- The following table lists the procedure for viewing system operating information. The parameter values in the figures are for reference only.

LCD	Procedure
	1. On the default screen, press  to enter the main menu.
	2. Choose  and press  .
	3. Select an operating parameter by pressing  and press  .

LCD	Procedure
Running->E-Day  Running->E-Day 	4. View the daily energy yield. a. On the E-Day screen, view the total energy yield and hourly energy yield for the current day. The displayed information includes the daily energy yield histogram, date, total energy yield of the current day, CO₂ emission reduction, and revenue from the energy yield. NOTE In the daily energy yield histogram, the time is represented by the horizontal axis in one-hour intervals. The energy yield is represented by the vertical axis. Each bar represents the total energy yield for that hour. NOTICE To view the energy yield in the past 30 days (including the current day), press ▲ or ▼. To view the hourly energy yield on a specific day, press ↩. b. Press ↩ to view the energy yield of a specific hour on the current day. To switch between hours, press ▲ or ▼. NOTE The selected block is displayed in white.
Running->E-Month  Running->E-Month 	5. View the monthly energy yield. a. On the E-Month screen, view the total energy yield and daily energy yield in the current month. The displayed information includes the monthly energy yield histogram, date, total energy yield of the current month, CO₂ emission reduction, and revenue from the energy yield. NOTE In the monthly energy yield histogram, the month is represented by the horizontal axis in one-day intervals. The energy yield is represented by the vertical axis. Each bar represents the total energy yield for that day. NOTICE To view the energy yield in the past 12 months (including the current month), press ▲ or ▼. To view the daily energy yield in a specific month, press ↩. b. Press ↩ to view the energy yield on a specific day of the current month. To switch between days, press ▲ or ▼. NOTE The selected block is displayed in white.

LCD	Procedure
Running->E-Year  Running->E-Year 	6. View the yearly energy yield. a. On the E-Year screen, view the total energy yield and monthly energy yield in the current year. The displayed information includes the yearly energy yield histogram, date, total energy yield of the current year, CO₂ emission reduction, and revenue from the energy yield. NOTE In the yearly energy yield histogram, the year is represented by the horizontal axis in one-month intervals. The energy yield is represented by the vertical axis. Each bar represents the total energy yield for that month. NOTICE To view the energy yield in the past 25 years (including the current year), press ▲ or ▼. To view the monthly energy yield in a specific year, press ←. b. Press ← to view the energy yield in a specific month of the current year. To switch between months, press ▲ or ▼. NOTE The selected block is displayed in white.
Running->E-History  Running->E-History 	7. On the E-History screen, view the historical energy yield. The LCD displays the yearly energy yield histogram, time periods, total energy yield of the selected year, CO₂ emission reduction, and revenue from the energy yield. Data of the past 25 years (current year included) are available. NOTE In the yearly energy yield histogram, the year is represented on the horizontal axis. The energy yield is represented by the vertical axis. Each bar represents the total energy yield for that year. Press ←, then press ▲ or ▼ to view the energy yield of the selected year.

LCD	Procedure
Running->E-Total E-Total:2993.36kWh CO₂ Reduction:2984.38kg Gain:751.3334¥	8. On the E-Total screen, view the total energy yield, CO₂ emission reduction, and revenue.
Information Address:1 Version:V100R001C81SPC103 Name:	9. On the Information screen, view the address, firmware version, and device name.
Running->ISO Value 2013-06  2.800megohm ESC ▲ ▼ ↵ Running->ISO Value 2013-06-01  2.490megohm ESC ▲ ▼	10. On the ISO Value screen, view the daily insulation resistance (ISO value) in the current month. Press ↵ to view the insulation resistance detected at the last connection to the power grid for each day of the current month.

LCD	Procedure
Running->Input Data <pre> PV1 V/I: 461.9V/1.60A PV2 V/I: 461.9V/0.63A PV3 V/I: 186.4V/0.03A PV4 V/I: 186.3V/0.00A PV5 V/I: 187.7V/0.05A PV6 V/I: 187.7V/0.00A </pre>	11. On the Input Data screen, view the voltage and current of each PV input.
Running->Output Data <pre> Ua: 230.40V Ia: 4.86A Ub: 230.41V Ib: 4.87A Uc: 230.42V Ic: 4.88A Active power: 3390W </pre> The preceding screen is displayed on all models except the SUN2000-28KTL.	12. On the Output Data screen, view the output voltage and current of each phase, active power, output frequency, and output power factor. NOTE As the SUN2000-28KTL has three-phase, three-wire outputs, the output voltage and current are the line voltage and line current.
Running->Cabinet Temp. <pre> Cabinet Temp.: 26.6degC </pre>	13. On the Cabinet Temp. screen, view the internal temperature of the SUN2000.

----End

7.2.2 Viewing Alarm Records

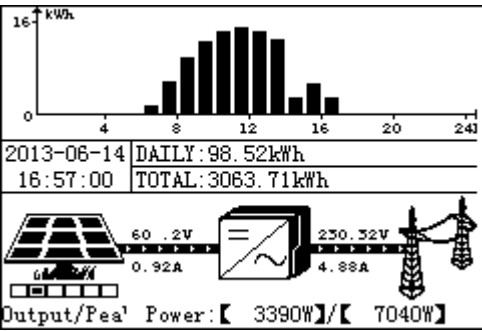
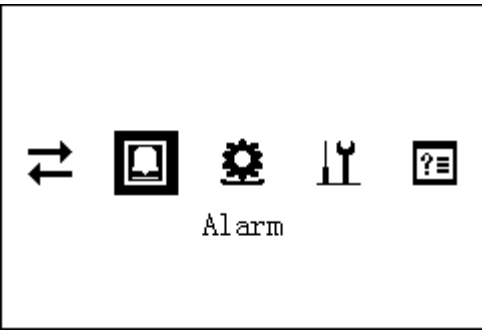
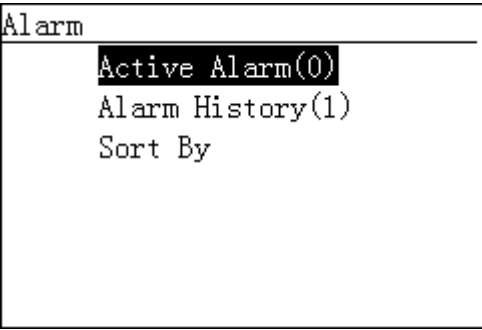
The monitoring panel displays the active and historical alarm records and allows setting of the sort mode of the alarm records.

Context

The LCD displays a maximum of 800 latest alarm records.

Procedure

- The following table lists the procedure for viewing active and historical alarms and setting the alarm record sort mode. The parameter values in the figures are for reference only.

LCD	Procedure
	1. On the default screen, press  to enter the main menu.
	2. Choose  and press  .
	3. Select a menu by pressing  and press  . You can view alarm details, or set the alarm record sort mode. - To view active alarms, go to step 4. - To view historical alarms, go to step 5. - To set the alarm record sort mode, go to step 6.

LCD	Procedure
Alarm->Active alarm(1/3) ①Fan Fault ①Surge Arrester Fault ①Version Mismatch ↓ Fan Fault(1/3) Alarm ID:320 Severity:Minor ① occur:2012-12-27 15:07:23 Info: Error Code = 0x00000001	4. On the Active Alarm (A/B) screen, select an alarm record, and press  to view the alarm details.
Alarm->Alarm History(1/1) ①Sting 1 Abnormal/ID:1 ↓ Sting 1 Abnormal(1/1) Alarm ID:106 Severity:Warning ① Generate:2013-04-28 18:36:08 Clear:2013-04-28 21:33:44 Info: Reason ID = 1	5. On the Alarm History (A/B) screen, select an alarm record, and press  to view the alarm details.

LCD	Procedure
Alarm Active Alarm(0) Alarm History(1) Sort By Alarm Sort By By Generation Time ✓ By Alarm Severity	6. On the Sort By screen, select By Generation Time or By Alarm Severity .

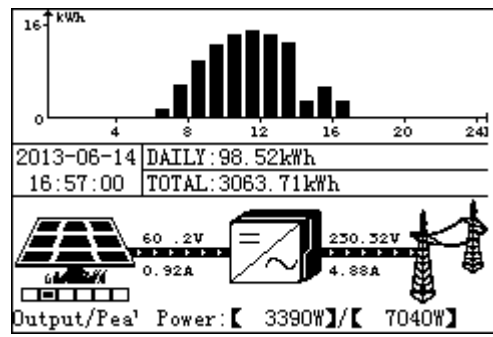
----End


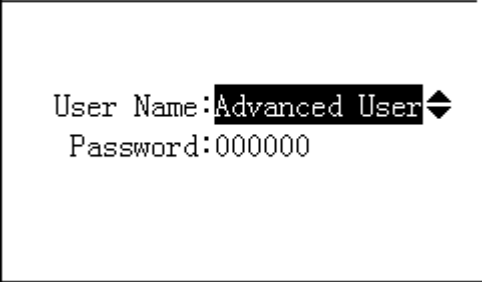
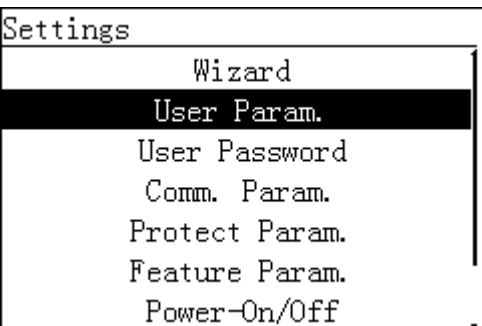

7.2.3 Setting System Time

The date format and date and time can be set on the monitoring panel.

Procedure

- The following table lists the procedure for setting the date format and date and time. The parameter values in the figures are for reference only.

LCD Screen	Operation Procedure
	1. On the default screen, press  to enter the main menu.

LCD Screen	Operation Procedure
	2. Choose  and press  .
Settings->The password. 	3. Enter the correct user name and password by pressing  or  , and press  .
Settings  An Advanced User has logged in to the SUN2000.	4. Choose User Param. and press  .
Settings->User Param. 	5. Choose Date Format or Date&Time by pressing  , and press  .

LCD Screen	Operation Procedure
Settings->User Param. Date Format Date&Time Language Contrast Currency Currency Factor	
Settings->User Param. Date Format YYYY-MM-DD MM-DD-YYYY DD-MM-YYYY	6. On the Date Format screen, select a date format, and press  .
Settings->User Param. Date&Time Date:2013-06-17 Time:09:42:17	7. On the Date&Time screen, set the date and time, and press  - To select a parameter, press . To set the parameter value, press  or . - The date format is YYYY-MM-DD. YYYY, MM, and DD stand for year, month, and day respectively. The time format is hh-mm-ss. hh, mm, and ss stand for hour, minute, and second respectively.

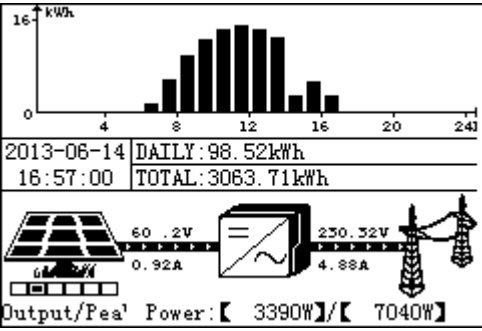
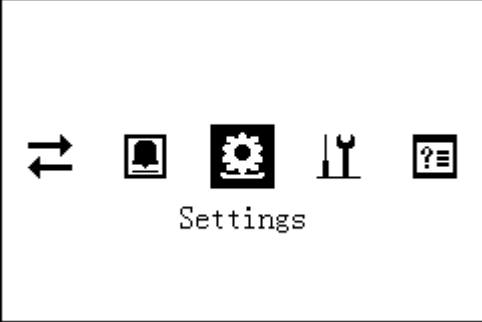
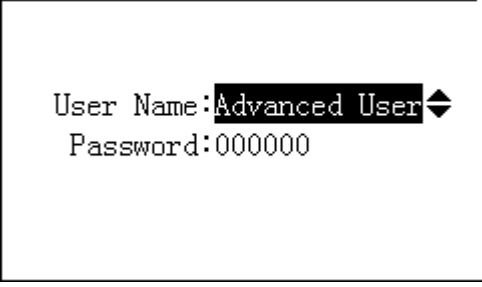
----End



7.2.4 Setting the System Language

This topic describes how to set the SUN2000 display language on the monitoring panel.

Procedure

- The following table lists the procedure for setting the display language. The parameter values in the figures are for reference only.

LCD	Procedure
 The LCD screen displays a bar chart of power generation over 24 hours. Below the chart, it shows the date and time (2013-06-14 16:57:00) and cumulative power generation (DAILY: 98.52kWh, TOTAL: 3063.71kWh). It also displays solar panel and inverter status with voltage and current readings (60.2V, 0.92A, 230.32V, 4.88A). At the bottom, it shows Output/Peak Power: [3390W] / [7040W].	1. On the default screen, press  to enter the main menu.
 The LCD screen shows the Settings menu with five icons: a double arrow, a bell, a gear, a wrench, and a question mark. The word "Settings" is displayed below the icons.	2. Choose  and press  .
Settings->The password.  The LCD screen displays the login information: User Name: Advanced User and Password: 000000.	3. Enter the correct user name and password by pressing  or  , and press  .
Settings  The LCD screen shows the Settings menu with the following options: Wizard, User Param. (highlighted), User Password, Comm. Param., Protect Param., Feature Param., and Power-On/Off. An Advanced User has logged in to the SUN2000.	4. Choose User Param. and press  .

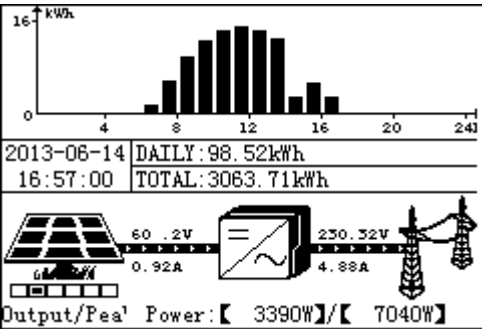
LCD	Procedure
	5. Choose Language by pressing ▼ and press ↵.
	6. On the Language screen, select a display language, and press ↵. The screens will be displayed in the selected language.


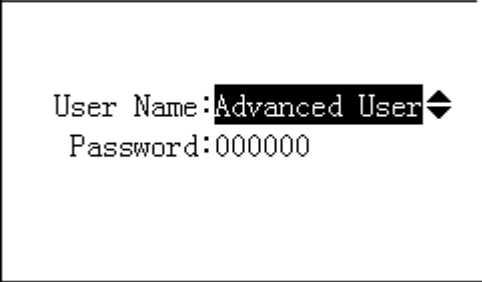
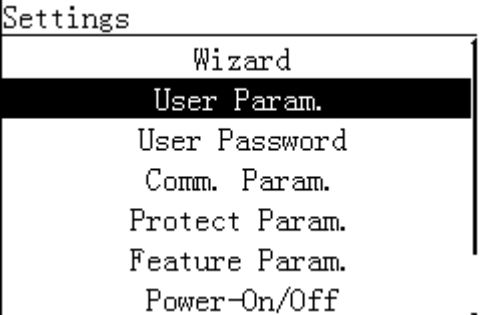
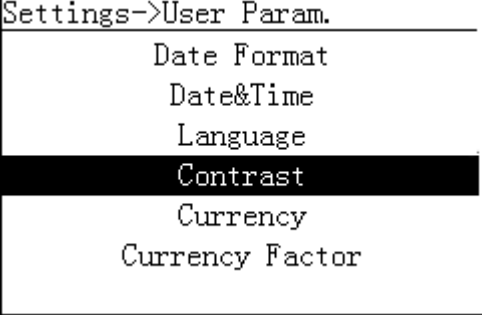
----End

7.2.5 Setting the Contrast

Procedure

- The following table lists the procedure for setting the contrast. The parameter values in the figures are for reference only.

LCD Screen	Procedure
	1. On the default screen, press ↵ to enter the main menu.

LCD Screen	Procedure
	2. Choose  and press .
Settings->The password. 	3. Enter the correct user name and password by pressing  or , and press . NOTE - The optional user names are Common User and Advanced User. The initial password for Common User and Advanced User is 000001. If you forgot the password, contact Huawei technical support for a dynamic password that is effective only on the current day. Change the password after login. - After the authentication is successful, the system keeps the authentication information for 30 seconds. If you exit from the Settings screen and log in again within 30 seconds, no authentication is required.
Settings  An Advanced User has logged in to the SUN2000.	4. Choose User Param. and press .
Settings->User Param. 	5. Choose Contrast by pressing , and press .

LCD Screen	Procedure
	6. On the Contrast screen, press ▲ and ▼ to set the contrast.

----End

7.2.6 Setting the Currency and Currency Factor

The currency and the revenue per kilowatt hour can be set on the monitoring panel, which allows the calculation of revenue from the energy yield.

Procedure

- The following table lists the procedure for setting the currency and currency factor. The parameter values in the figures are for reference only.

LCD Screen	Procedure
	1. On the default screen, press ↵ to enter the main menu.
	2. Choose ⚙ and press ↵.

LCD Screen	Procedure
Settings->The password. User Name:Advanced User↕ Password:000000	3. Enter the correct user name and password by pressing ▲ or ▼, and press ↵. NOTE - The optional user names are Common User and Advanced User. The initial password for Common User and Advanced User is 000001. If you forgot the password, contact Huawei technical support for a dynamic password that is effective only on the current day. Change the password after login. - After the authentication is successful, the system keeps the authentication information for 30 seconds. If you exit from the Settings screen and log in again within 30 seconds, no authentication is required.
Settings Wizard User Param. User Password Comm. Param. Protect Param. Feature Param. Power-On/Off An Advanced User has logged in to the SUN2000.	4. Choose User Param. and press ↵.
Settings->User Param. Date Format Date&Time Language Contrast Currency Currency Factor ↓ Settings->User Param. Currency EUR GBP USD CNY	5. Set the currency. a. Select Currency by pressing ▼, and press ↵. b. Select a currency and press ↵.

LCD Screen	Procedure
Settings->User Param. Date Format Date&Time Language Contrast Currency Currency Factor ↓ Settings->User Param. Currency Factor 0 0 0. 2 5 1	6. Set the currency factor. NOTE The currency factor is the local price of electricity. a. Select Currency Factor by pressing ▼, and press ↵. b. Set the currency factor by pressing ▲ or ▼, and press ↵.

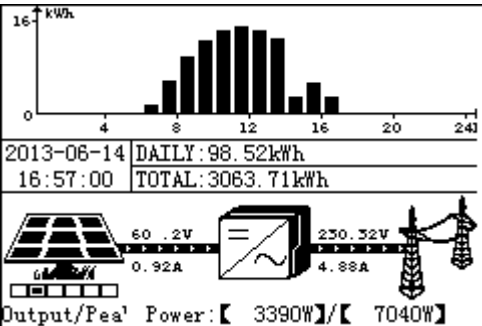
----End


7.2.7 Changing a User Password

The user password can be changed on the monitoring panel.

Procedure

- The following table lists the procedure for setting a new password. The parameter values in the figures are for reference only.

LCD Screen	Procedure
	1. On the default screen, press ↵ to enter the main menu.

LCD Screen	Procedure
	2. Choose  and press  .
Settings->The password. User Name:Advanced User▲▼ Password:000000	3. Enter the correct user name and password by pressing ▲ or ▼, and press  NOTE - The optional user names are Common User, Advanced User, and Special User. The initial password for these accounts is 000001. If you forgot the password, contact Huawei technical support for a dynamic password that is effective only on the current day. Change the password after login. - After the authentication is successful, the system keeps the authentication information for 30 seconds. If you exit from the Settings screen and log in again within 30 seconds, no authentication is required.
Settings Wizard User Param. User Password Comm. Param. Protect Param. Feature Param. Power-On/Off	4. Choose User Password by pressing ▼, and press  .
Settings->User Password Enter the old password: 0 0 0 0 0 0 (000000-999999)	5. Enter the old password and press  Increase or decrease the value by pressing ▲ or ▼. Switch between digits by pressing  .

LCD Screen	Procedure
Settings->User Password Enter a new password: 0 0 0 0 0 0 (000000-999999)	6. Enter a new password and press  . Increase or decrease the value by pressing  or  . Switch between digits by pressing  .
Settings->User Password Enter the new password again: 0 0 0 0 0 0 (000000-999999)  Settings->User Password Password changed successfully :Enter	7. Enter the new password again and press  . NOTE Ensure that the re-entered password is the same as the new password. Otherwise, an error message will be displayed. After the password has been changed, the LCD displays a success message.

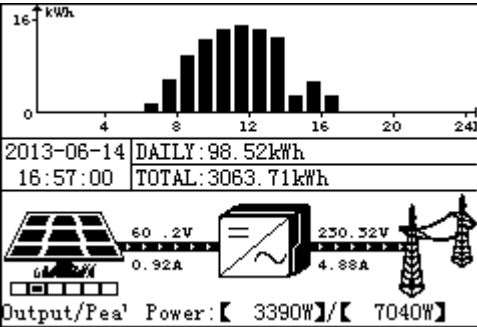
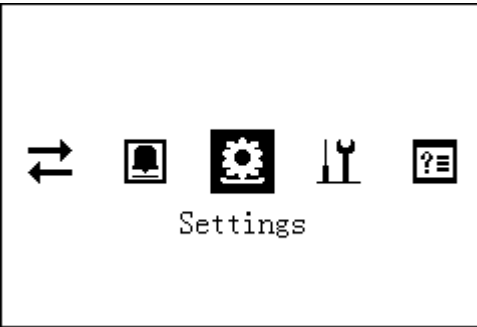
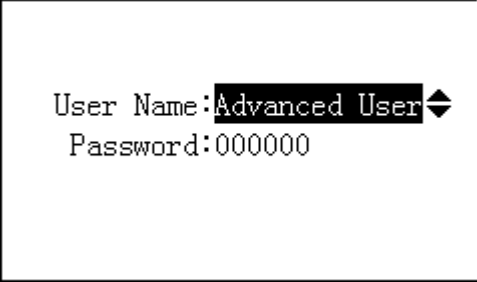
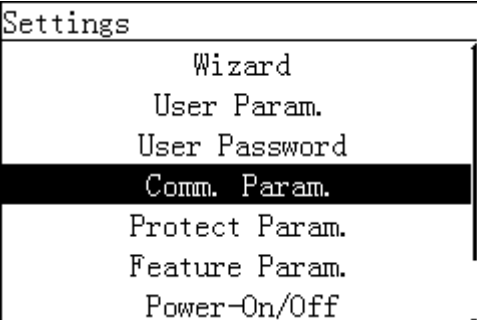
----End



7.2.8 Setting Communications Parameters

RS485 communications parameters such as the address, protocol, baud rate, and check mode can be set on the monitoring panel.

Procedure

- The following table lists the procedure for setting communications parameters. The parameter values in the figures are for reference only.

LCD Screen	Procedure
 2013-06-14 16:57:00 DAILY: 98.52kWh TOTAL: 3063.71kWh Output/Peak Power: 3390W / 7040W	1. On the default screen, press  to enter the main menu.
 Settings	2. Choose  and press .
Settings->The password.  User Name: Advanced User Password: 000000	3. Enter the correct user name and password by pressing  or , and press . NOTE - The optional user name is Advanced User. The initial password for Advanced User is 000001. If you forgot the password, contact Huawei technical support for a dynamic password that is effective only on the current day. Change the password after login. - After the authentication is successful, the system keeps the authentication information for 30 seconds. If you exit from the Settings screen and log in again within 30 seconds, no authentication is required.
 Settings Wizard User Param. User Password Comm. Param. Protect Param. Feature Param. Power-On/Off	4. Choose Comm. Param., and press .

LCD Screen	Procedure
	5. On the Comm. Param. screen, press  .
	6. Set Address, Protocol, Baud Rate , and Match Resistance , and press  . • The optional addresses range from 1 to 247. • The optional protocol is modbus. • The optional baud rates are 4800bps, 9600bps, and 19200bps. • The optional parities are None, Even parity, Odd parity. • The optional values of match resistance are Disconnect and Connect. This parameter is set to Disconnect by default. If signals are distorted or the communication is of poor quality because of a lengthy communications cable, set the parameter to Connect.

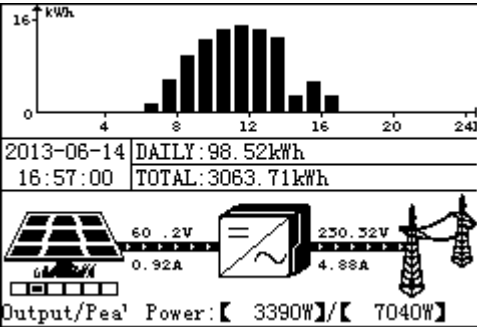
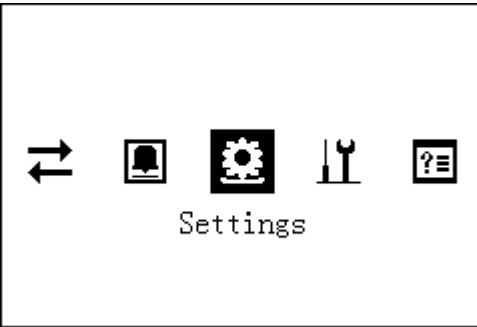
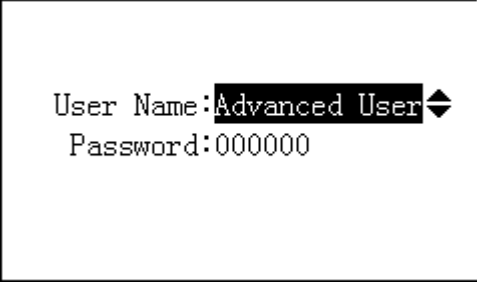
----End

7.2.9 Setting Protection Parameters

SUN2000 protection parameters can be set on the monitoring panel.

Procedure

- The following table lists the procedure for setting protection parameters. The parameter values in the figures are for reference only.

LCD Screen	Procedure
 2013-06-14 16:57:00 DAILY: 98.52kWh TOTAL: 3063.71kWh Output/Peak Power: [3390W] / [7040W]	1. On the default screen, press  to enter the main menu.
 Settings	2. Choose  and press .
Settings->The password.  User Name: Advanced User Password: 000000	3. Enter the correct user name and password by pressing  or , and press . NOTE - The optional user names are Advanced User and Special User. The initial password for Advanced User and Special User is 000001. If you forgot the password, contact Huawei technical support for a dynamic password that is effective only on the current day. Change the password after login. - After the authentication is successful, the system keeps the authentication information for 30 seconds. If you exit from the Settings screen and log in again within 30 seconds, no authentication is required.
Settings  Wizard User Param. User Password Comm. Param. Protect Param. Feature Param. Power-On/Off An Advanced User has logged in to the SUN2000.	4. Choose Protect Param. and press . - If you have logged in to the SUN2000 as Advanced User, perform step 5. - If you have logged in to the SUN2000 as Special User, perform step 6.

LCD Screen	Procedure
Protect Param. ->Protect Param. Insulation res. protec.:megohm Soft start time:20s On-grid recovery time:60s An Advanced User has logged in to the SUN2000.	5. Set Insulation res. protec. , Soft start time and On-grid recovery time , and press ↵. The parameters displayed vary with the setting of Grid Code .
Settings->Protect Param. OV Protection UV Protection OF Protection UF Protection A Special User has logged in to the SUN2000.	6. Select a parameter and press ↵.

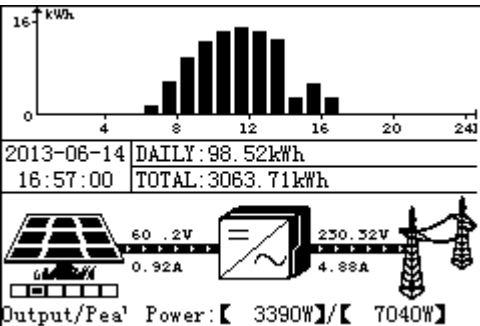
----End


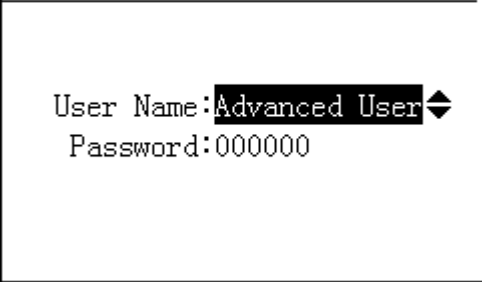
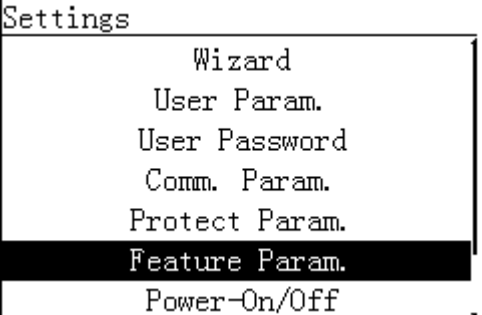
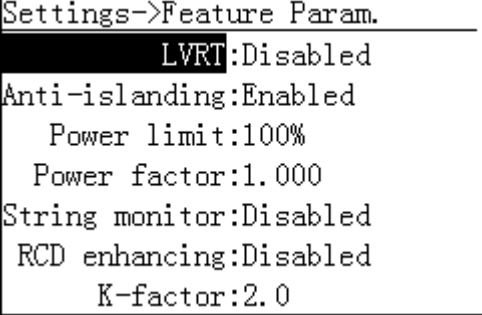
7.2.10 Setting Feature Parameters

SUN2000 feature parameters can be set on the monitoring panel.

Procedure

- The following table lists the procedure for setting feature parameters. The parameter values in the figures are for reference only.

LCD Screen	Procedure
	1. On the default screen, press ↵ to enter the main menu.

LCD Screen	Procedure
	2. Choose  and press .
Settings->The password. 	3. Enter the correct user name and password by pressing  or , and press . NOTE - The optional user names are Advanced User and Special User. The initial password for Advanced User and Special User is 000001. If you forgot the password, contact Huawei technical support for a dynamic password that is effective only on the current day. Change the password after login. - After the authentication is successful, the system keeps the authentication information for 30 seconds. If you exit from the Settings screen and log in again within 30 seconds, no authentication is required.
Settings  An Advanced User has logged in to the SUN2000.	4. Choose Feature Param. and press . - If you have logged in to the SUN2000 as Advanced User, perform step 5. - If you have logged in to the SUN2000 as Special User, perform step 6.
Settings->Feature Param.  An Advanced User has logged in to the SUN2000.	5. Set LVRT, Anti-islanding, Power limit, Power factor, String monitor, and press . If String monitor is set to Enable, the SUN2000 monitors the operating status of all the connected PV strings in real time. A warning is generated as a reminder to rectify an abnormality that has been detected (for example, modules are shielded for a long time or are faulty).

LCD Screen	Procedure
Settings->Feature Param. Ugrid-Unbalance:50.0% 10-min Over-Volt:253.00V 10-min OV Prot.time:200ms A Special User has logged in to the SUN2000.	6. Set Ugrid-Unbalance, 10-min Over-Volt, and 10-min OV Prot. time, and press . The parameters displayed vary with the setting of Grid Code.

----End

7.2.11 Setting Isolation Parameters

SUN2000 isolation parameters can be set on the monitoring panel.

Context

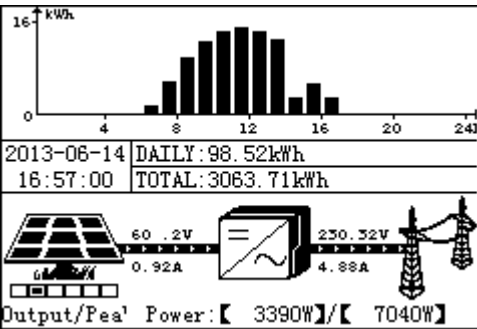



NOTICE

If PV strings are grounded, install a three-phase four-wire isolation transformer and set **Isolation** to **Input Grounded, With TF**.

Procedure

- The following table lists the procedure for setting isolation parameters. The parameter values in the figures are for reference only.

LCD	Procedure
	1. On the default screen, press  to enter the main menu.

LCD	Procedure
	2. Choose  and press  .
Settings->The password. User Name:Advanced User↕ Password:000000	3. Enter the correct user name and password by pressing  or  , and press  . NOTE • The optional user names are Common User and Advanced User. The initial password for Common User and Advanced User is 000001. If you forgot the password, contact Huawei technical support for a dynamic password that is effective only on the current day. Change the password after login. • After the authentication is successful, the system keeps the authentication information for 30 seconds. If you exit from the Settings screen and log in again within 30 seconds, no authentication is required.
Settings User Password Comm. Param. Protect Param. Feature Param. Power-On/Off Isolation Restore Defaults	4. Choose Isolation and press  .
Main Menu->Settings Isolation Input Grounded,With TF Input Ungrounded,Without TF✓ Input Ungrounded,With TF	5. Select an isolation method and press  .



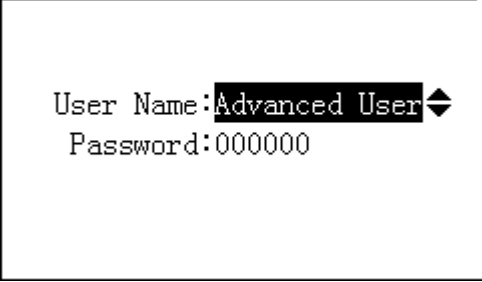
----End

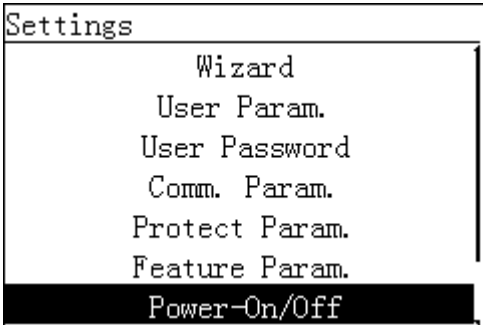
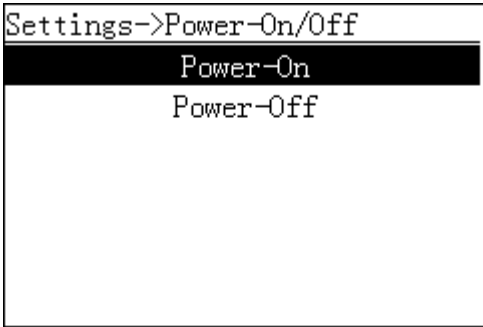
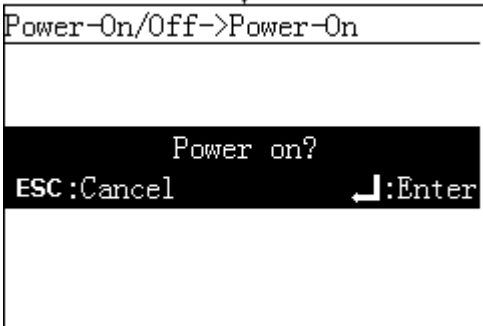
7.2.12 Manually Starting and Shutting down the SUN2000

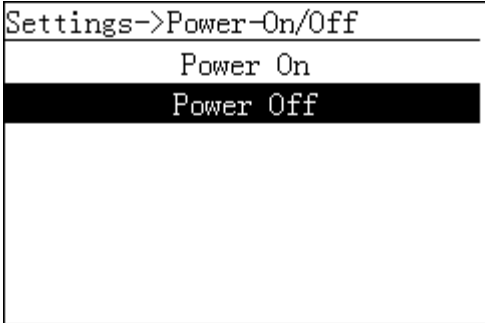
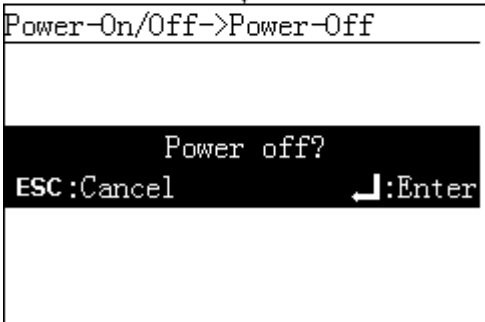
The SUN2000 can be manually started and shut down on the monitoring panel.

Procedure

- The following table lists the procedure for manually starting and shutting down the SUN2000. The parameter values in the figures are for reference only.

LCD Screen	Procedure
	1. On the default screen, press  to enter the main menu.
	2. Choose  and press  .
Settings->The password. 	3. Enter the correct user name and password by pressing  or  , and press  .
	NOTE - The optional user names are Common User, Advanced User, and Special User. The initial password for these accounts is 000001. If you forgot the password, contact Huawei technical support for a dynamic password that is effective only on the current day. Change the password after login. - After the authentication is successful, the system keeps the authentication information for 30 seconds. If you exit from the Settings screen and log in again within 30 seconds, no authentication is required.

LCD Screen	Procedure
 Settings Wizard User Param. User Password Comm. Param. Protect Param. Feature Param. Power-On/Off An Advanced User has logged in to the SUN2000.	4. Choose Power-On/Off and press . - To manually start the SUN2000, go to step 5. - To manually shut down the SUN2000, go to step 6.
 Settings->Power-On/Off Power-On Power-Off ↓  Power-On/Off->Power-On Power on? ESC:Cancel :Enter	5. Manually start the SUN2000. a. Choose Power-On and press . b. Press  again to confirm the operation.

LCD Screen	Procedure
 Settings->Power-On/Off Power On Power Off	6. Manually shut down the SUN2000.
 Power-On/Off->Power-Off Power off? ESC:Cancel Enter:Enter	a. Choose Power-Off and press  . b. Press  again to confirm the operation.

----End

7.2.13 Restoring Factory Settings

Factory settings for the SUN2000 can be restored on the monitoring panel. The operation will restore all configured parameters except the current date and time to their factory settings. The operation will not impact alarm records, system logs, and operating information.

Context

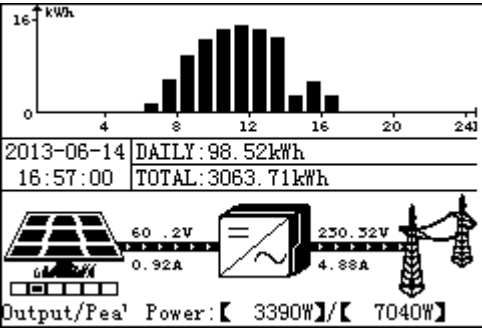
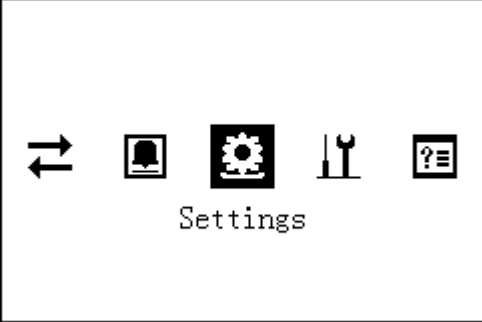
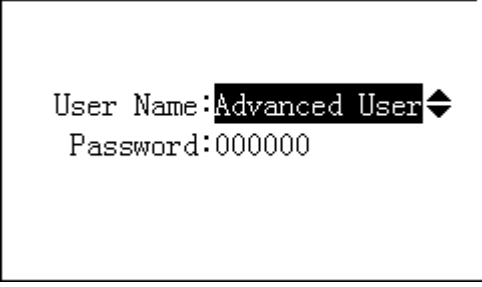
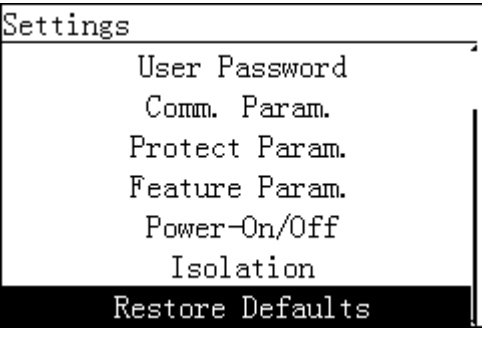


NOTICE

- Perform this operation with caution because all configured parameters except the current date and time will be restored to their factory settings.
- If PV strings are grounded, install a three-phase four-wire isolation transformer and set **Isolation** to **Input Grounded, With TF**.

Procedure

- The following table lists the procedure for restoring factory settings. The parameter values in the figures are for reference only.

LCD	Procedure
	1. On the default screen, press  to enter the main menu.
	2. Choose  and press  .
Settings->The password. 	3. Enter the correct user name and password by pressing  or  , and press  .
	4. Choose Restore Defaults and press  .

- NOTE**
- The optional user names are **Advanced User** and **Special User**. The initial password for **Advanced User** and **Special User** is 000001. If you forgot the password, contact Huawei technical support for a dynamic password that is effective only on the current day. Change the password after login.
 - After the authentication is successful, the system keeps the authentication information for 30 seconds. If you exit from the **Settings** screen and log in again within 30 seconds, no authentication is required.

LCD	Procedure
Settings->Restore Defaults Restore defaults? ESC:Cancel ↵:Enter	5. On the displayed screen, press ↵.
Settings->Restore Defaults Complete. ↵:Enter	6. Press ↵ to complete the settings. NOTE After factory settings are restored, the display language is English and the Wizard screen is displayed.

----End

7.2.14 Enabling USB Guide Functions

USB guide functions can be enabled on the monitoring panel. Upgrade firmware, import configurations, export configurations and export data with a USB flash drive when USB guide functions have been enabled.

Context

The USB guide functions are described as follows:

- Firmware upgrade: Upgrade the SUN2000 software.



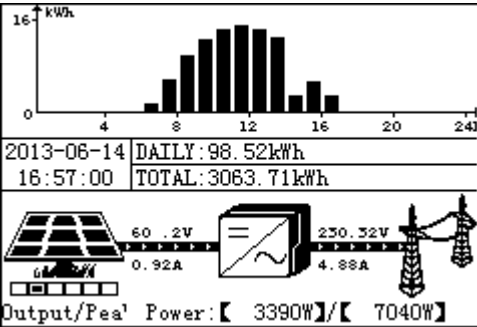
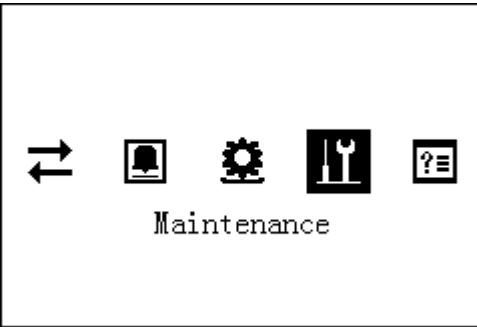
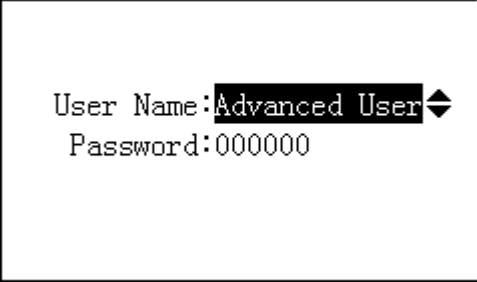
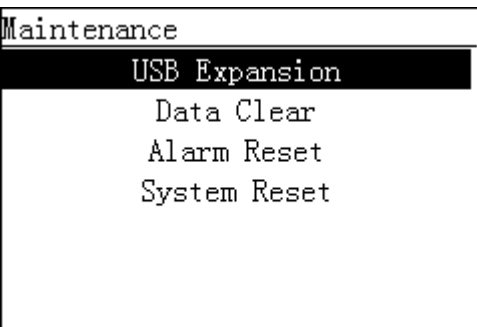
NOTE


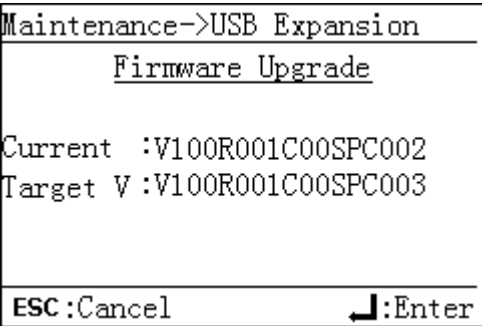


Inverters can be upgraded in batches using the SmartLogger or NMS.

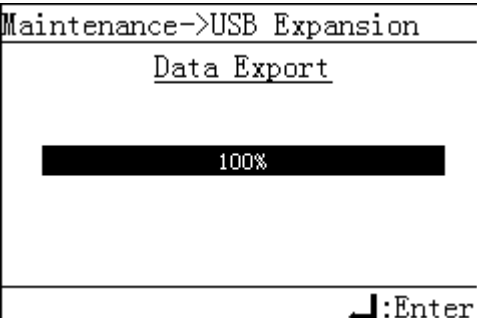
- Configuration importing: Load an existing configuration file to the SUN2000 and update the configuration parameters in batches (all parameter settings on the LCD).
- Configuration exporting: Download the configuration parameters to the local computer as a file.
- Data exporting: Download the alarm records, performance data, and logs to the local computer as a file to facilitate analysis.

Procedure

- The following table lists the procedure for enabling USB guide functions. The parameter values in the figures are for reference only.

LCD	Procedure
 The LCD screen displays a bar chart of power generation over 24 hours. Below the chart, it shows the date (2013-06-14), time (16:57:00), daily power (DAILY: 98.52kWh), and total power (TOTAL: 3063.71kWh). At the bottom, it shows system parameters: 60.2V, 0.92A, 230.32V, and 4.88A. The output power is shown as 3390W and 7040W.	1. On the default screen, press  to enter the main menu. NOTE On the default screen, after you insert a USB flash drive and log in to the system, the USB expansion screen is displayed. In this case, perform operations in step 5.
 The LCD screen shows the Maintenance menu with five icons: a double arrow, a bell, a gear, a wrench, and a question mark. The word "Maintenance" is displayed below the icons.	2. Choose  and press .
Maintenance->The password.  The LCD screen shows the password entry screen. It displays "User Name: Advanced User" and "Password: 000000".	3. Enter the correct user name and password by pressing  or , and press . NOTE - The optional user names are Advanced User and Special User. The initial password for Advanced User and Special User is 000001. If you forgot the password, contact Huawei technical support for a dynamic password that is effective only on the current day. Change the password after login. - After the authentication is successful, the system keeps the authentication information for 30 seconds. If you exit from the Maintenance screen and log in again within 30 seconds, no authentication is required.
 The LCD screen shows the USB Expansion menu. It displays "Maintenance" at the top, followed by "USB Expansion", "Data Clear", "Alarm Reset", and "System Reset".	4. Choose USB Expansion and press . NOTE If no USB flash drive is detected, the LCD displays a message prompting that a flash drive needs to be inserted.

LCD	Procedure
 Maintenance->USB Expansion Firmware Upgrade Config Import Config Export Data Export	5. Select a menu by pressing ▲ and ▼, and press ↵. The menu that can be selected are Firmware Upgrade, Config Import, Config Export, and Data Export. - To upgrade the firmware, perform step 6. - To import configurations, perform step 7. - To export configurations, perform step 8. - To export alarms, performance data, and log data, perform step 9.
 Maintenance->USB Expansion <u>Firmware Upgrade</u> Current :V100R001C00SPC002 Target V :V100R001C00SPC003 ESC:Cancel ↵:Enter	6. Confirm the target version and press ↵. NOTICE - Firmware upgrade is allowed only when the SUN2000 is properly connected to the PV strings (the PV connection indicator is green). - Before upgrading the firmware, download the upgrade package from http://support.huawei.com, decompress the package, and copy the files to the root directory of the USB flash drive.
 Maintenance->USB Expansion <u>Config Import</u> Import the config? ESC:Cancel ↵:Enter	7. Press ↵.
 Maintenance->USB Expansion <u>Config Export</u> 100% ↵:Enter	8. After the configurations are successfully exported, press ↵.

LCD	Procedure
	9. After the data is successfully exported, press  .

----End

7.2.15 Cleaning the User Data

This topic describes how to clean the energy yield data and the historical alarms for the SUN2000. The energy yield data includes the daily energy yield (E-Day), monthly energy yield (E-Month), yearly energy yield (E-Year), historical energy yield (E-History), and total energy yield (E-Total).

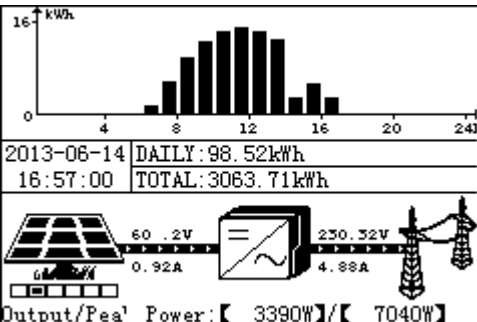
Context


 NOTICE


The operation of clearing user data is performed to delete the energy yield data and historical alarms during the commissioning phase. Data cannot be restored after being deleted. Therefore, exercise caution when deciding to perform this operation.

Procedure

- The following table lists the procedure for cleaning user data. The parameter values in the figures are for reference only.

LCD	Procedure
	1. On the default screen, press  to enter the main menu.

LCD	Procedure
	2. Choose  and press  .
Maintenance->The password. User Name:Advanced User▲▼ Password:000000	3. Enter the correct user name and password by pressing ▲ or ▼, and press  NOTE - The optional user names are Advanced User and Special User. The initial password for Advanced User and Special User is 000001. If you forgot the password, contact Huawei technical support for a dynamic password that is effective only on the current day. Change the password after login. - After the authentication is successful, the system keeps the authentication information for 30 seconds. If you exit from the Maintenance screen and log in again within 30 seconds, no authentication is required.
Maintenance USB Expansion Data Clear Alarm Reset System Reset	4. Choose Data Clear and press  .
Maintenance->Data Clear Clear historical data? ESC:Cancel :Enter	5. On the displayed screen, press  .

LCD	Procedure
	6. Press  to finish the operation.

----End

7.2.16 Resetting Alarms

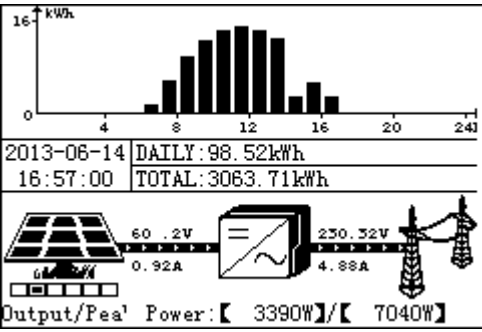
You can reset alarms on the LCD.

Context

If you reset alarms on the LCD, all the active and historical alarms for the inverter are deleted and the SmartLogger starts to collect new alarms.

Procedure

- The following table lists the procedure for resetting alarms. The parameter values in the figures are for reference only.

LCD	Procedure
	1. On the default screen, press  to enter the main menu.
	2. Choose  and press  .

LCD	Procedure
Maintenance->The password. User Name:Advanced User↕ Password:000000	3. Enter the correct user name and password by pressing ▲ or ▼, and press ↵. NOTE - The optional user names are Advanced User and Special User. The initial password for Advanced User and Special User is 000001. If you forgot the password, contact Huawei technical support for a dynamic password that is effective only on the current day. Change the password after login. - After the authentication is successful, the system keeps the authentication information for 30 seconds. If you exit from the Maintenance screen and log in again within 30 seconds, no authentication is required.
Maintenance USB Expansion Data Clear Alarm Reset System Reset	4. Choose Alarm Reset, and press ↵.
Maintenance->Alarm Reset Complete. ↵:Enter	5. After alarms are reset, press ↵.

----End

7.2.17 Resetting the System

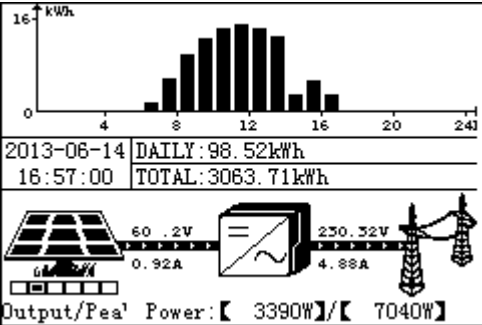
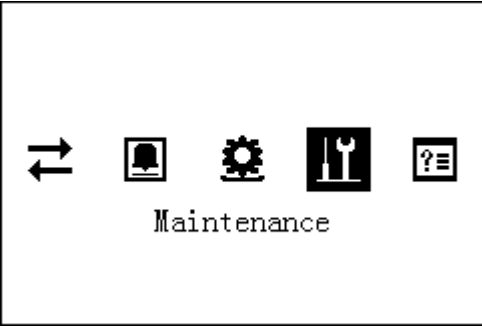

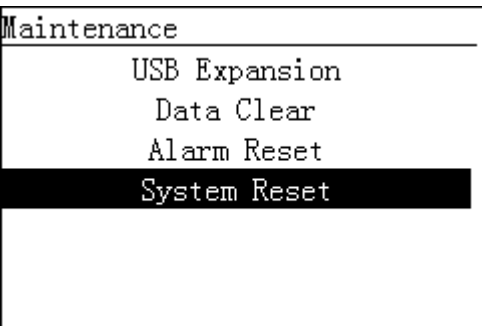
You can reset the system on the LCD.

Context


The inverter automatically shuts down and restarts after a system reset.

Procedure

- The following table lists the procedure for resetting the system. The parameter values in the figures are for reference only.

LCD	Procedure
	1. On the default screen, press  to enter the main menu.
	2. Choose  and press  .
	3. Enter the correct user name and password by pressing  or  , and press  .
	4. Choose System Reset , and press  .

- NOTE
- The optional user names are **Advanced User** and **Special User**. The initial password for **Advanced User** and **Special User** is 000001. If you forgot the password, contact Huawei technical support for a dynamic password that is effective only on the current day. Change the password after login.
 - After the authentication is successful, the system keeps the authentication information for 30 seconds. If you exit from the **Maintenance** screen and log in again within 30 seconds, no authentication is required.

LCD	Procedure
	5. After the system is reset, press ↵.

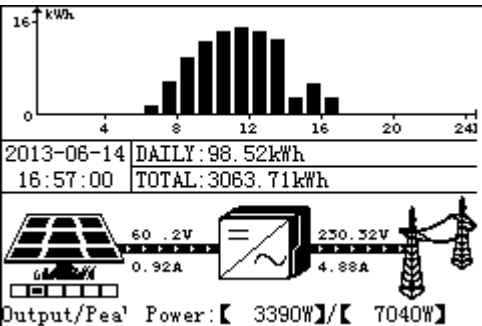
----End

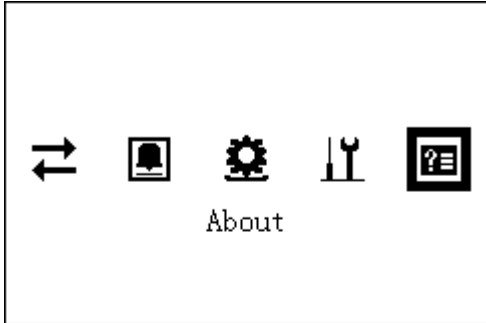
7.2.18 Viewing the System Version

This topic describes how to view the SUN2000 version on the monitoring panel.

Procedure

- The following table lists the procedure for viewing the SUN2000 version information. The parameter values in the figures are for reference only.

LCD	Procedure
	1. On the default screen, press ↵ to enter the main menu.

LCD	Procedure
 About ↓	2. Choose  and press . The version information includes Model, Version, and SN.
About Model:20KTL Version:V100R002 SN:210707164910D2000009	

----End

8 Maintenance

This chapter describes routine maintenance and troubleshooting practices that ensure optimal performance of the SUN2000.

8.1 Powering Off the SUN2000

Comply with the safety precautions and operation procedures specified in this section when powering off the SUN2000 for maintenance or replacement.

Context



WARNING

After the SUN2000 has shut down, residual electricity and heat may still cause electrical shock and body burns. Therefore, only begin servicing the SUN2000 five minutes later after shutting down.

Procedure

- To maintain the SUN2000, perform [a](#) to [c](#). To replace the SUN2000, perform [a](#) to [g](#).
 - a. Enter the shutdown command on the LCD.
For details, see [7.2.12 Manually Starting and Shutting down the SUN2000](#).
A shutdown command can also be run from the element management system (EMS).
For details, see the *NetEco 1000S V100R002C00 User Manual*.
 - b. Switch off the circuit breaker between the SUN2000 and the power grid.
 - c. Set the DC SWITCH to OFF.
 - d. Disconnect the RS485 communications cables.
 - e. Disconnect the DC input power cables.
For details, see **Follow-up Procedure** in [5.3 Connecting DC Input Power Cables](#).
 - f. Disconnect the AC output power cables.
For details, see **Follow-up Procedure** in [5.2 Connecting AC Output Power Cables](#).

- g. Disconnect the PGND cables.

For details, see **Follow-up Procedure** in [5.1 Connecting PGND Cables](#).

----End

8.2 Routine Maintenance

To ensure that the SUN2000 can operate properly for a long term, you are advised to perform routine maintenance on it as described in this chapter.



CAUTION

- Before cleaning the system, and maintaining the cable connections and grounding reliability, power off the system (see [8.1 Powering Off the SUN2000](#)) and ensure that the DC SWITCH on the inverter is OFF.
- Before wiping the heat sink clean, switch off the circuit breaker between the SUN2000 and the power grid, set the DC SWITCH to OFF, and wait at least 5 minutes after the SUN2000 is powered off.

Table 8-1 Maintenance list

Check Item	Check Method	Maintenance Interval
System cleaning	Check periodically that the heat sinks are free from obstacles or dust.	Semiannually to annually.
System running status	• Check that the SUN2000 is not damaged or deformed. • Check for normal sound emitted during operation of the SUN2000. • Check that all SUN2000 parameter settings are correctly set during operation.	Semiannually.
Electrical Connections	• Check that cables are securely connected. • Check that cables are intact and the parts in contact with a metallic surface are not scratched. • Check that the idle RS485 and USB ports are covered by waterproof caps.	Half a year after the initial commissioning, and semiannually to annually afterwards.
Grounding reliability	Check that PGND cables are securely connected.	Half a year after the initial commissioning, and semiannually to annually afterwards.

8.3 Troubleshooting

This section describes troubleshooting measures for common fault alarms in the SUN2000.

Alarms range in severity according to the following definitions:

- **Major:** The fault causes the SUN2000 to enter the shutdown mode and stop feeding electricity to the power grid.
- **Minor:** Some components are faulty but the SUN2000 can still feed electricity to the power grid.
- **Warning:** The SUN2000 output power decreases due to external factors.

Table 8-2 describes the common fault alarms of the SUN2000 and troubleshooting measures.

Table 8-2 Troubleshooting

Alarm ID	Name	Severity	Causes	Measures
103	DC Over Voltage	Major	• Cause ID = 1 The PV array is not properly configured. Excessive PV modules are connected in series to PV strings 1 and 2, and therefore the PV string open-circuit voltage exceeds the maximum value of the inverter MPPT voltage. • Cause ID = 2 The PV array is not properly configured. Excessive PV modules are connected in series to PV strings 3 and 4, and therefore the PV string open-circuit voltage exceeds the maximum value of the inverter MPPT voltage. • Cause ID = 3 The PV array is not properly configured. Excessive PV modules are connected in series to PV strings 5 and 6, and therefore the PV string open-circuit voltage exceeds the maximum value of the inverter MPPT voltage.	• Cause ID = 1 Reduce the number of PV modules connected in series to PV strings 1 and 2 until the open-circuit voltage is less than or equal to the maximum inverter input voltage. After the PV array configuration is corrected, the SUN2000 alarm disappears. • Cause ID = 2 Reduce the number of PV modules connected in series to PV strings 3 and 4 until the open-circuit voltage is less than or equal to the maximum inverter input voltage. After the PV array configuration is corrected, the SUN2000 alarm disappears. • Cause ID = 3 Reduce the number of PV modules connected in series to PV strings 5 and 6 until the open-circuit voltage is less than or equal to the maximum inverter input voltage. After the PV array configuration is corrected, the SUN2000 alarm disappears.

Alarm ID	Name	Severity	Causes	Measures
106 to 111	String 1-6 Abnormal	Warning	Cause ID = 1 - PV strings have been shielded for a long time. - PV strings have deteriorated.	1. Check whether the output current of a PV string is obviously less than the output current of other PV strings. 2. If so, check whether the PV string is shielded. 3. If the PV string is clean of contaminants and not shielded, check whether the PV modules are faulty.
120 to 125	String 1-6 Reverse	Cause ID = 1: Major Cause ID = 2: Warning	- Cause ID = 1 The PV string is reversely connected. - Cause ID = 2 Only a few PV modules are connected in series to the PV string, and therefore the end voltage is lower than that of other PV strings.	- Cause ID = 1 Check whether the PV string is reversely connected to the SUN2000. If so, set DC SWITCH to OFF after the solar irradiance declines at night and the PV string voltage drops to the safe voltage range (lower than 60 V DC), and then correct the PV string connection. - Cause ID = 2 Check whether the number of PV modules connected in series to the SUN2000 is small. If yes, increase the number.

Alarm ID	Name	Severity	Causes	Measures
200	Abnormal DC Circuit	Major	Abnormal external conditions trigger the protection for the DC circuit inside the SUN2000. The possible causes are as follows: - Reason ID = 3 The SUN2000 input is suddenly disconnected, or the shielded PV strings result in a sharp change in output power. - Reason ID = 10 The internal control circuit of the SUN2000 is unable to keep up with changes due to grid phase imbalances. - Cause ID = 11 The input energy of the SUN2000 cannot be vented quickly due to the sharp change of grid voltage. As a result, the internal voltage increases. - Cause ID = 12/15 An unrecoverable fault occurs on a circuit inside the SUN2000. - Cause ID = 16 The voltage between the PV string and the ground is abnormal, and there is a risk of power attenuation.	Cause ID = 3/10/11 - The SUN2000 monitors its external working conditions in real time and automatically reverts to normal operating status after the fault is rectified. - If the alarm occurs repeatedly, contact Huawei technical support. Cause ID = 12/15 Turn off the AC output switch and DC input switch. Then turn on the AC output switch and DC input switch after 5 minutes. If the fault persists, contact Huawei technical support. Cause ID = 16 - If there is no PID module in the system, set PID protection at night and Reactive power output at night of the SUN2000 to Disable on the SmartLogger or SUN2000 app. - If there is a PID module in the system, check whether the device is faulty. If so, rectify the fault. - Check whether Crystalline silicon PV compensation mode of the SUN2000 and PV module compensation voltage direction of the PID module are correctly set based on the PV module model. If not, reset them on the SmartLogger or SUN2000 app. - If the alarm occurs repeatedly, contact your supplier or Huawei technical support.

Alarm ID	Name	Severity	Causes	Measures
202	Abnormal Invert Circuit	Major	Abnormal external conditions trigger the protection for the inverter circuit inside the SUN2000. The possible causes are as follows: - Reason ID = 13 A sharp drop in grid voltage or a short-circuit has occurred, resulting in a fault in the voltage check circuit of the SUN2000. - Reason ID = 14 A sharp drop in grid voltage or a short-circuit has occurred, resulting in instantaneous high output current from the SUN2000. - Reason ID = 16 The grid DC current exceeds the allowed range. - Reason ID = 20 The SUN2000 output short-circuits, leading to a sharp increase in output current.	Cause ID = 13/14/16 - The SUN2000 monitors its external working conditions in real time and automatically reverts to normal operating status after the fault is rectified. - If the alarm occurs repeatedly, contact Huawei technical support. Reason ID = 20 - Check whether the SUN2000 output cables are short-circuited. Rectify any fault. - If the alarm occurs repeatedly, contact Huawei technical support.
301	Abnormal Grid Voltage	Major	The grid voltage is beyond the acceptable range. The possible causes are as follows: - Cause ID = 4 The grid voltage is below the specified lower threshold. - Cause ID = 16 The grid voltage is higher than the allowed range. - Cause ID = 19 The grid voltage has exceeded the specified upper threshold for 10 minutes. - Reason ID = 26 The grid voltage is higher than the allowed range. - Cause ID = 28 There is large difference in grid voltage among the	Cause ID = 4 - If the alarm occurs accidentally, it is possible that there is an accidental grid abnormality. The SUN2000 automatically reverts to normal operating status after the fault is rectified. - If the alarm occurs repeatedly, check whether the grid voltage is within the allowed range. If not, contact the local power operator. If so, refer to 7.2.9 Setting Protection Parameters or change the grid overvoltage and undervoltage protection thresholds on the SmartLogger, SUN2000 app, or NMS after obtaining approval from the local power operator. - If the alarm persists for a long time, check that the AC circuit breaker and output cables of the SUN2000 are properly connected.

Alarm ID	Name	Severity	Causes	Measures
			three phases. • Cause ID = 29 1. The power grid experiences an outage. 2. The AC circuit is disconnected or AC switch is OFF. • Cause ID = 31/32/33 The impedance of the output phase wire A (cause ID = 31)/B (cause ID = 32)/C (cause ID = 33) to the PE cable is low or short-circuited.	Cause ID = 16/19/26 1. Check whether the grid-tied point voltage is too high. If it is, contact your local power operator. 2. If the grid-tied point voltage is higher than the allowed range, change the overvoltage and undervoltage protection points after obtaining approval from the local power operator. 3. Check whether the grid voltage peak is too high. Cause ID = 28 1. The SUN2000 monitors its external working conditions in real time and automatically reverts to normal operating status after the fault is rectified. 2. If the alarm persists and affects the energy yield of the power station, contact the local power operator. Cause ID = 29 1. Check whether the AC voltage is normal. 2. Check that the AC power cable is securely connected and that the AC switch is ON. Cause ID = 31/32/33 Check the impedance of output phase wire A (cause ID = 31)/B (cause ID = 32)/C (cause ID = 33) to the PE cable and locate the position with lower impedance and resolve the issue.

Alarm ID	Name	Severity	Causes	Measures
305	Abnormal Grid Frequency	Major	• Cause ID = 2 The actual grid frequency is higher than the standard requirement for the local power grid. • Cause ID = 4 The actual grid frequency is lower than the standard requirement for the local power grid. • Cause ID = 5 The actual change rate of the grid frequency does not meet the standard requirement for the local power grid.	Cause ID = 2/4 1. If the alarm occurs accidentally, it is possible that there is an accidental grid abnormality. The SUN2000 automatically reverts to normal operating status after the fault is rectified. 2. If the alarm occurs repeatedly, check whether the grid frequency is within the allowed range. If not, contact the local power operator. If so, refer to 7.2.9 Setting Protection Parameters or change the grid overfrequency and underfrequency protection thresholds on the SmartLogger, SUN2000 app, or NMS after obtaining approval from the local power operator. Cause ID = 5 1. If the alarm occurs accidentally, it is possible that there is an accidental grid abnormality. The SUN2000 automatically reverts to normal operating status after the fault is rectified. 2. If the alarm occurs frequently, check whether the grid frequency is within the acceptable range. If no, contact the local power operator.
313	Low Insulation Resistance	Major	Cause ID = 1 • There is a short circuit between PV strings and the ground. • The PV strings are installed in a permanently moist environment.	1. Check the insulation resistance against the ground of the PV strings. If there is a short circuit, rectify the fault. 2. If the insulation resistance against the ground is lower than the default value in a rainy environment, refer to 7.2.9 Setting Protection Parameters or set Insulation resistance protection on the SUN2000 app, SmartLogger, or NMS.

Alarm ID	Name	Severity	Causes	Measures
318	Abnormal Residual Current	Major	Cause ID = 1 The insulation resistance against ground of the input side of the SUN2000 decreases during operation, which causes excessively high residual current.	1. If the alarm occurs accidentally, it is possible that there is an accidental external circuit abnormality. The SUN2000 automatically reverts to normal operating status after the fault is rectified. 2. If the alarm occurs repeatedly or lasts a long time, check whether the insulation resistance against ground of PV strings is too low.
321	Cabinet Overtemperature	Major	Cause ID = 1 • The SUN2000 is installed in a place with poor ventilation. • The ambient temperature is too high. • The internal fan is not working.	1. Check the ventilation and ambient temperature of the SUN2000 installation position. 2. If the ventilation is poor or the ambient temperature exceeds the upper threshold, improve the ventilation and heat dissipation. 3. If the ventilation and ambient temperature both meet requirements, contact Huawei technical support.
326	Abnormal Grounding	Major	Cause ID = 1 • The neutral wire or PGND cable is not connected to the SUN2000. • The isolation transformer is not connected to the SUN2000 at the output side when the PV strings are grounded.	1. Check that the neutral wire and PGND cable are properly connected. 2. If the PV string output is grounded, check that the SUN2000 output side connects to an isolation transformer.
400	System Fault	Major	Cause ID = 1/3/21/23/27 An unrecoverable fault has occurred on a circuit inside the SUN2000.	Turn off the AC output switch and DC input switch. Then turn on the AC output switch and DC input switch after 5 minutes. If the fault persists, contact Huawei technical support.
410	Abnormal Auxiliary Power	Major	Cause ID = 4 The sampling control board has an abnormal voltage, which may be caused by the following: • The internal power chip of the sampling control board is faulty. • The detection circuit becomes faulty.	1. When the alarm is generated, the SUN2000 shuts down automatically. When the fault is rectified, the SUN2000 starts automatically. 2. If the alarm occurs repeatedly, contact Huawei technical support.

Alarm ID	Name	Severity	Causes	Measures
504	Version Mismatch	Minor	Cause ID = 1/2/3 The version of the software loaded during a software upgrade is incorrect.	Check whether a recent software upgrade has been performed. If so, upgrade the software again to the correct version.
505	Firmware Upgrade Failed	Major	Cause ID = 1 The upgrade is incomplete.	Upgrade again.
61440	Flash Fault	Minor	Cause ID = 1 - There is insufficient space on the flash drive. - The flash drive has bad blocks or is faulty.	- Replace the monitoring board. - If the monitoring board is built into the monitoring device, replace the monitoring device.



NOTE

If a fault cannot be rectified by the measures listed in [Table 8-2](#), contact Huawei technical support.

9 SUN2000 Handling

This chapter describes how to remove, pack, and dispose of the SUN2000.

9.1 SUN2000 Removal

This section describes how to remove the SUN2000.

Perform the following operations to remove the SUN2000:

1. Disconnect all cables from the SUN2000, including RS485 communications cables, DC input power cables, AC output power cables, and PGND cables.
For details, see [8.1 Powering Off the SUN2000](#).
2. (Optional) Open the anti-theft lock at the bottom of the SUN2000.
3. Unmount the SUN2000 from the rear panel.
4. Unfasten the rear panel.

9.2 SUN2000 Packing

This section describes how to pack the SUN2000.

- If the original packing case is available, place the SUN2000 inside the packing case and seal it with adhesive tape.
- If the original packing case is unavailable, place the SUN2000 inside a suitable hard carton and seal it properly.

9.3 Disposing the SUN2000

This topic describes how to dispose the SUN2000.

If the SUN2000 service life has expired, dispose of the SUN2000 in accordance with local rules for disposal of electrical equipment waste.

10 Technical Specifications

Efficiency

Technical Specifications	SUN2000-8KTL	SUN2000-10KTL	SUN2000-12KTL	SUN2000-15KTL	SUN2000-17KTL	SUN2000-20KTL	SUN2000-23KTL	SUN2000-28KTL
Maximum efficiency	98.5%			98.6%			98.7%	
European efficiency	98.0%			98.3%			98.4%	

Input

Technical Specifications	SUN2000-8KTL	SUN2000-10KTL	SUN2000-12KTL	SUN2000-15KTL	SUN2000-17KTL	SUN2000-20KTL	SUN2000-23KTL	SUN2000-28KTL
Maximum input power	9000 W	11,400 W	13,500 W	17,000 W	19,100 W	22,500 W	23,600 W	28,200 W
Maximum input voltage	1000 V							
Maximum input current (per MPPT)	18 A							
Maximum short-circuit current (per MPPT)	25 A							
Maximum operating voltage	950 V							
Minimum operating/startup voltage	200 V/250 V							
Max. inverter backfeed current to PV	0 A							

Technical Specifications	SUN2000-8KTL	SUN2000-10KTL	SUN2000-12KTL	SUN2000-15KTL	SUN2000-17KTL	SUN2000-20KTL	SUN2000-23KTL	SUN2000-28KTL
array								
Full power MPPT voltage range	320–800 V		380–800 V	400–800 V		480–800 V		520–800 V
Maximum number of inputs	4			6				
Number of MPP trackers	2 ^a			3 ^b				

a: Two MPPT routes can work independently or work in parallel.

b: Three MPPT routes can work independently or work in parallel, or any two of the three MPPT routes can work in parallel.

Output

Technical Specifications	SUN2000-8KTL	SUN2000-10KTL	SUN2000-12KTL	SUN2000-15KTL	SUN2000-17KTL	SUN2000-20KTL	SUN2000-23KTL	SUN2000-28KTL
Rated active power	8000 W	10,000 W	12,000 W	15,000 W	17,000 W	20,000 W	23,000 W	27,500 W
Maximum apparent power	8800 VA	11,000 VA	13,200 VA	16,500 VA	18,700 VA	22,000 VA	23,000 VA	27,500 VA
Maximum active power (cosφ = 1)	8800 W	11,000 W	13,200 W	16,500 W	18,700 W	22,000 W	23,000 W	27,500 W
Rated output voltage	220 V-230 V/380 V-400 V, 3W + N + PE							277 V/480 V, 3W+PE
Adapted grid frequency	50 Hz/60 Hz							
Maximum output current	13.4 A	17 A	20 A	25.2 A	28.5 A	33.5 A		
Power factor	0.8 leading ... 0.8 lagging							
Maximum total harmonic distortion (rated power)	< 3%							

Protection

Technical Specifications	SUN2000-8KTL	SUN2000-10KTL	SUN2000-12KTL	SUN2000-15KTL	SUN2000-17KTL	SUN2000-20KTL	SUN2000-23KTL	SUN2000-28KTL
Input DC switch	Yes							
Anti-islanding protection	Yes							
Output overcurrent protection	Yes							
Input reverse polarity protection	Yes							
PV string fault detection	Yes							
DC surge protection	Type II							
AC surge protection	Type II							
Insulation resistance detection	Yes							
Residual	Yes							

Technical Specifications	SUN2000-8KTL	SUN2000-10KTL	SUN2000-12KTL	SUN2000-15KTL	SUN2000-17KTL	SUN2000-20KTL	SUN2000-23KTL	SUN2000-28KTL
current monitoring unit (RCMU)								

Display and Communication

Technical Specifications	SUN2000-8KTL	SUN2000-10KTL	SUN2000-12KTL	SUN2000-15KTL	SUN2000-17KTL	SUN2000-20KTL	SUN2000-23KTL	SUN2000-28KTL
Display	Graphical LCD, LED, Bluetooth module+app, USB data cable+app							
RS485	Yes							

General Data

Technical Specifications	SUN2000-8KTL	SUN2000-10KTL	SUN2000-12KTL	SUN2000-15KTL	SUN2000-17KTL	SUN2000-20KTL	SUN2000-23KTL	SUN2000-28KTL
Dimensions (W x H x D)	520 mm x 610 mm x 266 mm (including the mounting plate)							
Weight	About 41 kg (excluding the mounting plate)/About 42 kg (including the mounting plate)			About 49 kg (excluding the mounting plate)/About 50 kg (including the mounting plate)				
Operating temperature range	-25°C to +60°C							
Cooling	Natural convection							
Maximum operating altitude	3000 m							
Humidity	0%–100% RH							
Input terminal	Amphenol Helios H4							
Output terminal	Amphenol C16/3							
Ingress Protection Rating	IP65							
Protective class	Class I							
Degree of pollution	III							

Technical Specifications	SUN2000-8KTL	SUN2000-10KTL	SUN2000-12KTL	SUN2000-15KTL	SUN2000-17KTL	SUN2000-20KTL	SUN2000-23KTL	SUN2000-28KTL
Topology	Transformerless							

A Acronyms and Abbreviations

A

ACDU	AC Distribution Unit
-------------	----------------------

E

EMC	Electromagnetic Compatibility
------------	-------------------------------

EMI	Electromagnetic Interference
------------	------------------------------

EMS	Element Management System
------------	---------------------------

ESD	Electrostatic Discharge
------------	-------------------------

L

LCD	Liquid Crystal Display
------------	------------------------

LED	Light Emitting Diode
------------	----------------------

M

MPP	Maximum Power Point
------------	---------------------

MPPT	Maximum Power Point Tracking
-------------	------------------------------

P

PE	Protective Earthing
-----------	---------------------

PGND	Protection Ground
-------------	-------------------

PV	Photovoltaic
-----------	--------------

R

RCMU	Residual current monitoring unit
-------------	----------------------------------

S

SPD

Surge Protective Device

B

Power Grid Codes

Set the power grid code that applies to the country or region where the power station is located and the SUN2000 model.

Low-voltage power grid codes apply to SUN2000 models including the SUN2000-8KTL, 10KTL, 12KTL, 15KTL, 17KTL, 20KTL, and 23KTL. [Table B-1](#) describes the countries to which low-voltage power grid codes apply.

Table B-1 Low-voltage power grid codes

No.	Power Grid Code	Country
1	NB/T 32004	China Golden Sun low-voltage power grid
2	UTE C 15-712-1(A)	France low-voltage power grid
3	UTE C 15-712-1(B)	Islands of France 230 V 50 Hz
4	UTE C 15-712-1(C)	Islands of France 230 V 60 Hz
5	VDE 0126-1-1-BU	Bulgaria low-voltage power grid
6	VDE 0126-1-1-GR(A)	Mainland of Greece low-voltage power grid
7	VDE 0126-1-1-GR(B)	Islands of Greece low-voltage power grid
8	BDEW-MV	Germany medium-voltage power grid (400 V AC)
9	VDE-AR-N-4105	Germany low-voltage power grid
10	G59-England	England 230 V power grid (I > 16 A)
11	G59-Scotland	Scotland 240 V power grid (I > 16 A)
12	G83-England	England 230 V power grid (I < 16 A)
13	G83-Scotland	Scotland 240 V power grid (I < 16 A)
14	EN50438-CZ	Czech Republic low-voltage power grid
15	RD1699	Spanish low-voltage power grid (Pn < 100 kW)
16	RD661	Spanish low-voltage power grid (Pn > 100 kW)

No.	Power Grid Code	Country
		kW)
17	EN50438-NL	Netherlands low-voltage power grid
18	C10/11	Belgium low-voltage power grid
19	AS4777	Australia low-voltage power grid
20	CEI0-16	Italian medium-voltage power grid
21	CEI0-21	Italian low-voltage power grid
22	ANRE	Romania low-voltage power grid
23	TAI-PEA	Thailand low-voltage power grid (PEA)
24	TAI-MEA	Thailand low-voltage power grid (MEA)
25	EN50438-TR	Turkey low-voltage power grid
26	Philippines	Philippines low-voltage power grid
27	NRS-097-2-1	South Africa low-voltage power grid
28	KOREA	South Korea low-voltage power grid
29	IEC61727	IEC low-voltage power grid (50 Hz)
30	IEC61727-60Hz	IEC low-voltage power grid (60 Hz)
31	Custom (50Hz)	Reserved
32	Custom (60Hz)	Reserved

Medium-voltage power grid codes apply to SUN2000 models including the SUN2000-28KTL. [Table B-2](#) describes the countries to which medium-voltage power grid codes apply.

Table B-2 Medium-voltage power grid codes

No.	Power Grid Code	Country
1	CHINA-MV480	China medium-voltage power grid
2	BDEW-MV480	Germany medium-voltage power grid
3	G59-England-MV480	UK 480 V Medium-voltage power grid (I > 16 A)
4	UTE C 15-712-1-MV480	France medium-voltage power grid
5	TAI-PEA-MV480	Thailand medium-voltage power grid (PEA)
6	TAI-MEA-MV480	Thailand medium-voltage power grid (MEA)

No.	Power Grid Code	Country
7	EN50438-DK-MV480	Denmark medium-voltage power grid
8	Japan (50Hz)	Japan power grid (50 Hz)
9	Japan (60Hz)	Japan power grid (60 Hz)
10	EN50438-TR-MV480	Turkey medium-voltage power grid
11	C11/C10-MV480	Belgium medium-voltage power grid
12	Philippines-MV480	Philippines medium-voltage power grid
13	AS4777-MV480	Australia medium-voltage power grid
14	NRS-097-2-1-MV480	South Africa medium-voltage power grid
15	IEC61727-MV480	IEC medium-voltage power grid (50 Hz)
16	IEC61727-MV480-60Hz	IEC medium-voltage power grid (60 Hz)
17	ANRE-MV480	Romania medium-voltage power grid
18	Custom-MV480 (50Hz)	Reserved
19	Custom-MV480 (60Hz)	Reserved