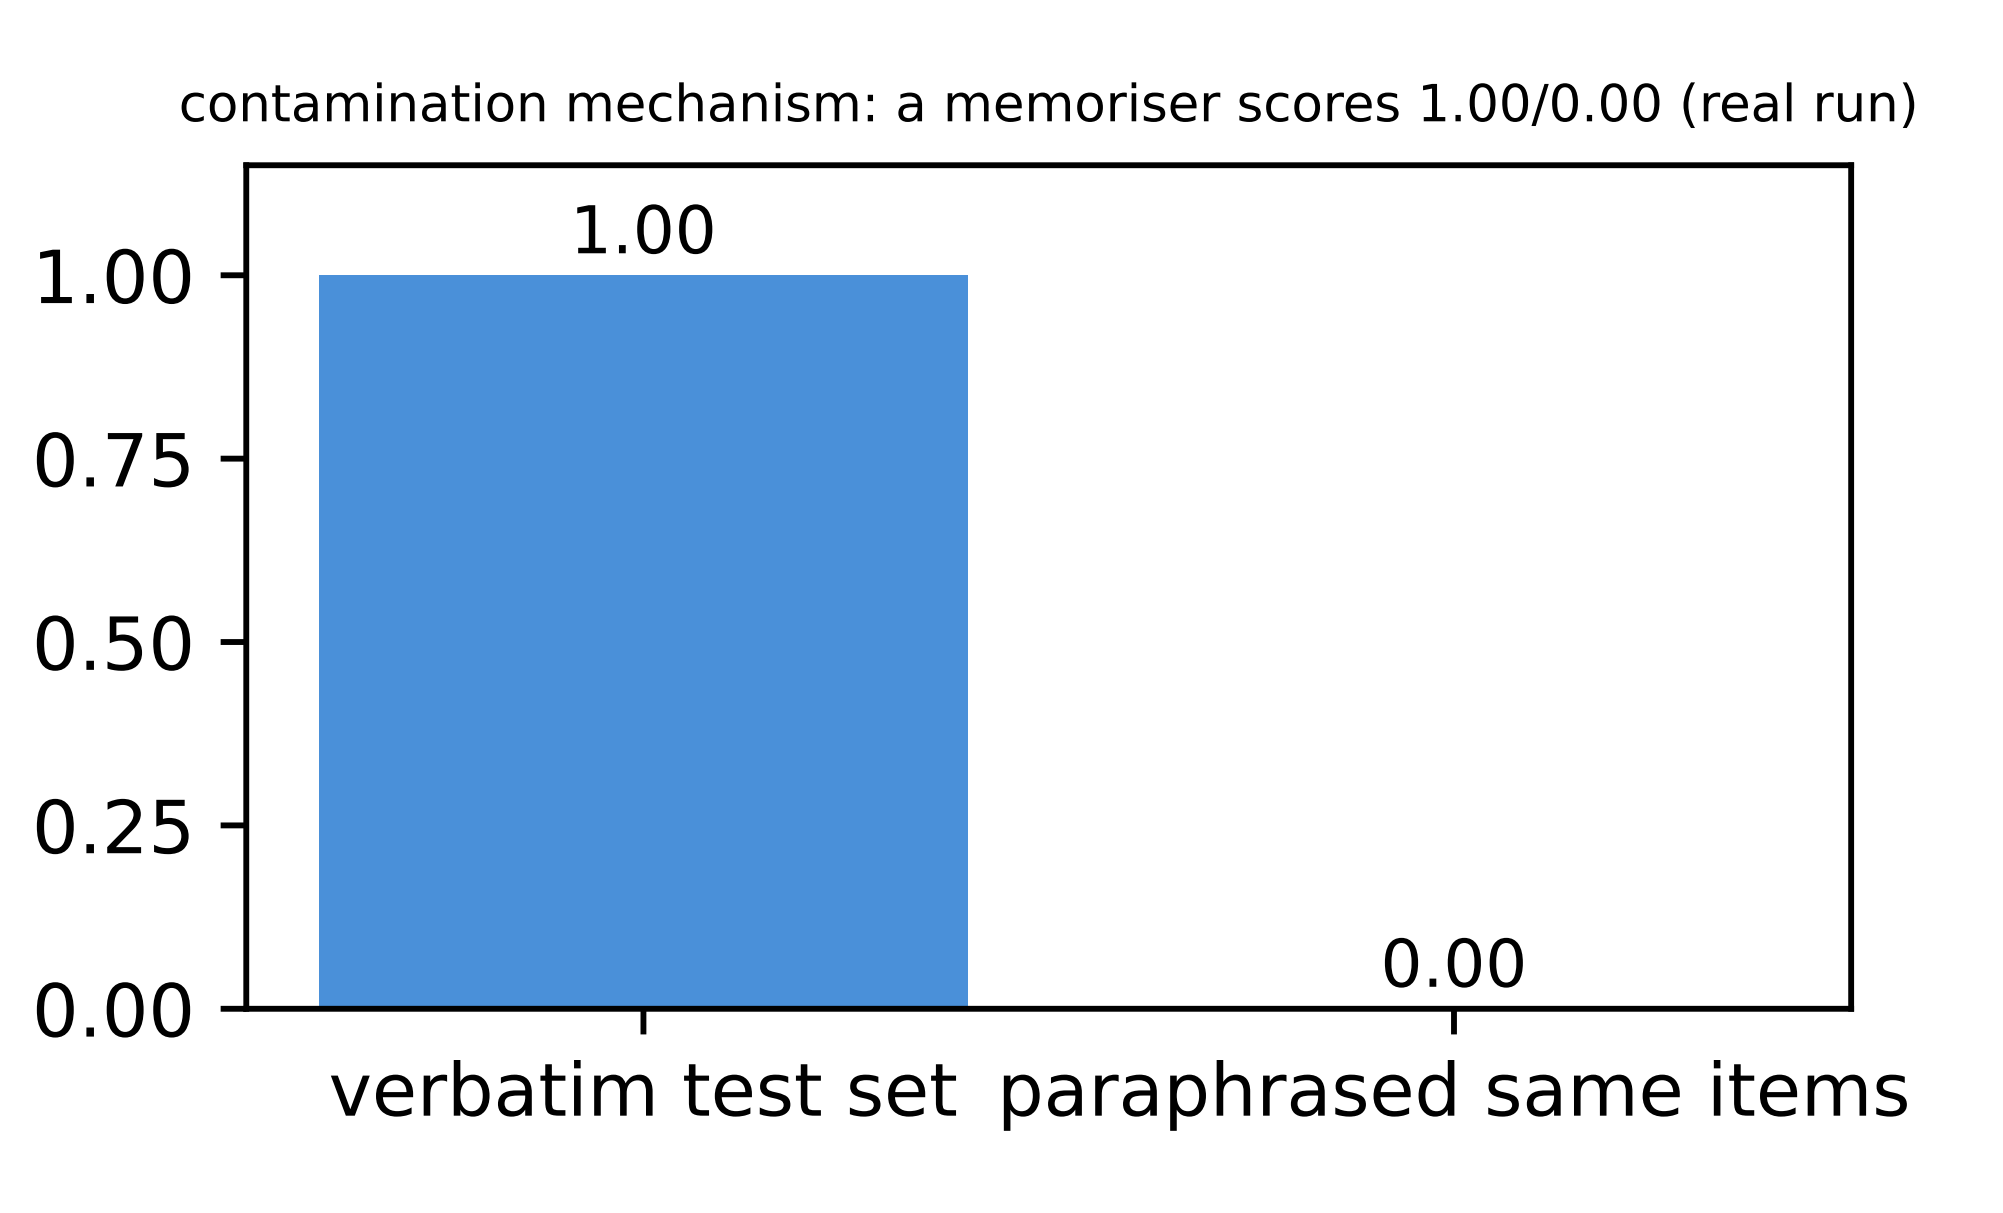
contamination mechanism: a memoriser scores 1.00/0.00 (real run)
1.00
0.00
1.00
0.75
0.50
0.25
0.00
verbatim test set
paraphrased same items