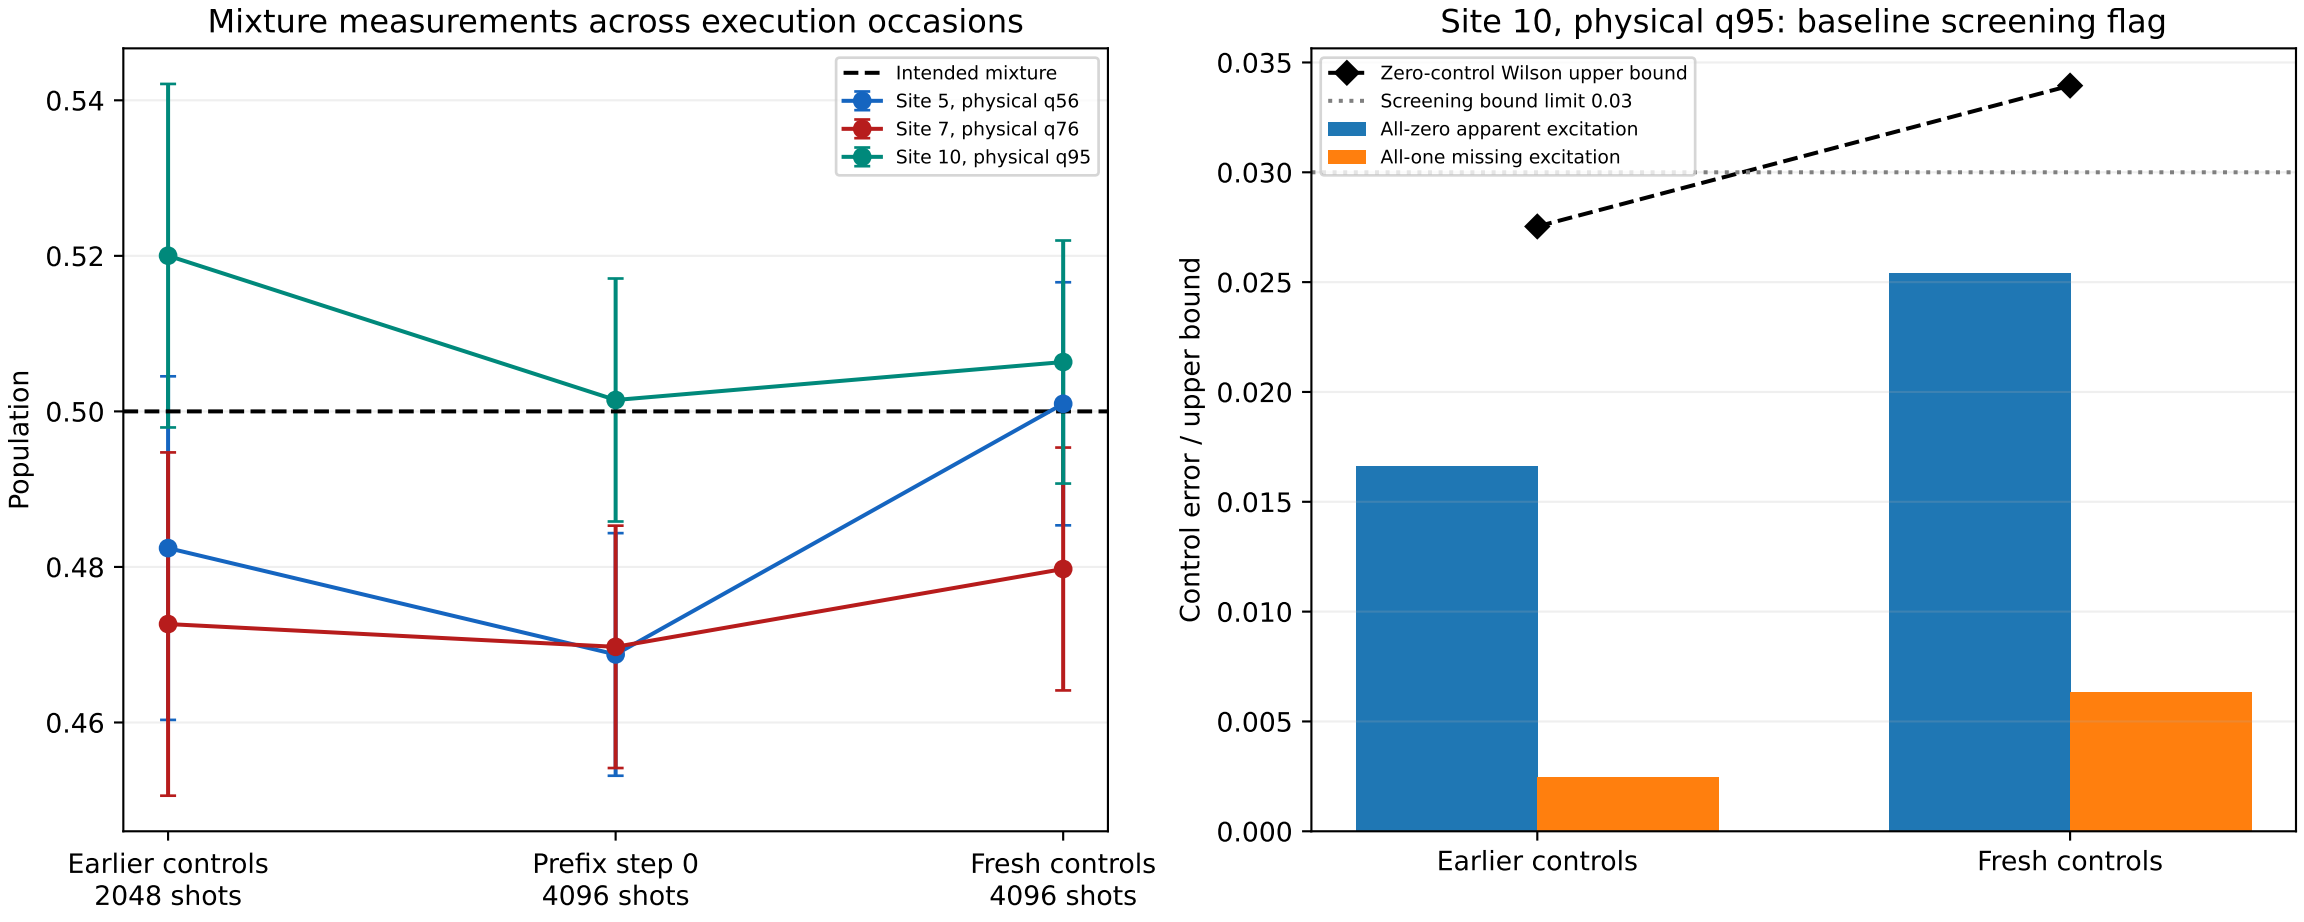
Mixture measurements across execution occasions
Intended mixture
Site 5, physical q56
Site 7, physical q76
Site 10, physical q95
Population
0.54
0.52
0.50
0.48
0.46
Earlier controls
2048 shots
Prefix step 0
4096 shots
Fresh controls
4096 shots
Site 10, physical q95: baseline screening flag
Zero-control Wilson upper bound
Screening bound limit 0.03
All-zero apparent excitation
All-one missing excitation
Control error / upper bound
0.035
0.030
0.025
0.020
0.015
0.010
0.005
0.000
Earlier controls
Fresh controls