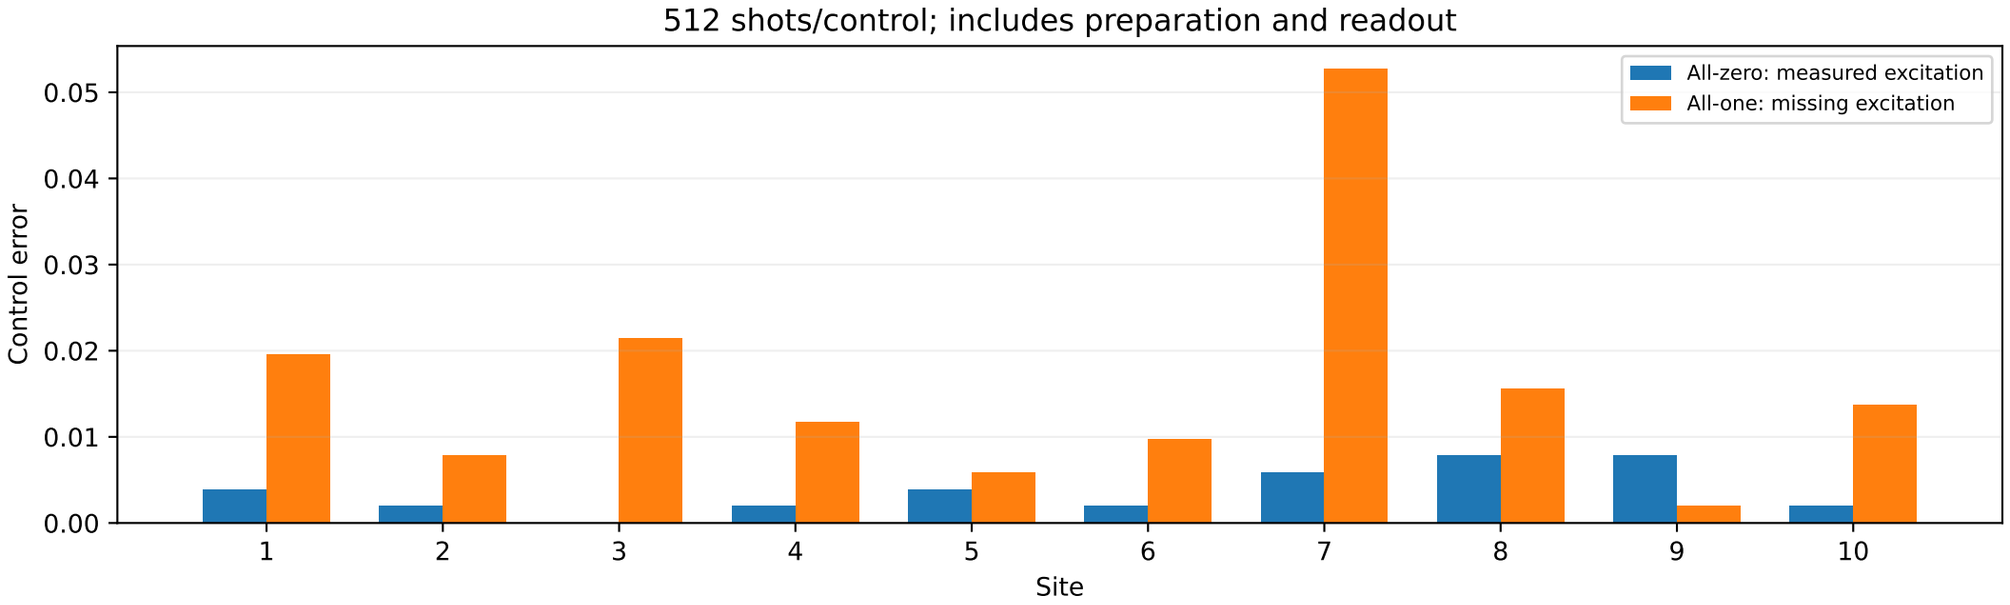
512 shots/control; includes preparation and readout
All-zero: measured excitation
All-one: missing excitation
Control error
0.00
0.01
0.02
0.03
0.04
0.05
1
2
3
4
5
6
7
8
9
10
Site

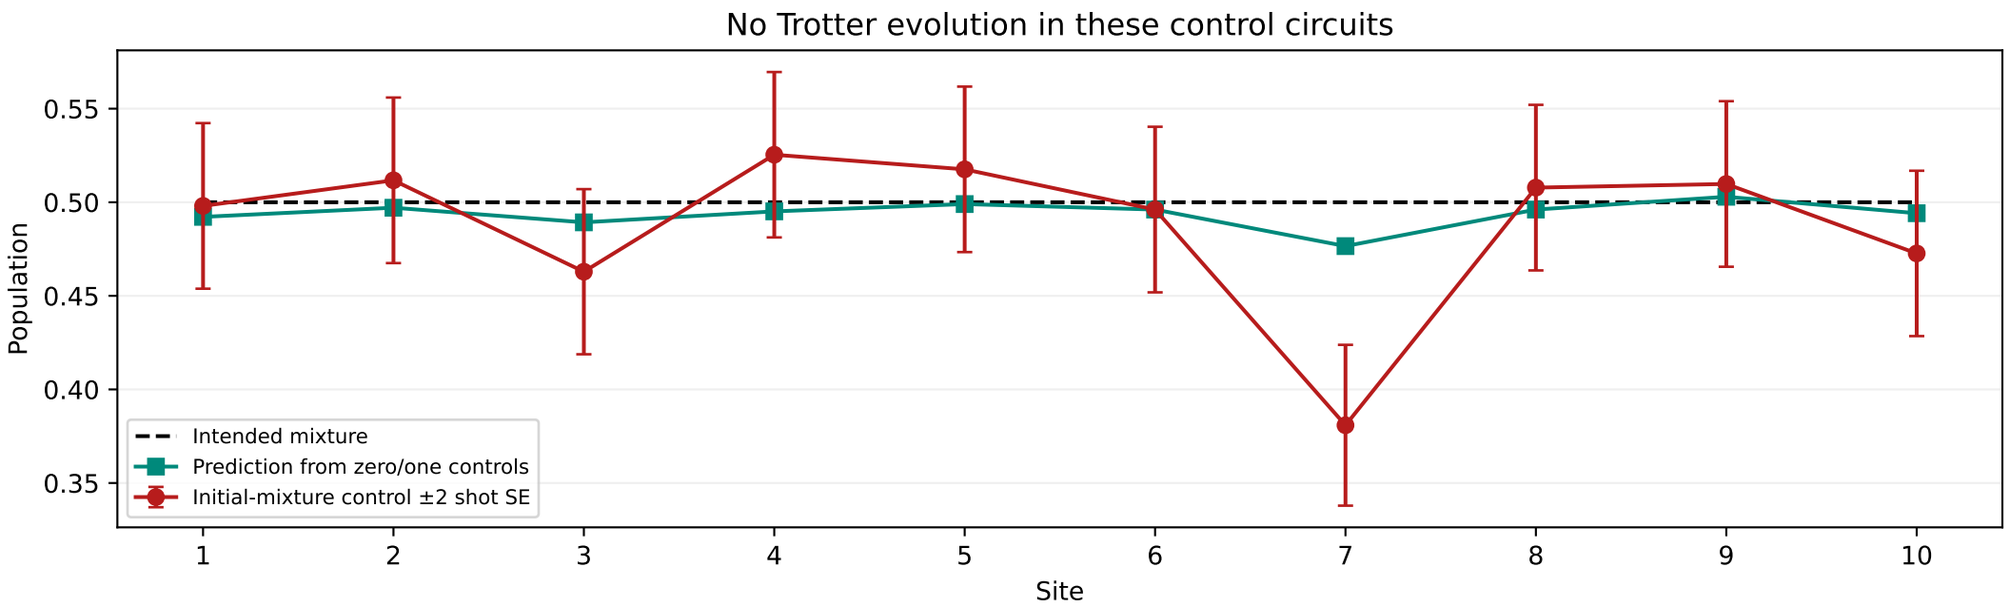
No Trotter evolution in these control circuits
Population
0.35
0.40
0.45
0.50
0.55
Intended mixture
Prediction from zero/one controls
Initial-mixture control ±2 shot SE
1
2
3
4
5
6
7
8
9
10
Site

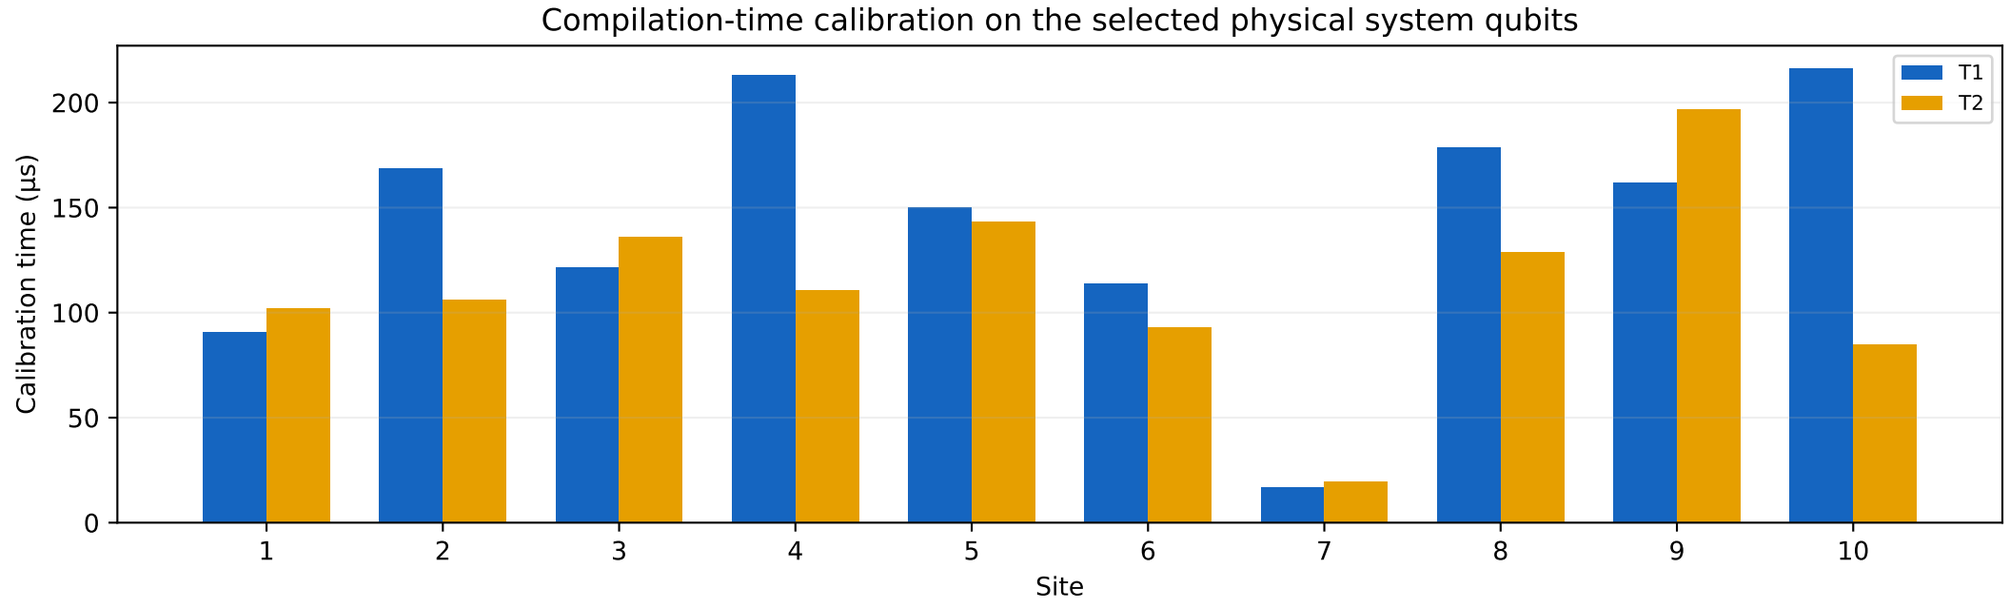
Compilation-time calibration on the selected physical system qubits
T1
T2
Calibration time (µs)
0
50
100
150
200
1
2
3
4
5
6
7
8
9
10
Site