Optimal Charge Scheduling For Energy Arbitrage On the Day-Ahead Market Under Operational Constraints

Alban Puech





Introduction

Context

Increased dependence on variable energy sources

- According to IEA, solar + wind = 70 percent of electricity production by 2050 in Europe [IEA]
- Need for solutions to increase grid reliability and flexibility
- Battery storage systems (BSS) can help in handling sudden and large changes in the power supply or demand

Peak Shaving via Energy arbitrage

- Peak shaving = eliminate short-term demand spikes, smooth out peak loads
- Can be done via Energy Arbitrage using BSS [2]
- Buy and store when electricity prices are low (low demand), discharge and sell when prices are high (high demand)

Benefits of Peak Shaving

- Profitability of energy arbitrage depends on the intraday volatility of electricity prices
- Represents an additional revenue stream for asset owners
- Increases ROI of batteries
- Increases the return to renewable production and reduces CO2 emissions [3]

Day-Ahead Market specificities


- Hourly prices for the next day are determined through an auction process that closes before midday
- Buying and selling orders are binding and need to be placed before market closure
- Prices are unknown before market closure
- Need to plan in advance the buying and selling orders = need for a charging schedule
- Unknown prices

Problem

For everyday d, we generate S_d , the schedule for the day d before market closure on day d-1. We denote by $\Delta E_d(h)$ the change in energy stored in the battery at hour h on day d.

$$S_d = (\Delta E_d(0), \Delta E_d(1), \dots, \Delta E_d(23))$$

Sample charge schedule

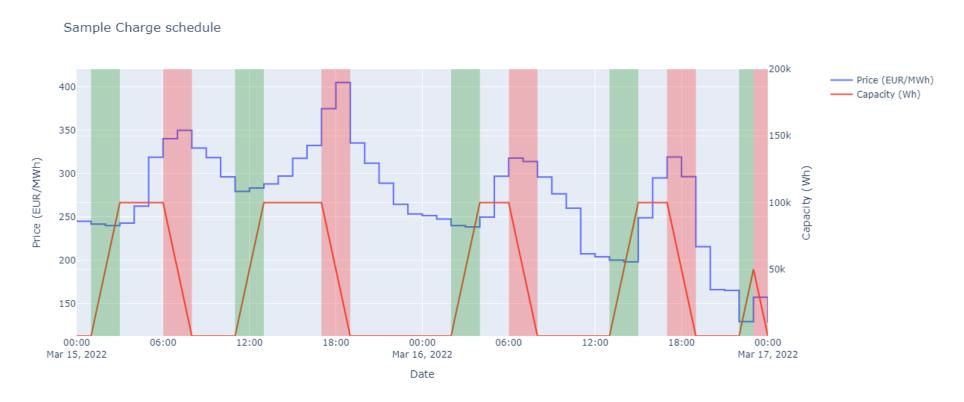

Sample schedule for a 100 kWh battery, assuming no grid cost, a constant charge rate of 0.5C, and without any limit on the number of charging/discharging cycles.

Related Work

Many linear programming approached [4,5,6,7,8], but:

- Battery models are often too simple (no variable charging rates, no battery degradation)
- Sometimes no real-world data and no clear baseline
- Generally assume known prices or use artificial forecasts (true prices with some gaussian noise)

Contributions

- A **battery model** with variable charging rates, discharge efficiency decrease, and capacity fading
- An MPC solution to the profit maximization task that can be deployed using Linear Programming solvers
- A **Python library** to output daily optimal schedules for custom data using built-in price forecasting and that allows running simulations on historical prices
- A quantitative comparison of the performances of our predictive optimization model with a baseline that outputs the optimal schedules, for different key hyperparameters and different European countries.
- A discussion of the impact of capacity fading, discharge efficiency decrease, and the charging rates on the profit obtained via arbitrage

Methodology

Price prediction

We use the mean hourly prices over the last l days as a prediction for $p_d(h)$, the dayahead electricity price at hour h on day d:

$$ilde{p_d}(h) = \sum_{d'=d-l}^{d-1} rac{p_d(h)}{l}$$

Battery model

- ullet Battery of initial energy capacity Q_0
- Battery has a state of charge SOC:

$$SOC(h) = egin{cases} rac{E_{init} + \sum_{t=0}^{h-1} \Delta E(t)}{Q} ext{ if } h \in \{1,2,..,24\} \ rac{E_{init}}{Q} ext{ if } h = 0 \end{cases}$$


where E_{init} denotes the initial energy stored in the battery at hour 0:

Charging rate

During charge/discharge, the state of charge SOC varies as a function of the charging rate r(t), expressed in W/Wh, which varies during the charge:

$$SOC(h) = \mathrm{Clip}_{[0,1]}ig(SOC(0) + \int_{t=0}^h r(t)dtig)$$

The (dis)charging curves give the rates as a function of the SOC

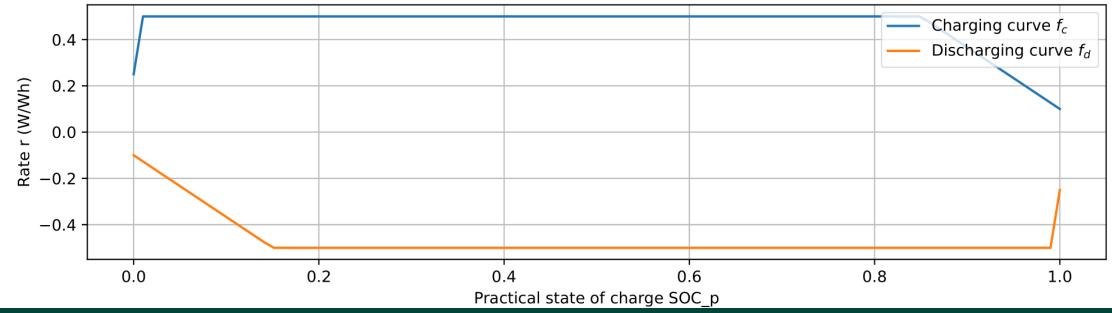



We can derive the maximum (positive) hourly energy change $\Delta E_{max}(SOC(h))$ and the maximum (negative) hourly energy change $\Delta E_{min}(SOC(h))$ between hour h and hour h+1.

$$egin{aligned} \Delta E_{max}(SOC(h)) &= \minigg(1-SOC(h), \int_{t=h}^{t=h+1} f_c(SOC(t)) dtigg) imes Q \ \Delta E_{min}(SOC(h)) &= \maxigg(-SOC(h), \int_{t=h}^{t=h+1} f_d(SOC(t)) dtigg) imes Q \end{aligned}$$

The constraint on the energy change between hour h and hour h+1 then writes as :

$$\Delta E_{max}(SOC(h)) \leq \Delta E(h) \leq \Delta E_{min}(SOC(h))$$

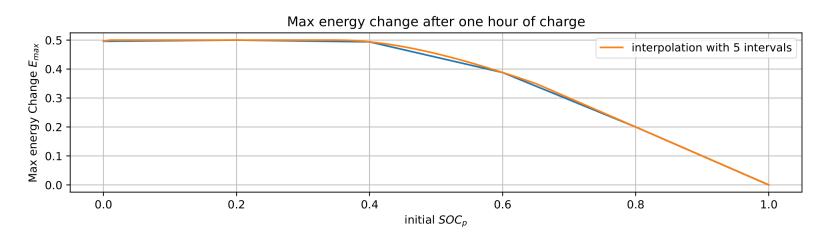

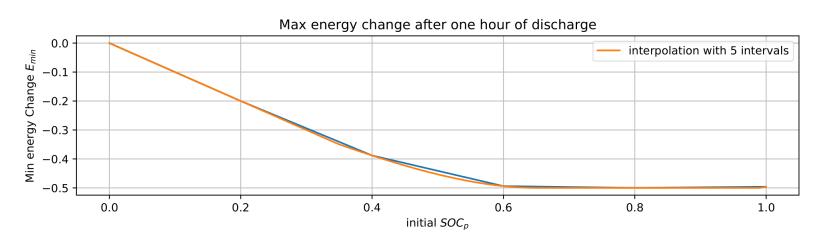


Availability constraints

- Energy Arbitrage = Additional revenue stream for asset owners using their batteries for another main purpose (e.g. backup energy source)
- Need to make sure that the battery is charged enough at some key point, or on the contrary discharged enough to store energy excess from renewables:

$$SOC_{min}(h) \leq SOC(h) \leq SOC_{max}(h) \quad \forall h \in \{1, 2, \dots, 24\}$$

Capacity fading

- Battery loses capacity with time and the number of charge/ discharge cycles.
- We assume a linear decrease of the capacity from Q_0 to Q_{min} reached after $Cycle_{max}$ cycles.

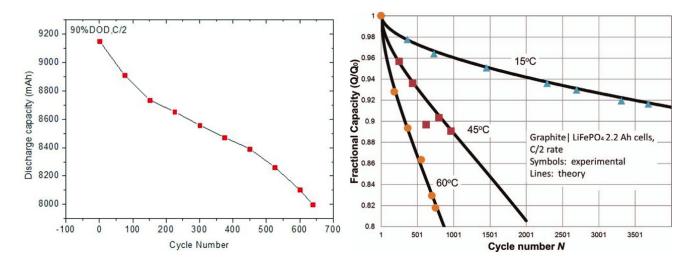

Left: Capacity fading of a LiFePO4. [9]. Right: Capacity fading of the cell as a function of number of cycles for different temperatures. [10]

The capacity at day d, denoted by Q(d), is computed as:

$$egin{aligned} Q(d) &= \max(Q_{min}, Q_0 - lpha imes n_{cycles}(d)) \ n_{cycles}(0) &= 0 \ n_{cycles}(d) &= rac{\sum_{d'=0}^{d-1} \Delta E_{day}(d')}{2Q(d)}, d \geq 1 \ Q_{min} &= 0.8 imes Q_0 \ lpha &= rac{Q_0 - Q_{min}}{Q_{min}} \end{aligned}$$

Where $\Delta E_{day}(d)$ denotes the total amount of energy exchanged during day d

The charge efficiency η decreases with the number of cycles. We update it similarly to the capacity:

$$egin{aligned} \eta(d) &= \max(\eta_{min}, \eta_0 - eta imes n_{cycles}(d)) \ \eta_{min} &= 0.8 imes \eta_0 \ eta &= rac{\eta_0 - \eta_{min}}{\eta_{min}} \end{aligned}$$

Grid costs

- ullet Variable grid costs ${
 m vgc}(h)$ [EUR/MWh] : to be multiplied by the total amount of energy exchanged with the grid
- ullet Fixed grid costs ${
 m fgc}(h)$ [EUR] : paid for every hour when energy has been exchanged with the grid

Profit from energy arbitrage

We optimize profits from arbitrage using forecasted prices

If the battery is charging at hour h, the forecasted (negative) profit $\pi(h)$ is the forecasted cost of the electricity bought added to the variable and fixed grid costs.

$$\pi(h) = -(p(h) + \operatorname{vgc}(h)) \times \Delta E(h) + \operatorname{fgc}(h)$$

If the battery is discharging at hour h, the forecasted profit $\pi(h)$ is the revenue from the electricity sold taking into account the discharge efficiency $\eta(d)$, net of the variable and grid costs.

$$\pi(h) = -(p(h) + \operatorname{vgc}(h)) imes \eta imes \Delta E(h) + \operatorname{fgc}(h)$$

The objective function then writes as:

$$egin{aligned} \pi_{total} &= -\sum_{h=0}^{23} \pi(h) \ \pi(h) &= egin{cases} -\Delta E(h) imes (\ p_d(h) + ext{vgc}(h)) + ext{fgc}(h) ext{ if } \Delta E(h) > 0 \ \eta \Delta E(h) imes (\ p_d(h) + ext{vgc}(h)) + ext{fgc}(h) ext{ if } \Delta E(h) < 0 \end{aligned}$$

MPC formulation

We define an MPC task solved using LP:

- ullet Decision variable : $S_d = (\Delta E_d(0), \Delta E_d(1), \ldots, \Delta E_d(23))$
- ullet Main parameters : functions : $\Delta E_{max}, \Delta E_{min}, f_c, f_d$
- ullet Call-specific parameters (specific to day d): Q_d, η_d
- ullet Exogenous stochastic parameters : $p_d(h)$, approximated by $ilde{p_d}(h), \quad h \in \{1,...,24\}$
- ullet State Variable : $SOC_d(h), \quad h \in \{1,...,24\}$

MPC formulation

$$\begin{split} & \underset{\Delta E(0),\,\Delta E(1),\,...,\,\Delta E(23)}{\text{minimize}} : \quad \pi_{total} = -\sum_{h=0}^{23} \pi(h) \\ & \pi(h) = \begin{cases} -\Delta E(h) \times (\ p_d(h) + \operatorname{vgc}(h)) + \operatorname{fgc}(h) \text{ if } \Delta E(h) > 0 \\ \eta \Delta E(h) \times (\ p_d(h) + \operatorname{vgc}(h)) + \operatorname{fgc}(h) \text{ if } \Delta E(h) < 0 \end{cases} \\ & \text{subject to :} \\ & \text{SOC definition} \begin{cases} SOC(h) = \frac{E_{init} + \sum_{t=0}^{h-1} \Delta E(t)}{Q}, \quad h \in \{1,...,24\} \\ SOC(0) = \frac{E_{init}}{Q} \end{cases} \\ & \text{SOC bounds} \left\{ SOC(h) \in [0,1], \quad h \in \{0,...,24\} \right. \\ & \text{Availability constraint} \left\{ SOC_{min}(h) \leq SOC(h) \leq SOC_{max}(h) \quad \forall h \in \{1,2,\ldots,24\} \right. \\ & \text{Max (dis) charging rates} \left\{ \Delta E_{max}(SOC(h)) \leq \Delta E(h) \leq \Delta E_{min}(SOC(h)), \quad h \in \{1,...,24\} \right. \end{split}$$

Linear approximation of π

we introduce the boolean variables c(h), d(h) that respectively indicate if the battery is charging at hour h, and if the battery is discharging at hour h.

$$egin{aligned} \pi_{total} &= \sum_{h=0}^{23} \left[\Delta E(h) imes (c(h) + d(h) imes \eta) imes (ilde{p}_d(h) + ext{vgc}(h)) + (c(h) + d(h)) imes ext{fgc}(h)
ight] \ arepsilon &= M imes (1 - c(h) \leq \Delta E(h) \leq eps + M imes c(h) \quad orall h \in \{0, 2, \dots, 23\} \ arepsilon &= M imes (1 - d(h) \leq -\Delta E(h) \leq eps + M imes d(h) \quad orall h \in \{0, 1\} \ d \in \{0, 1\} \end{aligned}$$

Linear approximation of ΔE_{min} and ΔE_{max}

We discretize the interval [0,1] into N_{int} intervals of length N_{int}^{-1} . This adds the following set of constraints to our LP model:

$$\begin{split} \text{set weight values} \bigg\{ \sum_{k=1}^{N_{int}} \lambda[k,h] \frac{k-1}{N_{int}} + \mu[k,h] \frac{k}{N_{int}} &= SOC(h), \quad \forall h \in \{0,2,\ldots,23\} \\ \text{select interval} \bigg\{ \lambda[k,h] + \mu[k,h] &= y[k,h], \quad \forall h \in \{0,2,\ldots,23\}, \quad \forall k \in \{1,2,\ldots,N_{int}\} \\ \text{ensure one interval is selected} \bigg\{ \sum_{k=1}^{N_{int}} y[k,h] &= 1, \quad \forall h \in \{0,2,\ldots,23\} \\ \text{set max SOC change} \bigg\{ \sum_{k=1}^{N_{int}} \lambda[k,h] \Delta E_{max} (\frac{k-1}{N_{int}}) + \mu[k,h] \Delta E_{max} (\frac{k}{N_{int}}) \geq \Delta E(h), \quad \forall h \in \{0,2,\ldots,23\} \\ \text{set min SOC change} \bigg\{ \sum_{k=1}^{N_{int}} \lambda[k,h] \Delta E_{min} (\frac{k-1}{N_{int}}) + \mu[k,h] \Delta E_{min} (\frac{k}{N_{int}}) \leq \Delta E(h), \quad \forall h \in \{0,2,\ldots,23\} \\ (\mu[k,h],\lambda[k,h],y[k,h]) \in [0,1] \times [0,1] \times \{0,1\}, \quad \forall h \in \{0,2,\ldots,23\}, \quad \forall k \in \{1,2,\ldots,N_{int}\} \end{split}$$

Implementation

- AmplPy for AMPL call from python code
- Gurobi solver

Results

Experiment setup

Battery

- ullet 1 MWh capacity battery ($Q_0=10^6$)
- Charging / Discharging curves as shown previously (0.5 W/Wh peak rate)
- ullet Initial discharge efficiency $\eta=0.99$
- ullet Cycle life $Cycles_{max}=4000$

Prices

- ullet Constant variable grid costs of 5 EUR/MWh ${
 m vgc}_d(h)=5 imes10^{-6}$ $\quad orall h\in\{0,2,\ldots,23\}, orall d.$
- Simulation ran on the **German** day-ahead wholesale electricity prices between **January 30th**, **2022** and **December 31st**, **2022**.

Other considerations

- ullet We end the day with a fully discharged battery: $SOC_{max_d}(24)=0 \quad orall d$
- Daily schedule starts at 00:00 and ends at 24:00

Algorithm Comparison

LP-PRED :

- The algorithm we defined up until now
- Uses price prediction
- optimal schedule w.r.t predicted prices

• LP-OPTIM (Baseline):

- Uses true prices
- Gives optimal schedules
- No stochasticity involved

Algorithm	I	Daily profit	Relative diff in profit with LP-OPTIM	#cycles	#Days neg. profit	MAE price pred.
LP-PRED	42	220.56	-19%	645	2	0.782
LP-PRED	35	221.06	-19%	643	1	0.753
LP-PRED	28	222.07	-19%	643	2	0.730
LP-PRED	14	222.03	-19%	643	1	0.627
LP-PRED	7	220.17	-19%	650	2	0.555
LP-PRED	2	201.91	-26%	682	3	0.534
LP-PRED	1	188.14	-31%	717	5	0.506
LP-OPTIM	•	273.31	•	718	0	•

Each simulation took ~2 minutes (Gurobi solver, AMD Ryzen 5 4600Hz, 16.0 GB RAM).


Importance of l (window size for price prediction)


- ullet Highest profits achieved for large l
- larger l decreases the number of cycles => the algorithm better tracks electricity price spreads when the forecast is based on a longer historical period
- ullet small l lead to overfitting: The schedule is based on variations observed in the last l days, but that do not accurately describe the usual intraday price variations
- MAE does not accurately describe the quality of the price prediction for the scheduling task

Profit distribution


- Two main drivers:
 - Intraday spreads
 - Absolute prices

LP-PRED (top) / LP-OPTIM (bottom). Germany January 31st, 2022 - December 31st.

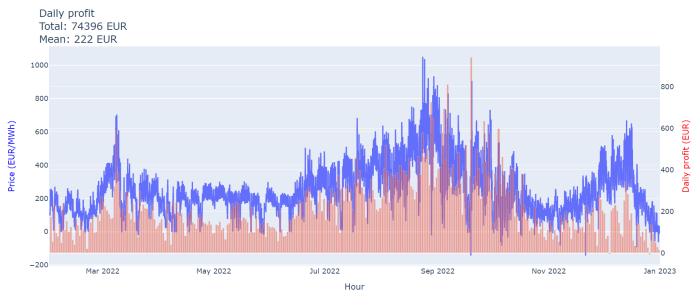

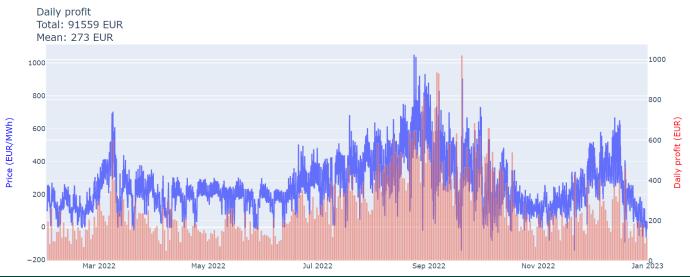


Relative profit difference between LP-OPTIM and LP-PRED

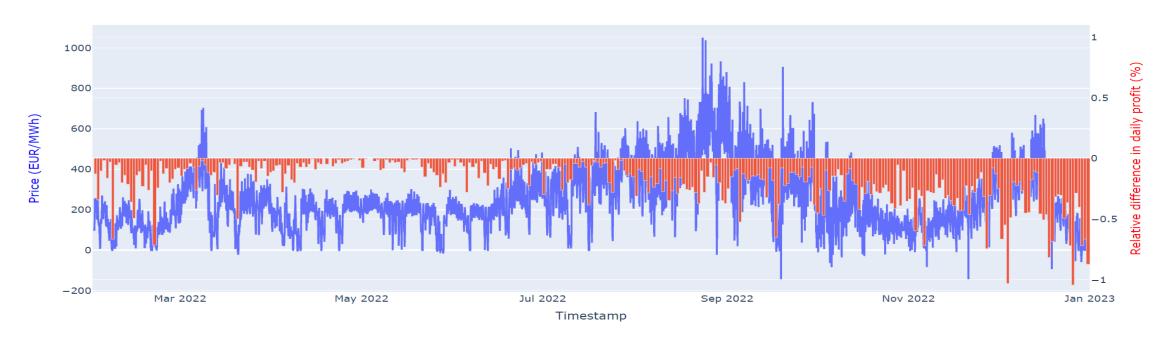


Results in other European countries

Algorithm	Country	I	Avg. Daily Profit	Relative diff in profit with LP-OPTIM	MAE prediction
LP-PRED	Germany	30	222.07	-19%	0.730
LP-PRED	France	30	167.36	-17%	0.688
LP-PRED	Denmark	30	185.90	-11%	0.762
LP-PRED	Spain	30	94.01	-13%	0.277
LP-PRED	Italy	30	94.01	-11%	0.580

France January 31st 2022 - December 31st.

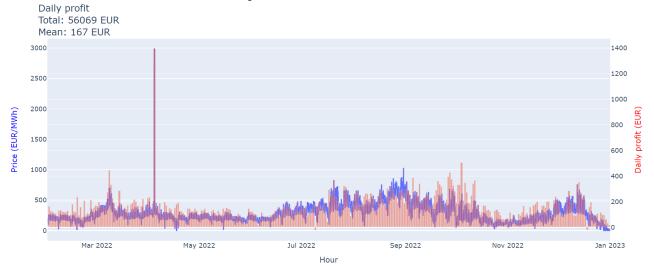


LP-PRED

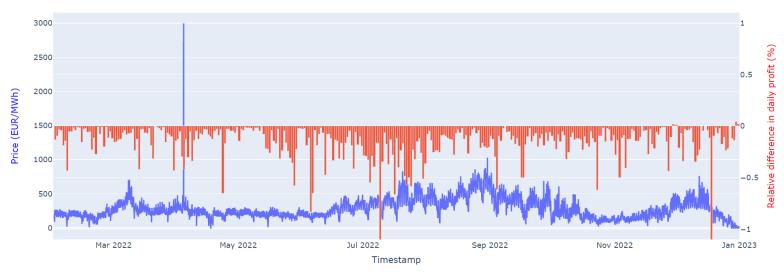


Rel. Difference in profit with LP-OPTIM

Denmark January 31st 2022 - December 31st.

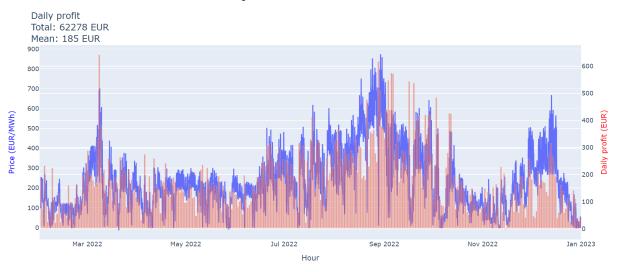


LP-PRED

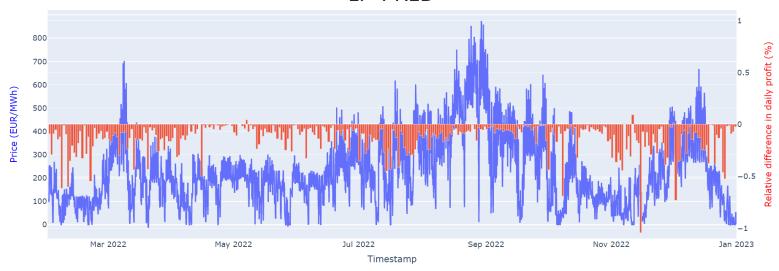

Rel. Difference in profit with LP-OPTIM

Impact of the charging/ discharging rate

Relative difference in profit between a 1 W/Wh and a 0.5 W/Wh peak rate battery

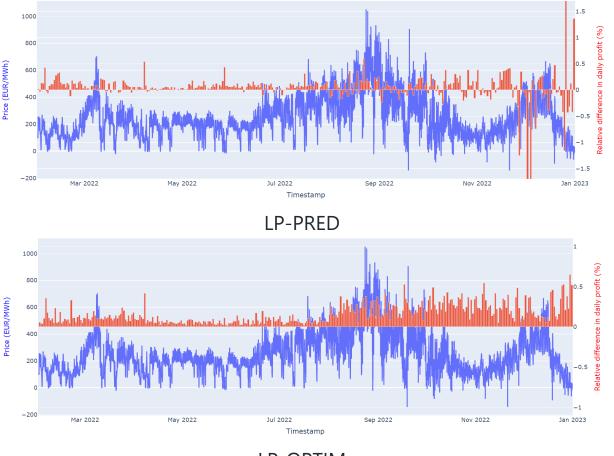


LP-OPTIM

- Higher charging rate generally increases profits (more electricity can be traded)
- Also increases the loss when the electricity is traded at the wrong times (because of wrong price predictions)

Impact of battery degradation (capacity fading + efficiency decrease)

Relative profit loss due to battery degradation with LP-OPTIM

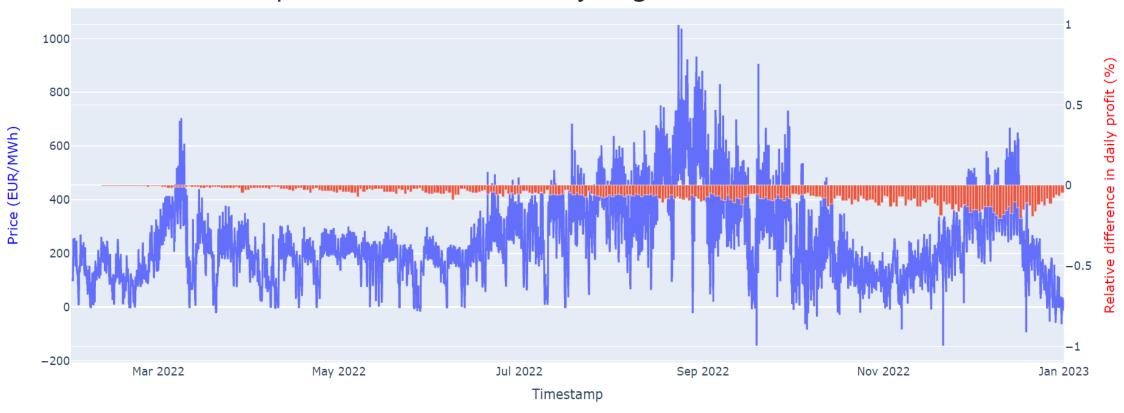

Conclusion

Conclusion

- We proposed an MPC algorithm for energy arbitrage profit maximization
- Introduced a battery model with capacity fading, efficiency decrease, variable charging rates
- Achieved between 80 percent (Germany) and 89 percent (Denmark) of the maximum obtainable profit on an 11-month-long simulation on the 2022 electricity prices
- Reported a daily profit of 222 euros for a 1MWh battery with 0.5 peak charging and discharging rate in Germany

Future Work

- The difference with the maximum relative profit can be further decreased by improving the price forecasting
 - Rely on machine learning regression model or stat models (e.g. ARIMA)
 - Define a loss function that describes the quality of the prediction for the optimization task (we are not interested in the absolute price value, but in knowing the intraday hourly price variations)

References:

- [1] lea. Net zero by 2050 analysis, May 2021
- [2] Claudia Pavarini. Battery storage is (almost) ready to play the flexibility game analysis, Nov 2018.
- [3] Omer Karaduman. Economics of grid-scale energy storage. Job market paper, 2020.
- [4] Dheepak Krishnamurthy, Canan Uckun, Zhi Zhou, Prakash R. Thimmapuram, and Audun Botterud. Energy storage arbitrage under day-ahead and real-time price uncertainty. IEEE Transactions on Power Systems, 33:84–93,2018.
- [5] Md Umar Hashmi, Arpan Mukhopadhyay, Ana Bušic, and Jocelyne Elias. Optimal control of storage under time varying electricity prices. In 2017 IEEE International Conference on Smart Grid Communications (SmartGridComm), pages 134–140, 2017.
- [6] Peter M. van de Ven, Nidhi Hegde, Laurent Massoulié, and Theodoros Salonidis. Optimal control of end-user energy storage. IEEE Transactions on Smart Grid, 4(2):789–797, 2013.
- [7] Yixing Xu and Chanan Singh. Adequacy and economy analysis of distribution systems integrated with electric energy storage and renewable energy resources. IEEE Transactions on Power Systems, 27(4):2332–2341, 2012.
- [8] Alessandro Di Giorgio, Francesco Liberati, Andrea Lanna, Antonio Pietrabissa, and Francesco Delli Priscoli. Model predictive control of energy storage systems for power tracking and shaving in distribution grids. IEEE Transactions on Sustainable Energy, 8(2):496–504, 2017
- [9] Zhang, Heng & Liu, Weiwei & Dong, Yazhou & Zhang, Hong-Chao & Chen, Hao. (2014). A Method for Pre-determining the Optimal Remanufacturing Point of Lithium ion Batteries. Procedia CIRP. 15. 218–222. 10.1016/j.procir.2014.06.064.
- [10] Deshpande, Rutooj & Verbrugge, Mark & Cheng, Yang-Tse & Wang, John & Liu, Ping. (2012). Battery Cycle Life Prediction with Coupled Chemical Degradation and Fatigue Mechanics. Journal of the Electrochemical Society. 159. A1730-A1738. 10.1149/2.049210jes.