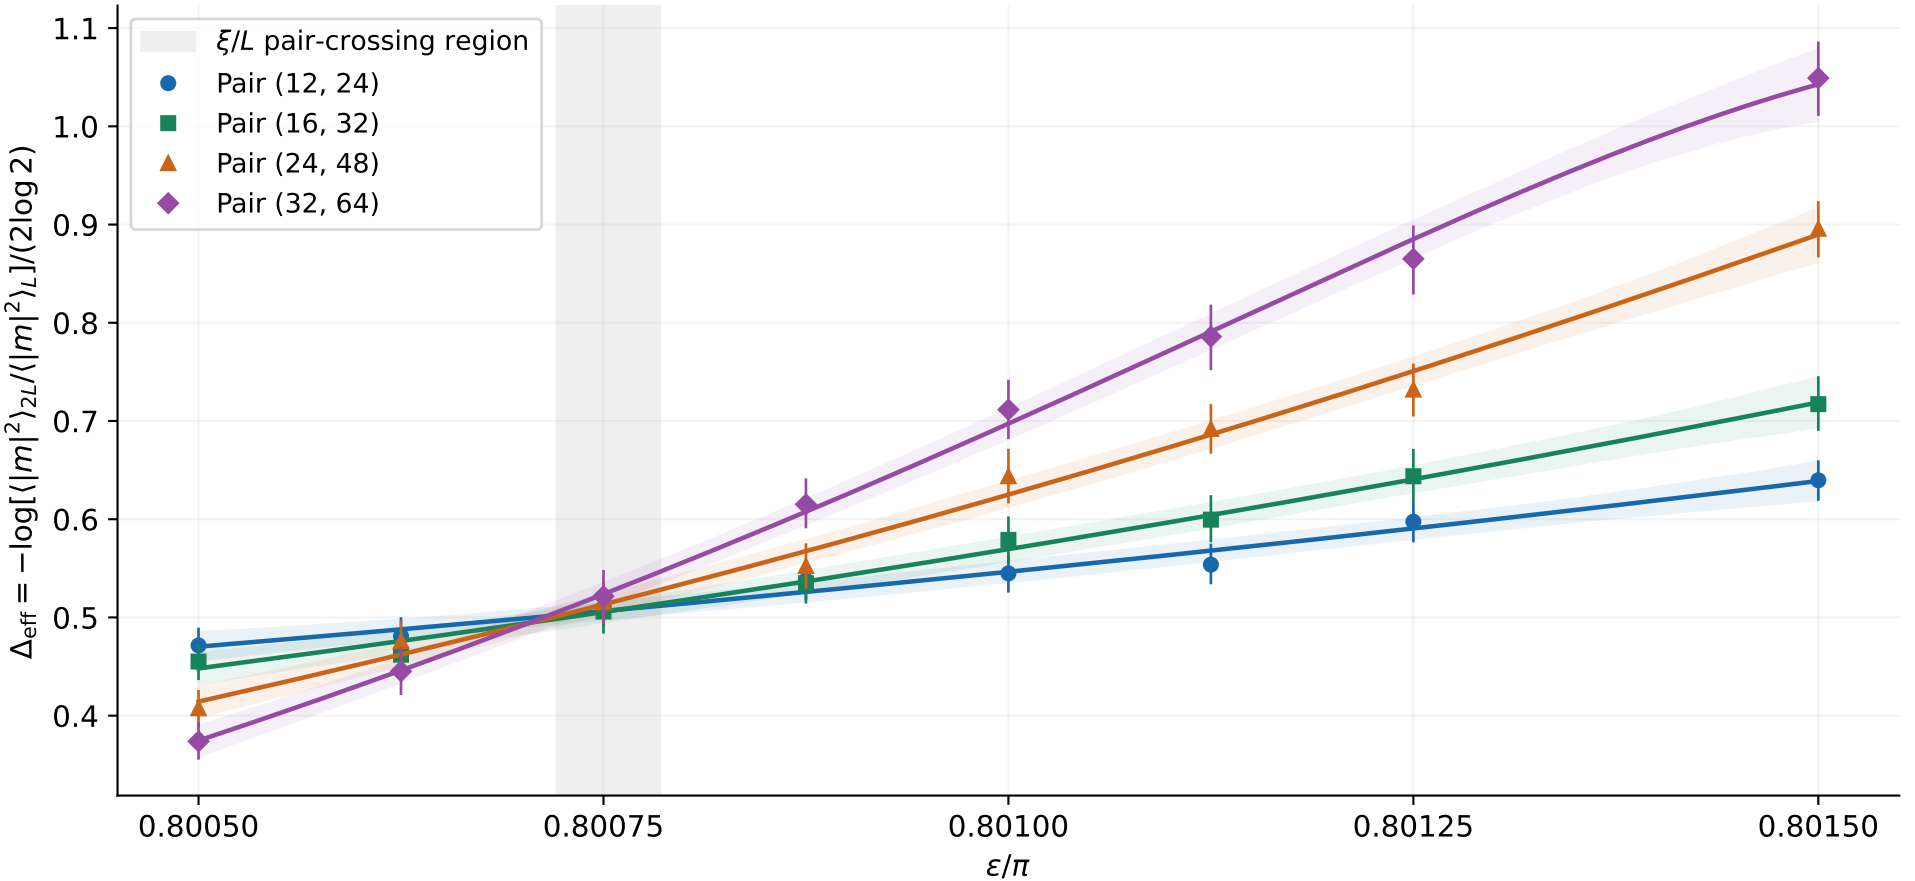



Points: direct measured ratios. Curves/bands: independent quadratic magnetization responses; conditional MC 95%.
Gray strip: descriptive union of two finite-size crossing intervals, not an infinite-volume critical-coupling interval.
Finite-size corrections remain; these effective-dimension curves need not cross at one exact point.