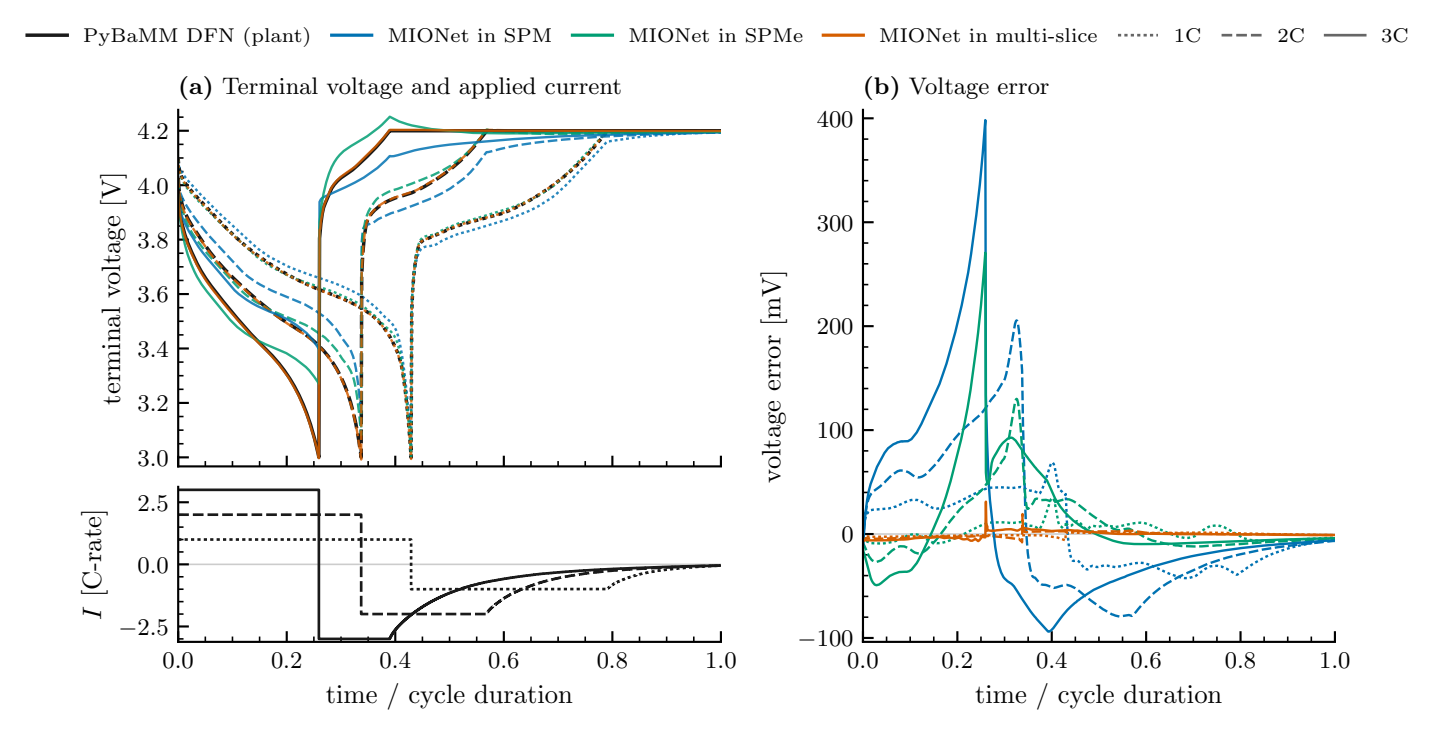

PyBaMM DFN (plant)
MIONet in SPM
MIONet in SPMe
MIONet in multi-slice
1C
2C
3C
(a) Terminal voltage and applied current
terminal voltage [V]
4.2
4.0
3.8
3.6
3.4
3.2
3.0
I [C-rate]
2.5
0.0
−2.5
0.0
0.2
0.4
0.6
0.8
1.0
time / cycle duration
(b) Voltage error
voltage error [mV]
400
300
200
100
0
−100
0.0
0.2
0.4
0.6
0.8
1.0
time / cycle duration