

Gamybai

1

2

3


4

5

6

7


8

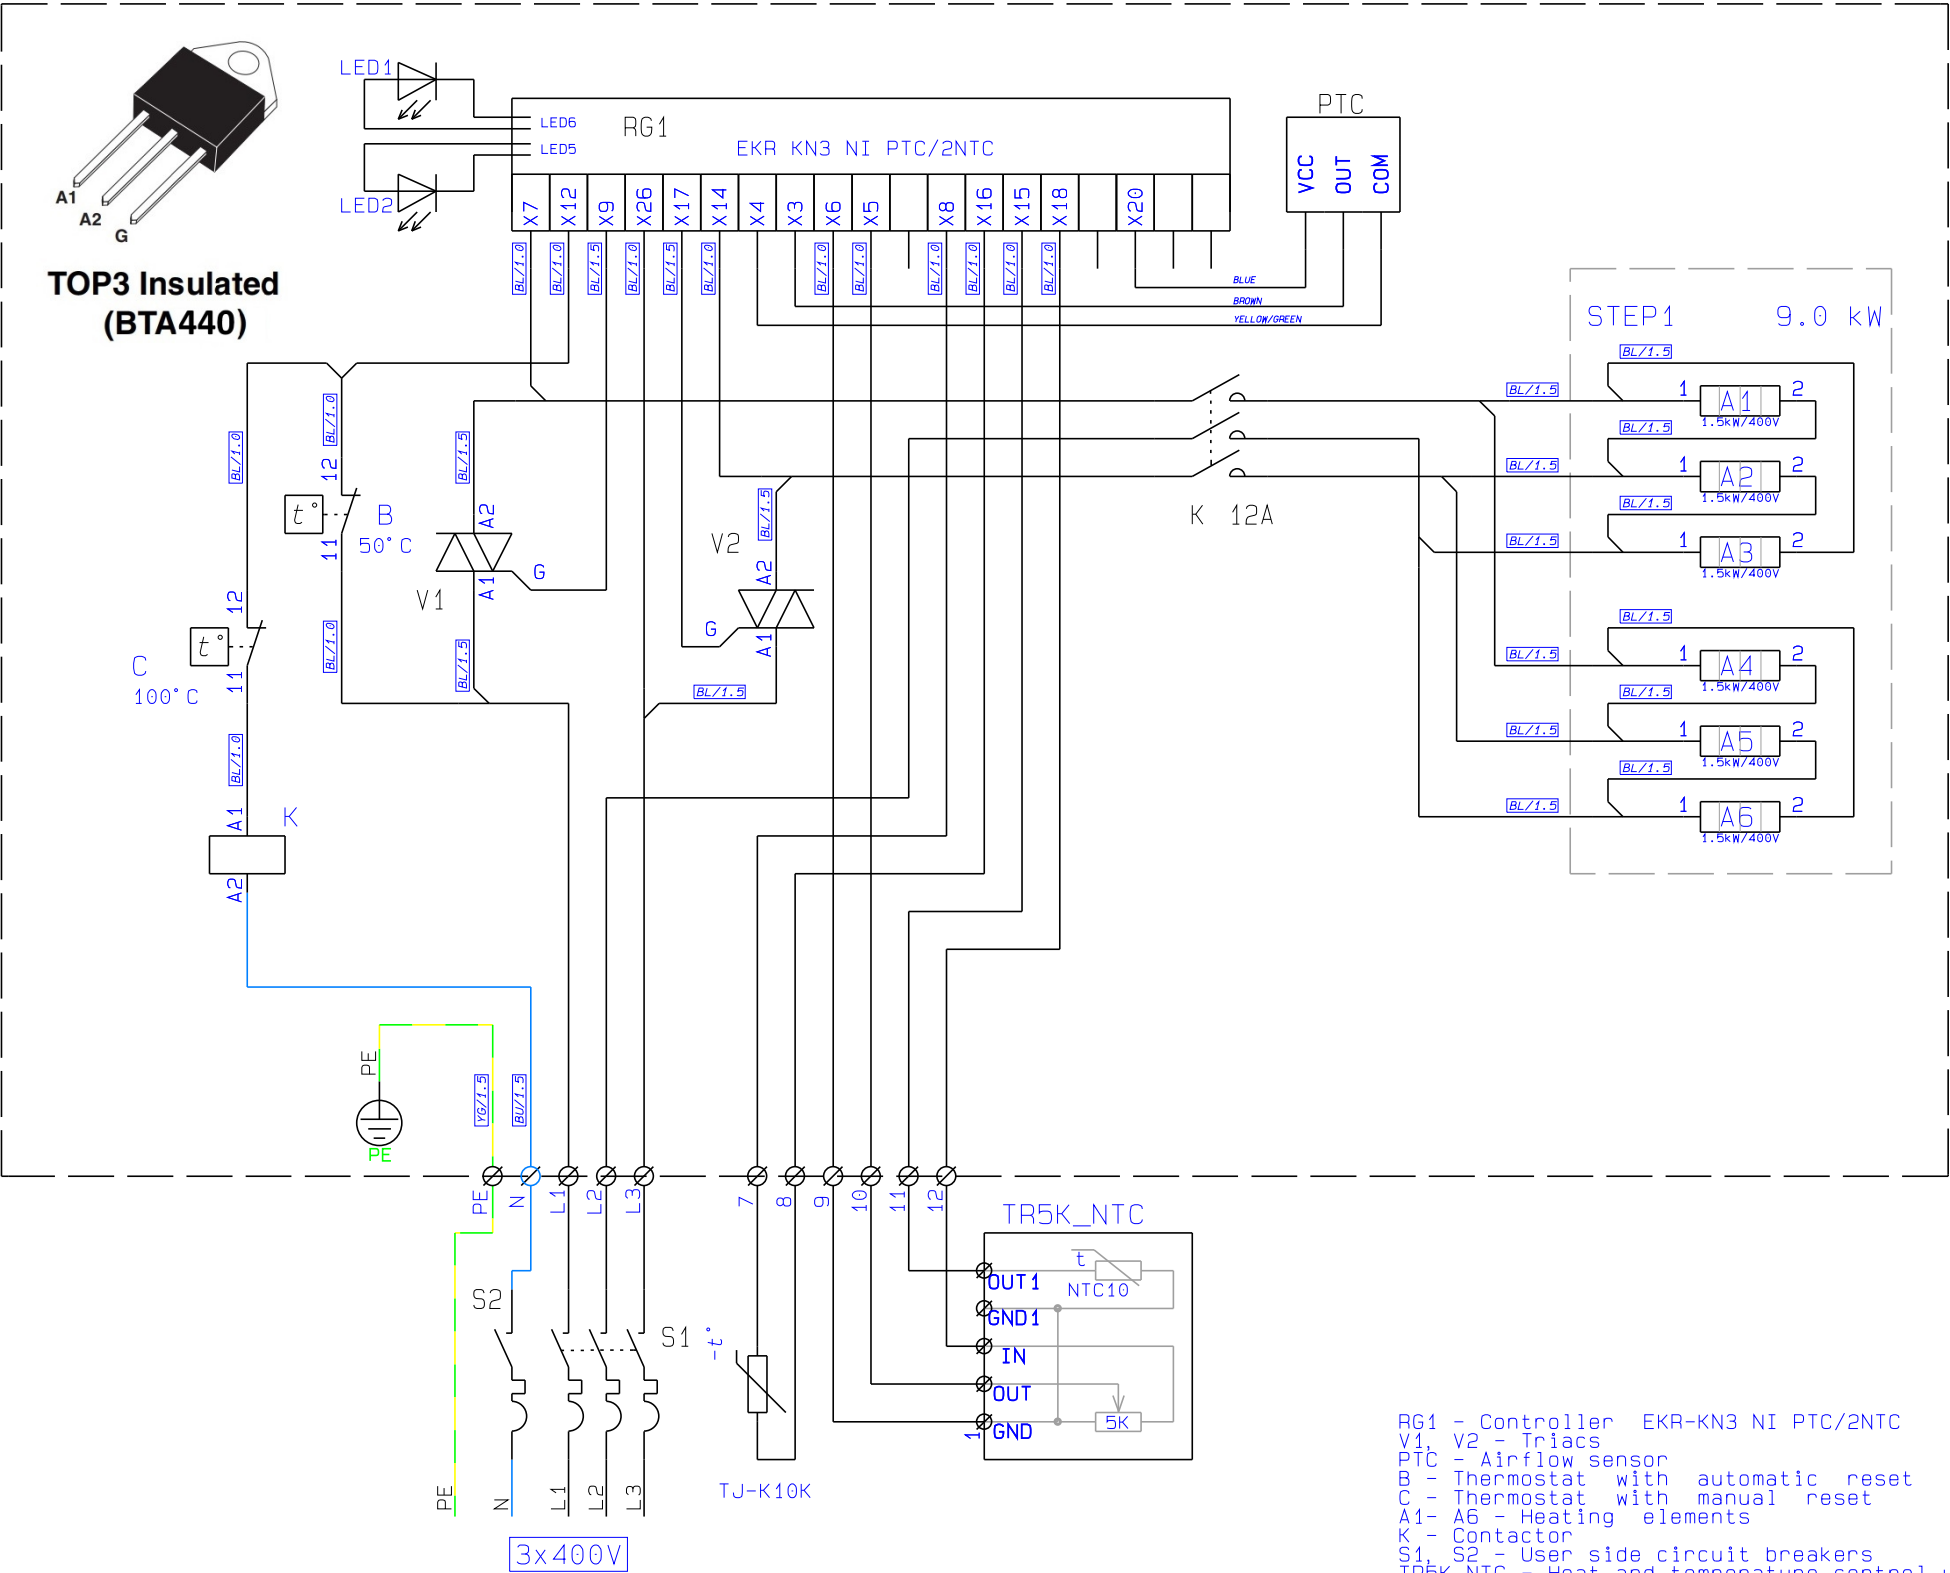

RG1 - Controller EKR-KN3 NI PTC/2NTC
V1, V2 - Triacs
PTC - Airflow sensor
B - Thermostat with automatic reset
C - Thermostat with manual reset
A1- A6 - Heating elements
K - Contactor
S1, S2 - User side circuit breakers
TR5K_NTC - Heat and temperature control unit


WT	-	WHITE
GY	-	GRAY
OR	-	ORANGE
BU	-	BLUE
GN	-	GREEN
BN	-	BROWN
YE	-	YELLOW
Y/G	-	YELLOW/GREEN
BL	-	BLACK
NV	-	NAVY

EKA NI 400 9.0kW 3f PTC/2NTC K

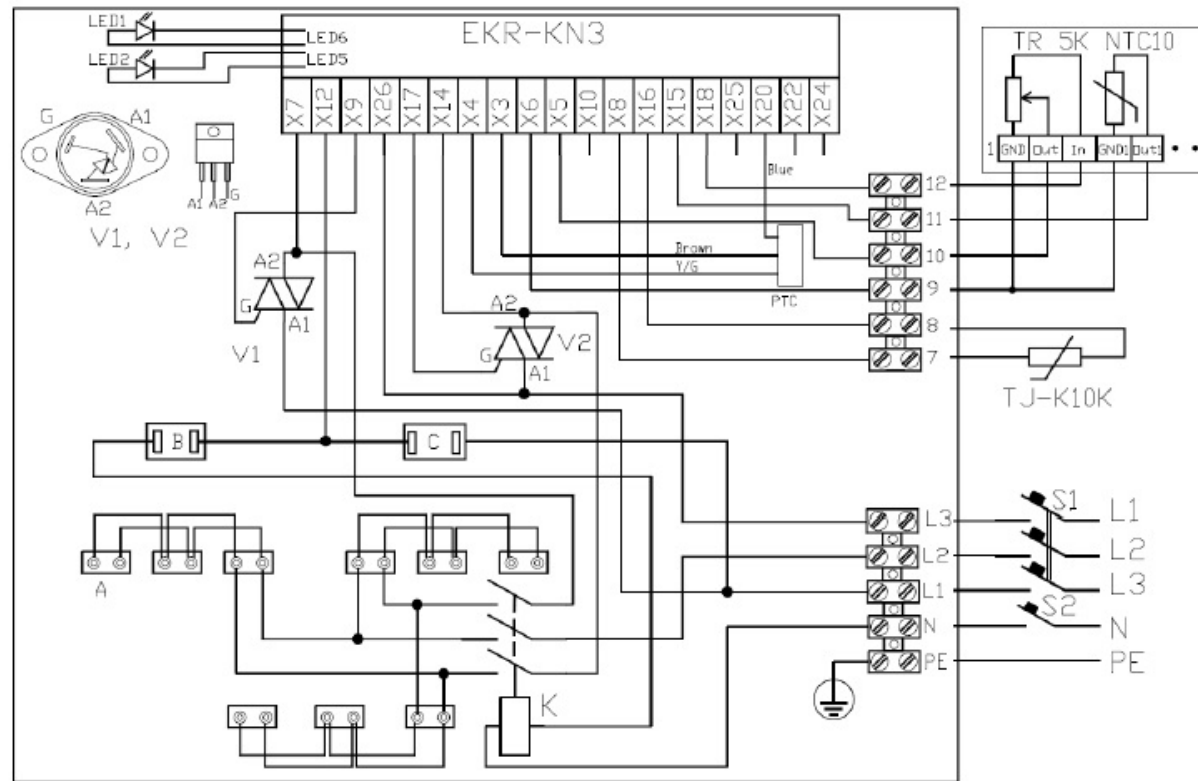

RG1 - Controller EKR-KN3 NI PTC/2NTC
 V1, V2 - Triacs
 PTC - Airflow sensor
 B - Thermostat with automatic reset
 C - Thermostat with manual reset
 A - Heating elements
 K - Contactor
 TJ-K10K - Air temperature sensor
 TR5K NTC10 - Heat and temperature control unit
 S1, S2 - User side circuit breakers

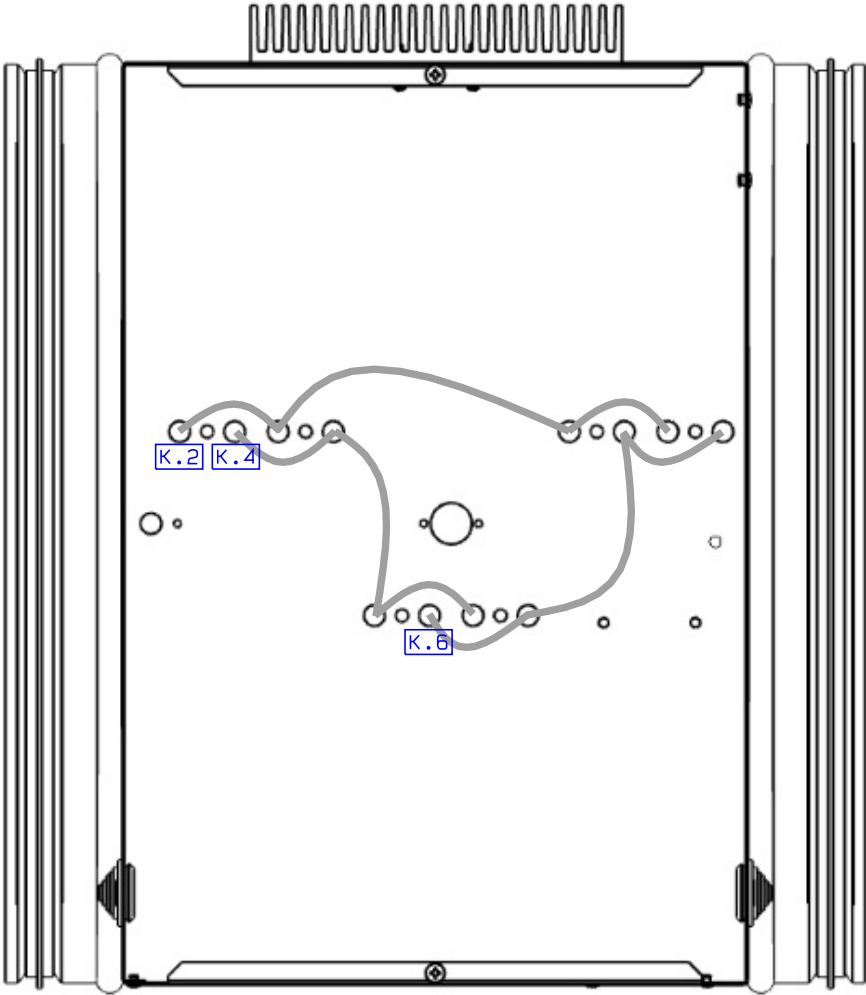

Tenu jungimas



		Date: 2019-06-03		<div><div><div>VENTMATIKA</div><div>VENTMATIKA UAB</div><div>Metalisty 2A-1, Siauliai</div><div>LT-78107 Lithuania</div></div></div>	
EKA NI 400 9.0kW 3f PTC/2NTC K					
Edited: Drawn: A. Ponomarchuk Approved:					
		Last change: 2019-04-09 13:29:44		Page 3 / 4	
				Rev.: 002	

KS

[illegible]

		Date: 2019-06-03		
EKA NI 400 9.0kW 3f PTC/2NTC K				
Edited: Drawn: A. Ponomarchuk Approved:		Last change: 2019-06-03 14: 41: 16		Page 4 / 4 Rev.: 002