



1	2	3	4	5	6	7	8
---	---	---	---	---	---	---	---



RG1 - Controller EKR-KN1 NI/PTC2NTC
V1 - Triac
PTC - Airflow sensor
B - Thermostat with automatic reset
C - Thermostat with manual reset
A1-A3 - Heating elements
K - Contactor
S - User side circuit breaker
TR5K_NTC - Heat and temperature control unit
TJ-K10K - Air temperature sensor

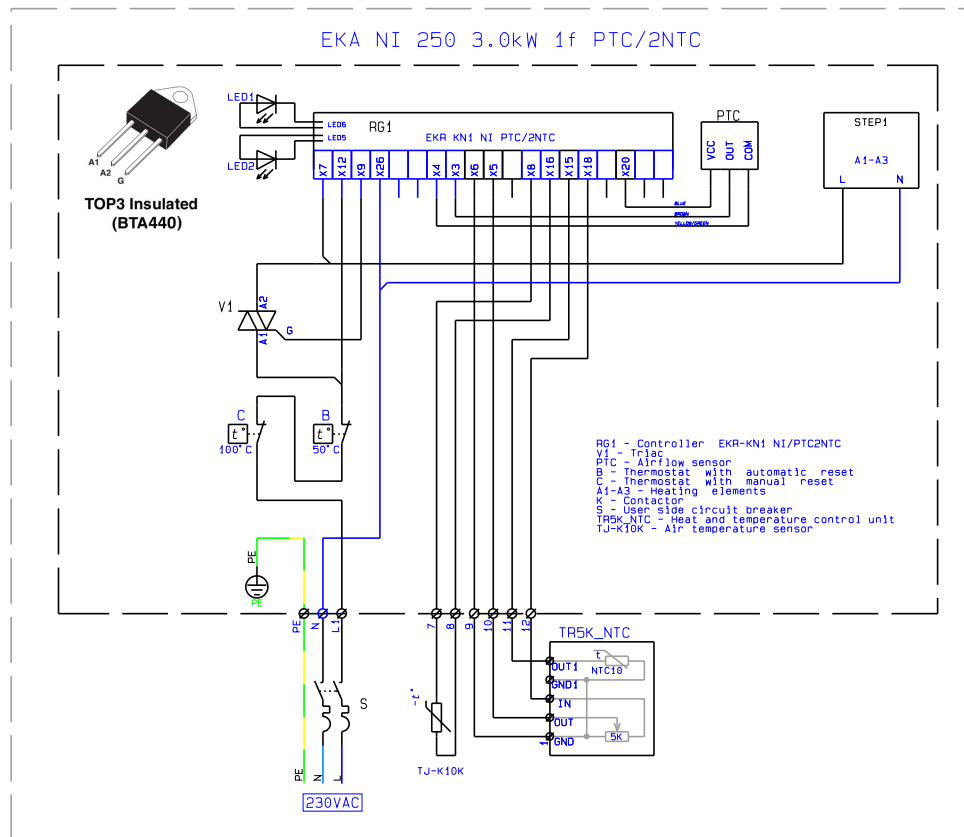

Tenu jungimas

		Date: 2019-05-31	 <div>VENTMATIKA VENTMATIKA UAB Metalisty 2A-1, Siauliai LT-78107 Lithuania</div>
EKA NI 250 3.0kW 1f PTC/2NTC			
Edited: Drawn: A. Ponomarchuk Approved:			
		Last change: 2019-05-27 17: 05: 40	Page 3 / 4
			Rev.:

[illegible]