

Gamybai

1

2

3


4

5

6


7

8

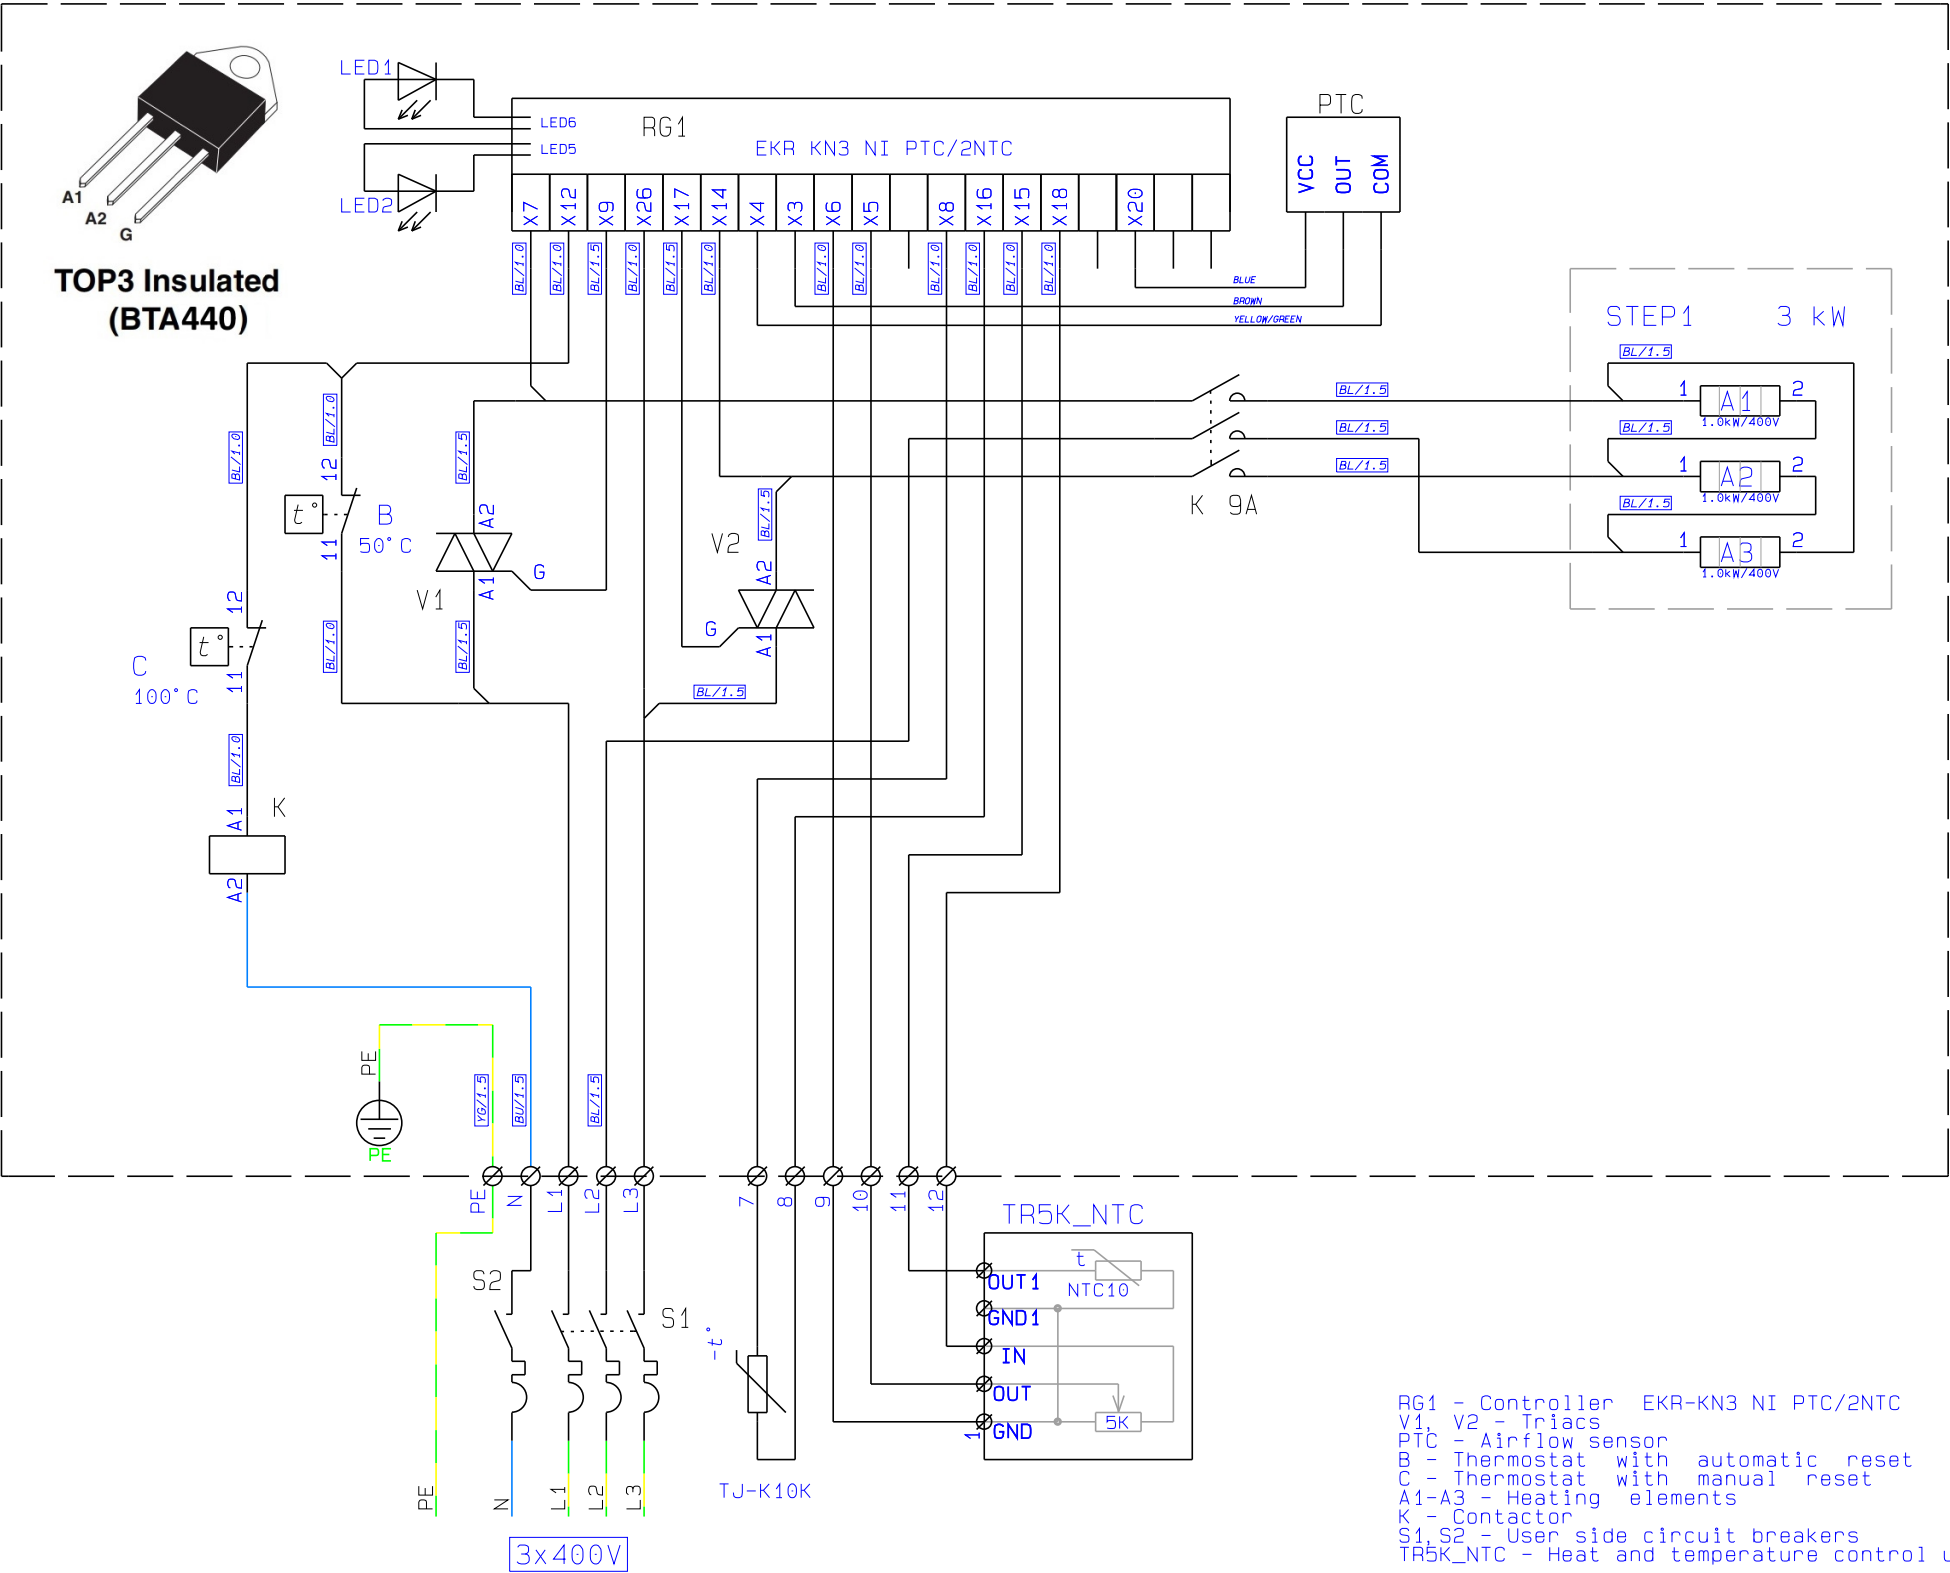


RG1 - Controller EKR-KN3 NI PTC/2NTC
V1, V2 - Triacs
PTC - Airflow sensor
B - Thermostat with automatic reset
C - Thermostat with manual reset
A1-A3 - Heating elements
K - Contactor
S1, S2 - User side circuit breakers
TR5K_NTC - Heat and temperature control unit


EKA NI 250 3.0kW 3f PTC/2NTC K

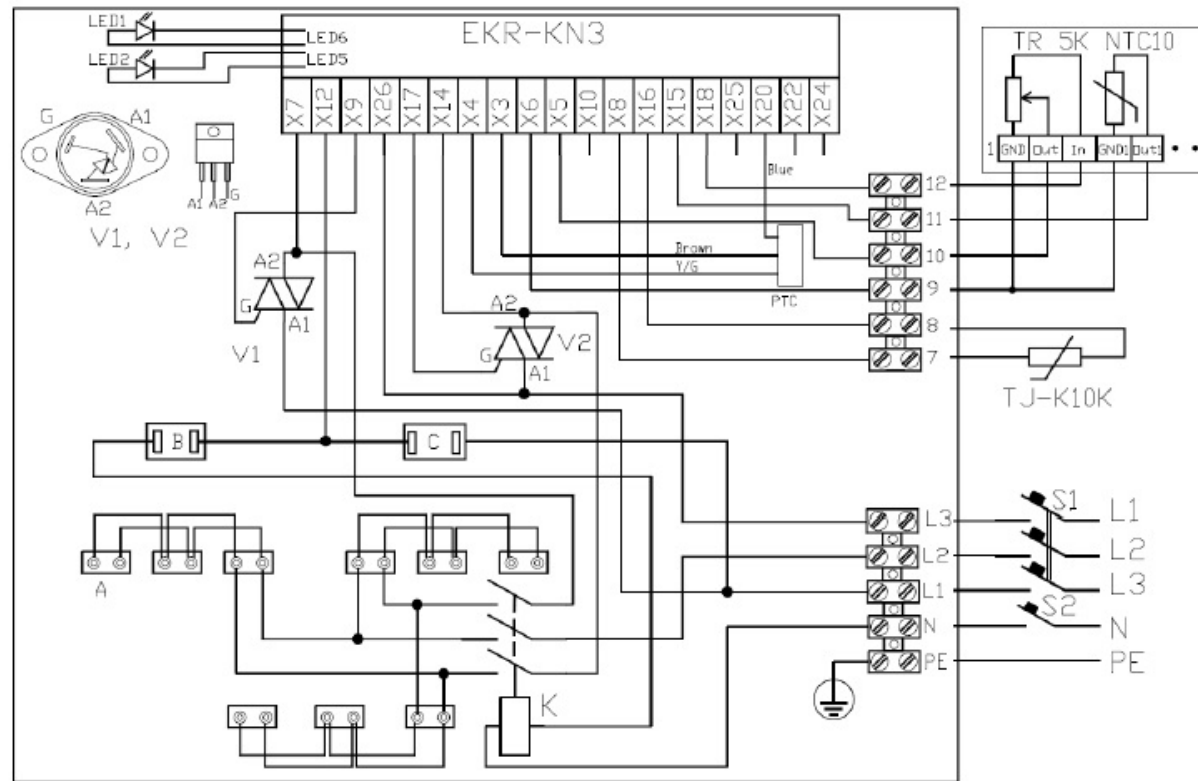

RG1 - Controller EKR-KN3 NI PTC/2NTC
V1, V2 - Triacs
PTC - Airflow sensor
B - Thermostat with automatic reset
C - Thermostat with manual reset
A - Heating elements
K - Contactor
TJ-K10K - Air temperature sensor
TR5K NTC10 - Heat and temperature control unit
S1, S2 - User side circuit breakers

Tenu jungimas

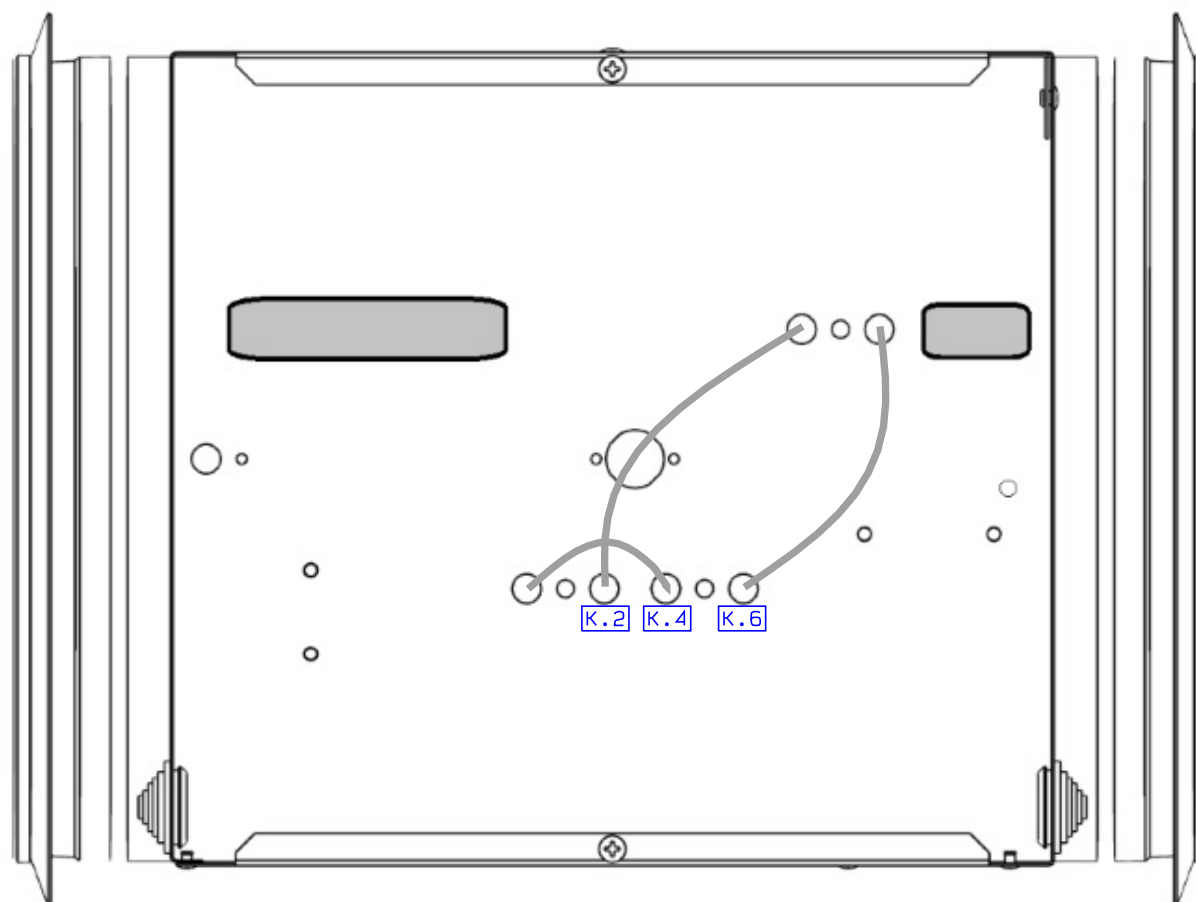

		Date: 2019-06-03	 VENTMATIKA VENTMATIKA UAB Metalisty 2A-1, Siauliai LT-78107 Lithuania
EKA NI 250 3.0kW 3f PTC/2NTC K			
Edited: Drawn: A. Ponomarchuk Approved:			
		Last change: 2019-04-09 13:29:22	Page 3 / 4
			Rev.: 002

[illegible]