

NeuroAnalyzer report: LDF Processing

NeuroAnalyzer v0.3.0 · MATLAB 2026a · 2026-09-25T05:27:24+00:00 · window image: exportapp

LDF Processing

Filter and downsample LDF, then cut trials around stimulus onsets

? Help

2 Filter & downsample (optional)

Settings...Undo

Downsampled LDFs to 100 Hz. Butterworth filter pass 1 Hz, order 4

3 Segment trials

Edm threshold2.5

Pre-onset (s)5

Post-onset (s)20

Min interval (s)10

Segment trials

8 trials, LDFs to 20.00 s around onset


4 Save trials

Save trials...

Click and drag to zoom the plot area. Open the file in LDF Average.

Save session...Open session...

Report (PDF)...Methods text...

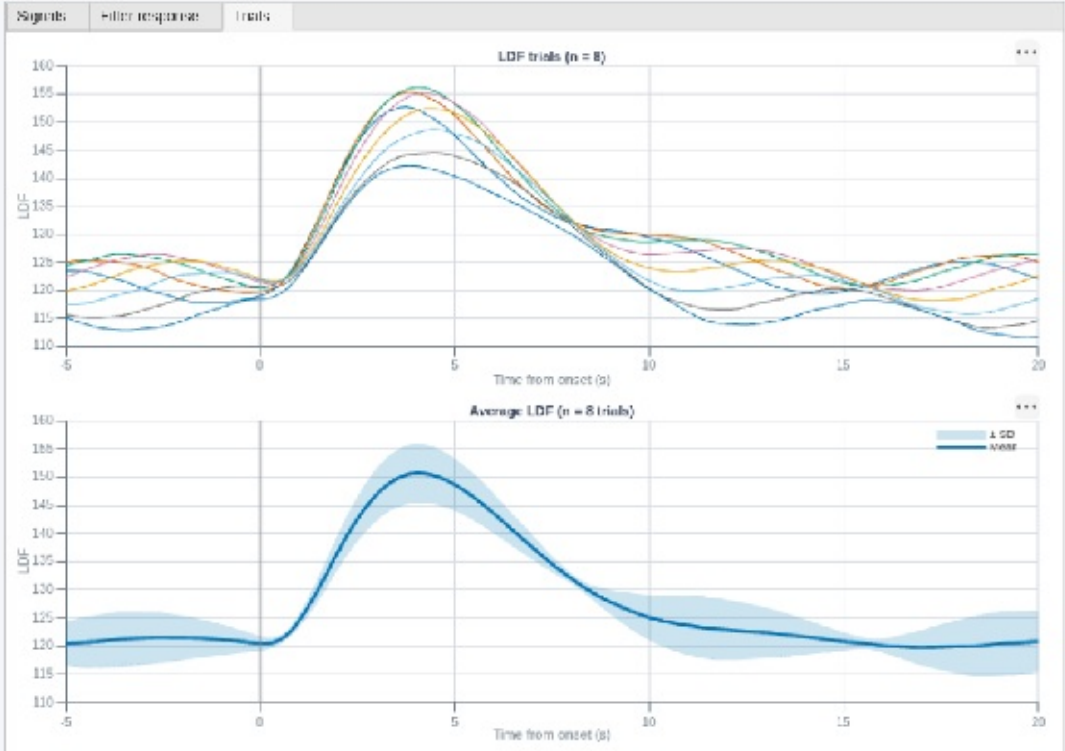

Session saved in ProcessingLDFApp session mat (1 input file(s) with VDS, settings and results).

© Copyrights by Alejandro Suarez, Ph.D. · v0.3.0

Window: LDF Processing (ProcessingLDFApp)
NeuroAnalyzer v0.3.0
MATLAB 26.1.0.3346908 (R2026a) Update 5
OS: Linux 6.17.0-1022-azure (GLNXA64)
Session created: 2026-09-25T05:27:24+00:00
Report created: 2026-09-25T05:27:24+00:00

NOTES
ProcessingLDFApp walkthrough: demo data

INPUTS (1)
1. Cropped LDF file: demo_ldf_cropped.mat
path: /tmp/NeuroAnalyzerDemo/demo_ldf_cropped.mat
4,407,851 bytes, modified 2026-09-25T05:23:21
MD5 8501afb13fe453ee7d86c1bbf729b1a1

SETTINGS
processing.downsample = 10
processing.filterType = 2
processing.designType = 1
processing.filterOrder = 4
processing.cutoffLow = NaN
processing.cutoffHigh = 1
threshold = 2.5
preS = 5
postS = 20
minISI = 10
segmented = true
tab = Trials

KEY RESULTS
Loaded 260001 samples at 1000 Hz; processed rate 100 Hz
8 trials, -5.00 to 20.00 s; trial mean peaks at 150.7, 4.07 s
after onset