Figure 1. Symmetric and Asymmetric Saturation Transfer Functions
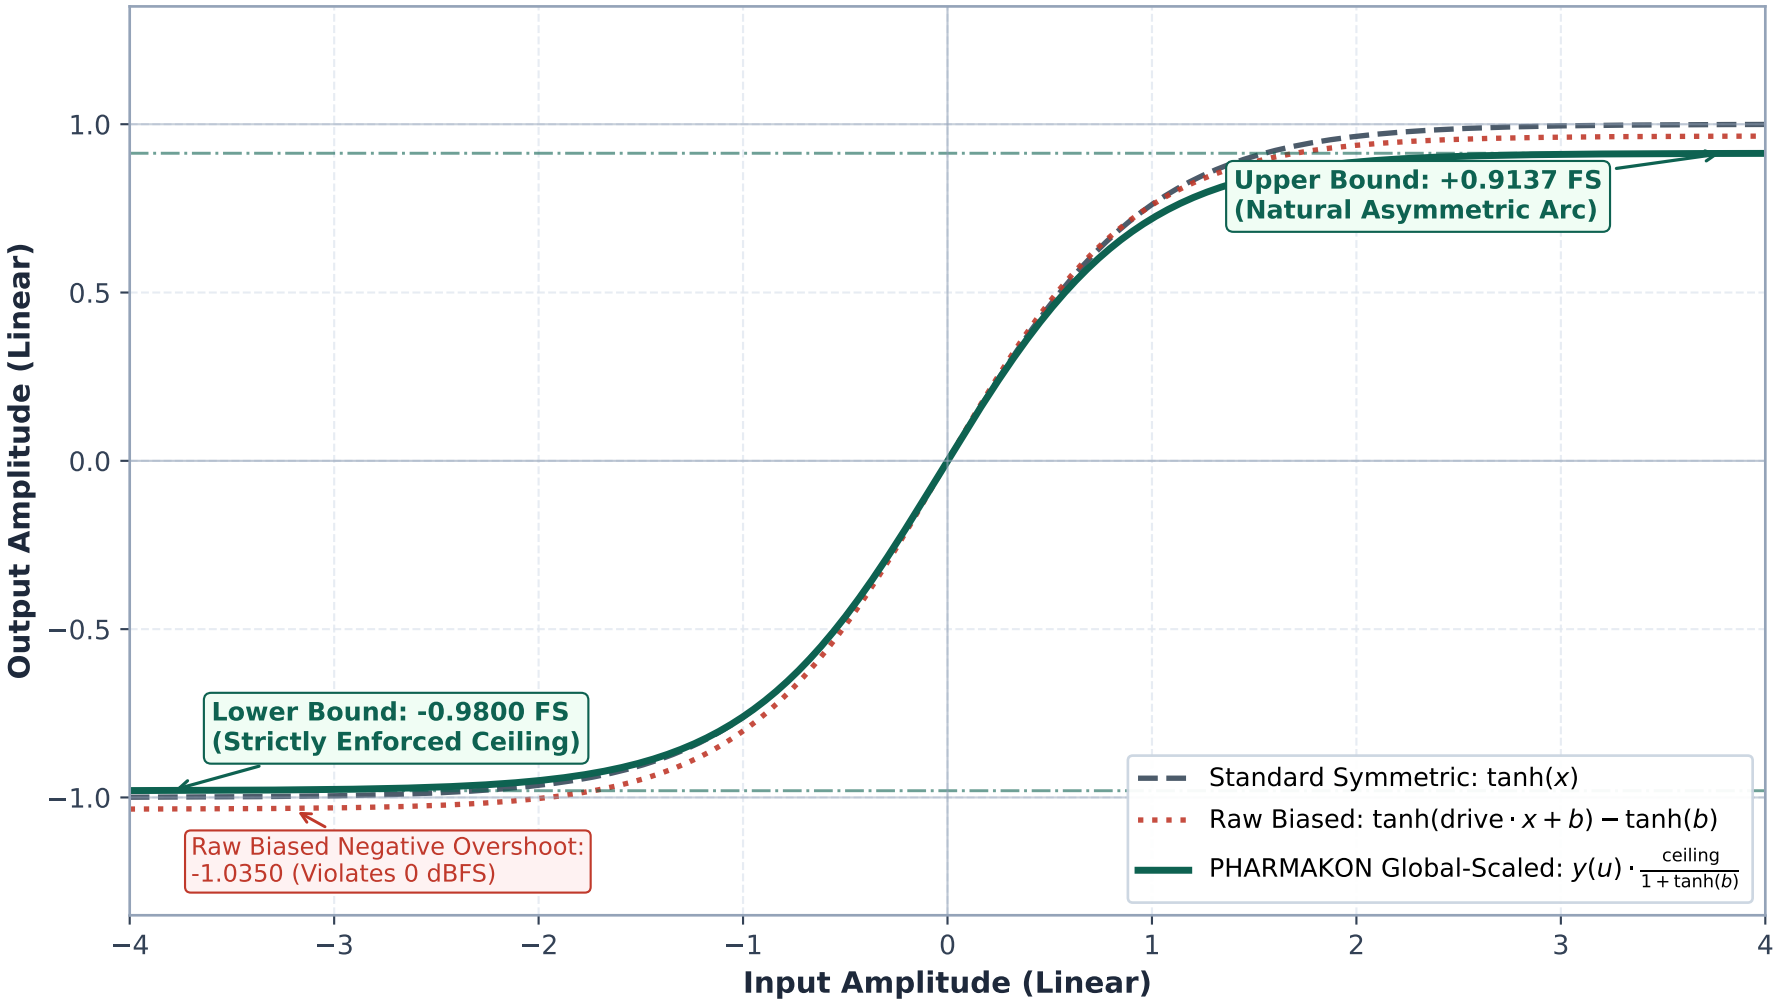
Parameters : drive = 1.05, bias = 0.035, ceiling = 0.98