

---

# Deep Reinforcement Learning in Electricity Generation Investment for the Minimization of Long-Term Carbon Emissions and Electricity Costs

---

Anonymous Author(s)

Affiliation

Address

email

## Abstract

1 A transition from a high-carbon emitting electricity power system to one based  
2 on renewables would aid in the mitigation of climate change. Decarbonization  
3 of the electricity grid would allow for low-carbon heating, cooling and transport.  
4 Investments in renewable energy must be made over a long time horizon to max-  
5 imise return of investment of these long life power generators. Over these long  
6 time horizons, there exist multiple uncertainties, for example in future electricity  
7 demand and costs to consumers and investors.

8 To mitigate for for imperfect information of the future, we use the deep determinis-  
9 tic policy gradient (DDPG) deep reinforcement learning approach to optimize for a  
10 low-cost, low-carbon electricity supply using a modified version of the FTT:Power  
11 model. In this work, we model the UK and Ireland markets. The DDPG algorithm  
12 is able to learn the optimum electricity mix through experience and achieves this  
13 between the years of 2017 and 2050. We find that a transition from fossil fuels and  
14 nuclear power to renewables, based upon wind, solar and wave would provide a  
15 cheap and low-carbon alternative to fossil fuels.

## 1 Introduction

17 A transition from a high carbon electricity supply to a low-carbon system is central to avoiding  
18 catastrophic climate change [1]. A low carbon electricity supply will aid in the decarbonization of  
19 the automotive and heating sectors by allowing for low-carbon electricity to be used in place of oil  
20 and gas. Such a transition must be made in a gradual approach to maintain grid reliability [2].

21 Renewable energy costs, such as solar and wind energy, have reduced over the last ten years, making  
22 them cost-competitive with fossil fuels. These price drops are projected to continue [3]. The future  
23 cost of generation, demand and fuel prices, however, remain uncertain over the long-term future.  
24 These uncertainties are risks which investors must analyze while making long-term decisions.

25 In this paper, we use the deep deterministic policy gradient (DDPG) reinforcement learning algorithm  
26 to simulate the behaviour of investors over a 33-year horizon, between 2017 and 2050 using the  
27 FTT:Power model [4]. FTT:Power is a global power systems model that uses logistic differential  
28 equations to simulate technology switching [5]. The model is parameterized and runs from 2007;  
29 however, the investment decisions began in 2017. We start in this year due to the prior parameteriza-  
30 tion of the FTT:Power model with historical data up until this time. We projected until 2050 because  
31 this is a common target for governments to reach zero carbon. The environment used was a modified  
32 version of the FTT:Power model.

We modified the FTT:Power model to use the DDPG algorithm in place of the logistic differential equations to make investment decisions. In addition, we simulated two countries: the United Kingdom and Ireland. This was achieved through the use of the same FTT:Power model. We choose these due to the wealth of prior work on these countries which can be used for comparison [6, 7]. The DDPG algorithm allows us to simulate the decisions made by investors under imperfect information, such as future electricity costs, taxes and demand. This work enabled us to see whether a low-carbon mix is possible over the next 33-years to avert climate change.

Prior work in this domain has tackled the capacity expansion problem. For example, Oliveira *et al.* also use reinforcement learning for the capacity expansion problem [8]. Whilst Oliveria *et al.* provide detailed calculations of agents for the capacity expansion problem, we reduce this complexity to a series of observations of the environment, to allow for emergent behaviour.

Kazempour *et al.* use a mixed-integer linear programming approach to solve the generation investment problem [9]. In contrast our approach removes the requirement for full knowledge of the time-horizon.

Through this work, it is possible to assess whether a low cost, low-carbon electricity mix is viable over the long-term using a deep reinforcement learning investment algorithm, as well as finding what this optimum mix should be. This work enables us to closely match the investment behaviour of rational agents, without knowledge of the future. It can help guide investors on the choice and proportion of technologies to invest in over the long term.

## 2 Model and methodology

In this paper, we used the Future Technology Transformations system for the power sector model (FTT:Power) [5]. This model represents global power systems based on market competition, induced technological change and natural resource use and depletion. This technological change is dependent on previous cumulative investment [5]. The model uses a dynamic set of logistic differential equations for competition between technology options.

For this work, we modified the FTT:Power model to use the deep reinforcement learning investment algorithm, DDPG. That is, the DDPG algorithm made the size of the investment made in each technology. In addition, we reduced the model only to consider the countries of Ireland and the UK. This enables us to iterate through enough episodes for the reinforcement learning to converge to an optimal reward. With more time, however, it would be possible to undertake this optimisation for the whole world.

### Reinforcement Learning

The investment decision-making process can be formulated as a Markov Decision Process (MDP) [10]. In an MDP environment, an agent receives an observation about the state of their environment  $s_t$ , chooses an action  $a_t$  and receives a reward  $r_t$  as a consequence of their action and the resultant change on the environment. Solving an MDP consists of maximizing the cumulative reward over the lifetime of the agent.

For our simulation environment, the agent makes continuous investment decisions for each energy technology, in each region and each year, starting from 2017 until 2050. Technology switching is modelled using a pairwise comparison of flows of market shares of different electricity generation capacity. That is, how much capacity flows from one technology to another.

The agent’s observation space is a vector consisting of the electricity produced by each technology, total capacity, total CO<sub>2</sub> emissions over the simulation, levelized cost of electricity (LCOE) both with and without taxes, cumulative investment in each technology, investment in new capacity, carrier prices by commodity, fuel costs and carbon costs.

The reward  $r$  is defined as:

$$r = - \left( 1000 \times \text{CO}_{2e} + \frac{\text{LCOE}}{1000} \right), \quad (1)$$

where CO<sub>2e</sub> is equal to total CO<sub>2</sub> emissions over the simulation. The LCOE is calculated without taxes and the scaling factors are used to place the LCOE and CO<sub>2</sub> on the same scale. The reward

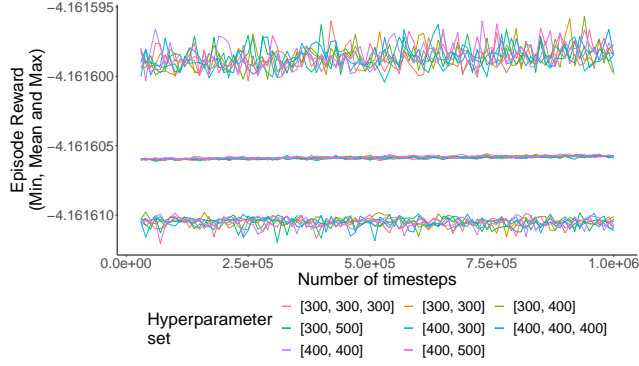


Figure 1: Training with different hyperparameters, displaying the minimum, mean and maximum rewards per episode.

was multiplied by -1 due to the reinforcement learning (RL) algorithm maximizing reward and our requirement to reduce both LCOE and CO<sub>2</sub> emissions.

RL approaches have been used to solve MDP through a trial and error based approach [11]. In recent times RL has been extended to incorporate Deep Reinforcement Learning (DRL). DRL exploits deep neural networks to overcome the problems of memory and computational complexity [12].

We applied the deep deterministic policy gradient (DDPG) DRL algorithm [4] from the Ray RLlib package [13]. The DDPG algorithm is made up of an actor and critic network. We designed both of these to have two hidden layers, made up of 400 and 300 units per layer. The training batch size was set to 40,000. We chose these parameters as they were the default implementation in Ray RLlib. We trialled a variety of different configurations for the number of neurons per layer. To increase the speed of computation, we reduced the simulation to run from 2007 to 2017. We chose this number as it would allow for a transition in the electricity mix. However, we found that the approach worked well, irrespective of parameter choice, as shown by Figure 1. We trialled the use of two and three layers, as well as varying permutations of 300, 400 and 500 neurons. The parameters trialled are shown by Figure 1, where [300, 500] refers to two layers for both the actor and critic network, with 300 neurons in the first layer and 500 in the second. [300, 300, 300] refers to three layers in the actor and critic network, with 300 neurons in each of these three layers.

### 3 Results

Our results show that our investment agent can increase its reward over time, as shown in Figure 2. A total of ~400,000 steps were required to see a levelling off in reward. The total time to simulate ~400,000 steps was ~8 days. We stopped the training and simulation after this time due to diminishing returns and the cost of computation.

Figure 3 displays the results of reinforcement learning algorithm. Before the black vertical line (2017), the investments made are based upon historical data used by FTT:Power. The reinforcement learning algorithm starts to make investments after the black vertical line.

The historical electricity mix before 2017 is based mainly on fossil fuels: coal, combined cycle gas turbine (CCGT) and oil. Additionally, nuclear is a significant component of the electricity mix before 2009. After reinforcement learning optimizes for LCOE and carbon emissions, a rapid transition occurs from fossil fuel and nuclear to renewable energy.

This rapid transition occurs because the RL algorithm does not take into account the technical and timeframe constraints embedded in the unmodified FTT:Power model. However, although it is likely that whilst the transition speed is unrealistic, the electricity mix found by the reinforcement learning algorithm is likely to be optimal, according to the reward function defined in Equation 1.

The primary source of energy after the reinforcement learning algorithm begins is offshore, followed by onshore, solar photovoltaics (PV) and wave. As can be seen by Figure 4, the carbon emissions reduce significantly at the time that the reinforcement learning algorithm begins to control investments.

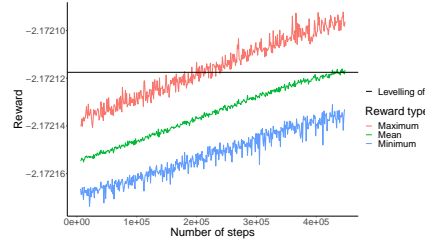


Figure 2: Mean, minimum and maximum rewards over run time.

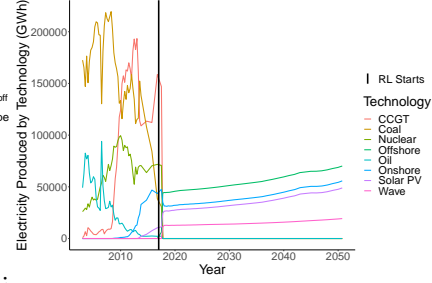


Figure 3: Electricity mix over time.

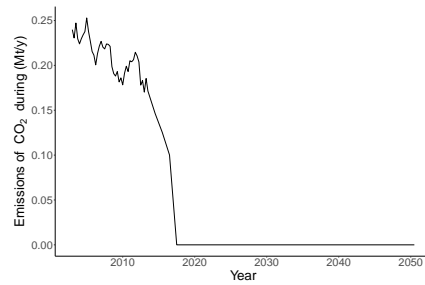


Figure 4: Carbon emissions.

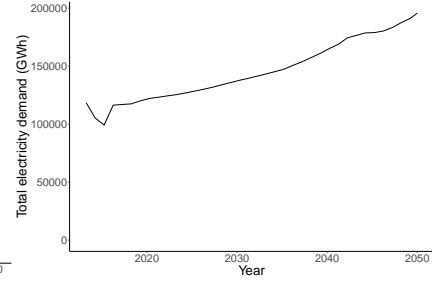


Figure 5: Demand scenario over simulation.

116 This mix of renewable electricity generation across Ireland and the UK allows for demand to be met  
 117 during the quarterly time periods of the model. The demand scenario is shown in Figure 5, where the  
 118 demand can be seen to closely match the electricity mix shown by Figure 3.

## 119 4 Discussion

120 A transition from a high carbon-emitting electricity grid to a low-carbon system is required. In order  
 121 to achieve this, investments in electricity generators must be made whilst taking into account future  
 122 uncertainty. In this paper, we have modelled a central agent which makes investment decisions in an  
 123 uncertain environment to find an optimal low-cost, low-carbon electricity mix. To achieve this, we  
 124 used the reinforcement learning algorithm, DDPG. The environment is modelled using FTT:Power.

125 Through this exercise, we are able to see the optimal electricity mix in the UK and Ireland. We found  
 126 that a mixture of renewable sources such as wind, solar and wave power would meet demand at  
 127 quarter year intervals, as well as providing a cost-effective and low-carbon system.

128 A limitation of this work is the fact that the investment algorithm does not take into account the  
 129 technical and timeframe constraints of transitions between technologies. It is for this reason that  
 130 the reinforcement learning algorithm is able to make such a rapid transition in 2017. However, we  
 131 believe that the investment algorithm is able to find a general solution to the problem of investing in a  
 132 cost-efficient and low-carbon system over a long time horizon.

133 In future work, we would like to increase the number of steps of the FTT:Power model to more  
 134 adequately model the investment behaviour introduced by the reinforcement learning algorithm. A  
 135 lower number of simulated time steps leads to an overestimation of the supply of renewables and  
 136 underestimation of storage and dispatchable technologies [14]. In addition, an increase in the number  
 137 of countries modelled would enable us to see a global picture of how different, interdependent regions  
 138 may evolve in a new climate of a requirement of low-carbon emissions. This would require an  
 139 exponentially longer runtime for the reinforcement learning algorithm to converge. This is due to  
 140 the increased number of decisions that the reinforcement learning algorithm would need to make to  
 141 account for the different countries. Finally, we would like to incorporate the technical and timeframe  
 142 constraints for technology switching. This could be undertaken by modifying the reward function to  
 143 ensure the transition remains within these constraints.

## 5 Acknowledgements

Acknowledgements redacted to maintain anonymity for double-blind.

## References

- [1] A. J. M. Kell, M. Forshaw, and A. S. McGough, “Long-Term Electricity Market Agent Based Model Validation using Genetic Algorithm based Optimization,” *The Eleventh ACM International Conference on Future Energy Systems (e-Energy’20)*, 2020.
- [2] F. Kahrl, J. Williams, D. Jianhua, and H. Junfeng, “Challenges to China’s transition to a low carbon electricity system,” *Energy Policy*, vol. 39, no. 7, pp. 4032–4041, 2011.
- [3] IEA, “Projected Costs of Generating Electricity,” p. 215, 2015.
- [4] J. J. Hunt, A. Pritzel, N. Heess, T. Erez, Y. Tassa, D. Silver, and D. Wierstra, “Continuous learning control with deep reinforcement,” *ICLR*, 2016.
- [5] J. F. Mercure, “FTT:Power A global model of the power sector with induced technological change and natural resource depletion,” *Energy Policy*, vol. 48, pp. 799–811, 2012.
- [6] L. M. H. Hall and A. R. Buckley, “A review of energy systems models in the UK : Prevalent usage and categorisation,” *Applied Energy*, vol. 169, pp. 607–628, 2016.
- [7] N. Hughes and N. Strachan, “Methodological review of UK and international low carbon scenarios,” *Energy Policy*, vol. 38, no. 10, pp. 6056–6065, 2010.
- [8] F. S. Oliveira and M. L. Costa, “Capacity expansion under uncertainty in an oligopoly using indirect reinforcement-learning,” *EJOR*, vol. 267, no. 3, pp. 1039–1050, 2018.
- [9] S. J. Kazempour, A. J. Conejo, and C. Ruiz, “Strategic generation investment using a complementarity approach,” *IEEE Transactions on Power Systems*, vol. 26, no. 2, pp. 940–948, 2011.
- [10] M. L. Puterman, “Markov decision processes: discrete stochastic dynamic programming,” 2014.
- [11] R. S. Sutton and A. G. Barto, “An introduction to reinforcement learning,” *The MIT Press*, 2015.
- [12] K. Arulkumaran, M. P. Deisenroth, M. Brundage, and A. A. Bharath, “A Brief Survey of Deep Reinforcement Learning,” *IEEE Signal Processing Magazine*, pp. 1–16, 2017.
- [13] E. Liang, R. Liaw, P. Moritz, R. Nishihara, R. Fox, K. Goldberg, J. E. Gonzalez, M. I. Jordan, and I. Stoica, “RLlib : Abstractions for Distributed Reinforcement Learning,” 2014.
- [14] S. Ludig, M. Haller, E. Schmid, and N. Bauer, “Fluctuating renewables in a long-term climate change mitigation strategy,” *Energy*, vol. 36, no. 11, pp. 6674–6685, 2011.